

Draft Application for New License
Major Project – Existing Dam

Exhibit B
Project Operations and Resource Utilization
Security Level: Public

Yuba River Development Project
FERC Project No. 2246



Prepared by:
Yuba County Water Agency
1220 F Street
Marysville, CA 95901
www.ycwa.com

Draft - December 2013

Table of Contents
Description

Section No.	Description	Page No.
1.0	Introduction.....	B-1
2.0	Project Overview	B-2
2.1	Use of YCWA’s Water Balance/Operations Model in Exhibit B.....	B-3
2.1.1	Changes in Regulatory Conditions	B-3
2.1.2	Water Delivery Demand	B-4
3.0	Hydrology	B-4
3.1	General	B-4
3.2	Climate	B-5
3.3	Hydrologic Records	B-6
3.4	Basin Transfers and Diversions	B-13
3.5	Typical Dry, Normal and Wet Years	B-13
3.6	Relicensing Hydrologic Records	B-14
4.0	Operations Planning and Forecasting	B-14
4.1	Dry, Normal, and Wet Year Reservoir Operations.....	B-15
4.2	Operations, Maintenance, Inspection, and Access.....	B-16
5.0	Regulatory/Contractual Operating Constraints.....	B-17
5.1	Conditions in Current FERC License	B-17
5.2	Measures in Other Licenses, Agreements and Contracts that Affect Operations.....	B-20
5.2.1	Lower Yuba River Accord (no expiration date in SWRCB Corrected Order Water Right 2008-0014)	B-20
5.2.2	YCWA’s Water Rights for Power (No Expiration Date)	B-22
5.2.3	1965 Cal Fish and Game Agreement (has been fully implemented)	B-23
5.2.4	Water Supply Deliveries	B-23
5.2.5	Davis-Grunsky Agreement (Expires December 31, 2014).....	B-25
5.3	Other Operating Constraints	B-25
5.3.1	Anticipated Water Availability	B-25
5.3.2	YCWA Transfers	B-25
5.3.3	Adherence to 1966 Power Purchase Contract with PG&E.....	B-27
6.0	Existing Operations.....	B-28
6.1	New Colgate Development.....	B-28
6.1.1	Reservoir Operation	B-29
6.1.2	Plant Operations – New Colgate Powerhouse	B-41
6.2	New Bullards Bar Minimum Flow Development.....	B-46
6.2.1	Reservoir Operations	B-46
6.2.2	Plant Operations – New Bullards Bar Minimum Flow Powerhouse	B-46

Table of Contents (continued)

Section No.	Description	Page No.
6.3	Narrows 2 Development	B-50
6.3.1	Reservoir Operations	B-50
6.3.2	Plant Operations – Narrows 2 Powerhouse	B-50
7.0	YCWA’s Proposed Project Operations by Development	B-54
7.1	Proposed Project Conditions Affecting Project Operations	B-54
7.1.1	New Water Year Types for Conditions Pertaining to New Bullards Bar Dam, Our House Diversion Dam, and Log Cabin Diversion Dam.....	B-54
7.1.2	Minimum Flows in the Middle Yuba River Downstream of Our House Diversion Dam.....	B-55
7.1.3	Minimum flows in Oregon Creek Flow Downstream of the Log Cabin Diversion Dam	B-55
7.1.4	Minimum Flows in the North Yuba River Flow Downstream of New Bullards Bar Dam.....	B-56
7.1.5	Control Project Spills at Our House Diversion Dam	B-56
7.1.6	Minimum Flows on the Yuba River below the Narrows 2 Powerhouse and Narrows 2 Full Bypass	B-57
7.1.7	Control Project Spills at New Bullards Bar Dam	B-58
7.2	New Colgate Development.....	B-58
7.2.1	Middle Yuba River Below the Our House Diversion Dam	B-58
7.2.2	Oregon Creek downstream of Log Cabin Dam	B-61
7.2.3	New Bullards Bar Reservoir	B-64
7.2.4	Plant Operations – New Colgate Powerhouse	B-67
7.3	New Bullards Bar Minimum Flow Development.....	B-69
7.3.1	Powerhouse Minimum, Maximum and Mean Flows.....	B-70
7.4	Narrows 2 Development	B-72
8.0	Literature Cited	B-75

List of Figures

Figure No.	Description	Page No.
3.5-1.	Yuba River at Smartsville unimpaired runoff from WY 1970 through WY 2010.....	B-13
3.5-2.	Yuba River at Smarstville water year unimpaired runoff ranked in order of increasing runoff from 1970 through 2010.	B-14
6.1-1.	Our House Diversion Impoundment storage-capacity curve.....	B-30
6.1-2.	Our House Diversion Dam spillway rating curve.....	B-31

List of Figures (continued)

Figure No.	Description	Page No.
6.1-3.	Modeled monthly flow duration curves for the Middle Yuba River downstream of Our House Diversion Dam for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-31
6.1-4.	Modeled monthly flow duration curves for the Lohman Ridge Diversion Tunnel for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-32
6.1-5.	Modeled flow duration curves for the Middle Yuba River downstream of Our House Diversion Dam for the representative dry (2001), normal (2005) and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.....	B-32
6.1-6.	Modeled flow duration curves for the Lohman Ridge Diversion Tunnel for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.....	B-33
6.1-7.	Log Cabin Diversion Impoundment storage-capacity curve.....	B-34
6.1-8.	Modeled monthly flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-35
6.1-9.	Modeled monthly flow duration curves for the Camptonville Diversion Tunnel for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-35
6.1-10.	Modeled flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.....	B-36
6.1-11.	Modeled flow duration curves for the Camptonville Diversion Tunnel for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.....	B-36
6.1-12.	Modeled average-daily storage in New Bullards Bar Reservoir for various percent exceedances for the simulated period of water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-38
6.1-13.	New Bullards Bar Reservoir storage-capacity curve.....	B-39
6.1-14.	Modeled New Bullards Bar Reservoir median and mean storage for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-39
6.1-15.	Modeled New Bullards Bar Reservoir storage for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.....	B-40
6.1-16.	New Bullards Bar Reservoir rule curve.....	B-40

List of Figures (continued)

Figure No.	Description	Page No.
6.1-17.	New Bullard Bar Dam spillway rating curve.....	B-41
6.1-18.	Modeled monthly flow duration curves for New Colgate Powerhouse for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-43
6.1-19.	New Colgate Powerhouse capability curve.	B-44
6.2-1.	Modeled monthly flow duration curves for New Bullards Bar Minimum Flow Powerhouse for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-47
6.2-2.	New Bullards Bar minimum flow powerhouse capability curve.....	B-48
6.3-1.	Modeled monthly flow duration curves for Narrows 2 Powerhouse for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.....	B-51
6.3-2.	Modeled monthly flow duration curves for Narrows 2 Bypass for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.	B-51
6.3-3.	Narrows 2 Powerhouse capability curve.....	B-52
7.2-1.	Modeled monthly flow duration curves for the Middle Yuba River downstream of Our House Diversion Dam for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.	B-59
7.2-2.	Modeled monthly flow duration curves for the Lohman Ridge Diversion Tunnel for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.	B-60
7.2-3.	Modeled flow duration curves for the Middle Yuba River downstream of Our House Diversion Dam for the representative dry (2001), normal (2005) and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative Model run.	B-60
7.2-4.	Modeled flow duration curves for the Lohman Ridge Diversion Tunnel for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative Model run.....	B-61
7.2-5.	Modeled monthly flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.	B-62
7.2-6.	Modeled monthly flow duration curves for the Camptonville Diversion Tunnel for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.	B-62
7.2-7.	Modeled flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative Model run.....	B-63

List of Figures (continued)

Figure No.	Description	Page No.
7.2-8.	Modeled flow duration curves for the Camptonville Diversion Tunnel for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative model run	B-63
7.2-9.	Modeled average-daily storage in New Bullards Bar Reservoir for various percent exceedances for the simulated period of water years 1970 through 2010 under YCWA’s Proposed Project Alternative model run.....	B-66
7.2-10.	Modeled New Bullards Bar Reservoir median and mean storage for water years 1970 through 2010 under YCWA’s Proposed Project Alternative model run.	B-66
7.2-11.	Modeled New Bullards Bar Reservoir storage for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative model run.....	B-67
7.2-12.	Modeled monthly flow duration curves for New Colgate Powerhouse for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.....	B-68
7.3-1.	Modeled monthly flow duration curves for New Bullards Bar Minimum Flow Powerhouse for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.....	B-70
7.4-1.	Modeled monthly flow duration curves for Narrows 2 Powerhouse for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.....	B-73
7.4-2.	Modeled monthly flow duration curves for Narrows 2 Bypass for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.....	B-73

List of Tables

Table No.	Description	Page No.
3.2-1.	Average-monthly precipitation in the vicinity of the Yuba River Development Project.....	B-5
3.3-1.	Descriptions of United States Geological Survey stream, canal, tunnel and powerhouse flow and reservoir storage gages in the Yuba River watersheds near the Project for USGS period of record.	B-7
3.3-2.	Summary of hydrologic data from USGS stream, canal, tunnel and powerhouse flow gages in the Yuba River watersheds near the Project for USGS period of record.....	B-11
3.4-1.	In-basin transfers associated with the Project.	B-13
5.1-1.	New Bullards Bar Reservoir flood storage space allocation in thousands of acre-feet.....	B-19

List of Tables (continued)

Table No.	Description	Page No.
5.2-1.	Yuba Accord flow schedules.	B-21
5.2-2.	North Yuba River Index Schedule Year-Types	B-21
5.2-3.	Water right licenses held by YCWA for operation of the Project for power generation.....	B-22
5.2-4.	YCWA’s annual contract amounts and place of delivery.....	B-24
5.2-5.	YCWA’s water supply contract shortage provisions.....	B-24
5.3-1.	YCWA historical sales from 1987 to 2010.....	B-26
5.3-2.	Storage criteria for New Bullards Bar Reservoir under 1966 PG&E Power Purchase Contract.	B-27
5.3-3.	Minimum required power production under 1966 PG&E Power Purchase Contract.....	B-28
6.1-1.	Modeled minimum and maximum elevations in New Bullards Bar Reservoir in the representative dry (2001), normal (2005) and wet (1998) water years under YCWA’s No Action Alternative Model run.	B-38
6.1-2.	Modeled generation and plant factors for New Colgate Powerhouse under YCWA’s No Action Alternative Model run.	B-44
6.2-1.	Modeled generation and plant factors for New Bullards Bar Minimum Flow Powerhouse under YCWA’s No Action Alternative Model run.	B-48
6.3-1.	Generation and plant factors for Narrows 2 Powerhouse under YCWA’s No Action Alternative Model run.	B-53
7.1-1.	Smartsville hydrological index Water Year types and associated thresholds....	B-55
7.1-2.	Proposed Project flow requirements for the Middle Yuba River downstream of Our House Diversion Dam by Smartsville hydrological index Water Year type.	B-55
7.1-3.	Proposed Project flow requirements for Oregon Creek downstream of Log Cabin Diversion Dam by Smartsville Hydrological Index Water Year Type.	B-56
7.1-4.	Proposed Project Flow Requirements for the North Yuba River below New Bullards Bar Dam by Smartsville Hydrological Index Water Year-Type.	B-56
7.1-5.	Proposed Project flow requirements for the Yuba River downstream of Narrows 2 Powerhouse and Narrows 2 full flow bypass by North Yuba Index Flow Schedule.....	B-57
7.2-1.	Modeled minimum and maximum elevations in New Bullards Bar Reservoir in the representative dry (2001), normal (2005) and wet (1998) water years under YCWA’s Proposed Project Alternative model run.	B-65
7.2-2.	Modeled generation and plant factors for New Colgate Powerhouse under the Proposed Project Alternative model run.	B-68

List of Tables (continued)

Table No.	Description	Page No.
7.3-1.	Modeled generation and plant factors for New Bullards Bar Minimum Flow Powerhouse under YCWA’s Proposed Project Alternative Model run.	B-71
7.4-1.	Generation and plant factors for Narrows 2 Powerhouse under YCWA’s Proposed Project Alternative Model run.....	B-74

List of Attachments

None.

Page Left Blank

EXHIBIT B

Project Operations and Resource Utilization

1.0 Introduction

The Yuba County Water Agency (YCWA or YCWA) has prepared this Exhibit B, Project Operations and Resource Utilization, as part of its application for a new license from the Federal Energy Regulatory Commission (FERC) for the Yuba River Development Project (Project), FERC Project No. 2246. This exhibit is prepared in conformance with Title 18 of the Code of Federal Regulations (C.F.R.), Subchapter B (Regulations Under the Federal Power Act), Part 4 (Licenses, Permits, Exemptions and Determination of Project Costs), Subpart F (Application for a New License Major Project – Existing Dam). In particular, this Exhibit B conforms to the regulations in 18 C.F.R. § 4.51(C), and describes Project operations as proposed by YCWA in this application for new license. As a reference, 18 C.F.R. § 4.51(c) states:

Exhibit B is a statement of project operation and resource utilization. If the project includes more than one dam with associated facilities, the information must be provided separately for each such discrete development. The exhibit must contain:

- (1) A statement whether operation of the powerplant will be manual or automatic, an estimate of the annual plant factor, and a statement of how the project will be operated during adverse, mean, and high water years,
- (2) An estimate of the dependable capacity and average annual energy production in kilowatt-hours (or a mechanical equivalent), supported by the following data:
 - (i) The minimum, mean, and maximum recorded flows in cubic feet per second of the stream or other body of water at the powerplant intake or point of diversion, with a specification of any adjustment made for evaporation, leakage, minimum flow releases (including duration of releases), or other reductions in available flow, monthly flow duration curves indicating the period of record and the gauging stations used in deriving the curves, and a specification of the period of critical stream flow used to determine the dependable capacity,
 - (ii) An area-capacity curve showing the gross storage capacity and usable storage capacity of the impoundment, with a rule curve showing the proposed operation of the impoundment and how the usable storage capacity is to be utilized;
 - (iii) The estimated minimum and maximum hydraulic capacity of the powerplant (maximum flow through the powerplant) in cubic feet per second;
 - (iv) A tailwater rating curve; and
 - (v) A curve showing powerplant capability versus head and specifying maximum, normal, and minimum heads.
- (3) A statement, with load curves and tabular data, if necessary, of the manner in which the power generated at the project is to be utilized, including the amount of power to be used on-site, if any, the amount of power to be sold, and the identity of any proposed purchasers; and
- (4) A statement of the applicant's plans, if any, for future development of the project or of any other existing or proposed water power project on the stream or other body of water, indicating the approximate location and estimated installed capacity of the proposed developments.

Besides this introductory section, this Exhibit B includes 7 sections. Section 2.0 gives an overview of existing Project operations. Section 3.0 describes historical hydrology representative of the Project area. Section 4.0 describes operations planning and forecasting. Section 5.0 summarizes regulatory and contractual operating constraints of the Project. Section 6.0 describes project operations for each development. Section 7.0 describes YCWA's proposed operations. Section 8.0 includes a list of references cited.

See Exhibit A for a description of Project facilities and features, Exhibit C for a construction history and a construction schedule, Exhibit D for a description of Project costs and financing, and Exhibit E for a discussion of potential environmental effects and YCWA's proposed resource management measures. Project design drawings and Project maps are included in Exhibit F and G, respectively. Exhibit H contains a detailed description of the need for the electricity provided by the Project, the availability of electrical energy alternatives and other miscellaneous information.

All elevation data in this exhibit are in National Geodetic Vertical Datum of 1929 (NGVD 29) unless otherwise specified.

2.0 Project Overview

The existing Project consists of three developments – New Colgate, New Bullards Bar Minimum Flow and Narrows 2 – which, in total, include: one main dam; two diversion dams; four water tunnels; three powerhouses with associated switchyards with a combined capacity of 361.9 megawatts (MW); and appurtenant facilities and structures, including recreation facilities, gages and roads.

The Project, constructed and operated by YCWA, is a multiple-use project that provides flood control, power generation, irrigation, recreation, and protection and enhancement of fish and wildlife. It includes Our House and Log Cabin diversion dams, New Bullards Bar Dam and Reservoir, New Colgate Powerhouse and Narrows 2 Powerhouse.

Total usable storage capacity of the Project is 966,103 acre-feet (ac-ft). New Bullards Bar Reservoir, the Project's largest reservoir, operates as a storage reservoir to capture rain and snowmelt during the winter and spring months and are slowly drawn down through summer and fall months, releasing water for power generation, irrigation and domestic consumption purposes. Consequently, New Bullards Bar Reservoir reaches its peak storage at the end of the spring runoff season, and then is gradually drawn down as storage is released to the Yuba River. Releases are made through both the New Bullards Bar Minimum Flow Powerhouse at the base of the dam to the North Yuba River and through the New Colgate Power Tunnel and the New Colgate Powerhouse on the Yuba River. The reservoir usually reaches its lowest elevation in early to mid-winter. The annual drawdown in normal water years is about 90 ft. The reservoir does not undergo significant daily changes in elevation.

New Bullards Bar Reservoir is used to provide irrigation water supply to about 90,000 acres (ac) of farmland in western Yuba County. Releases of water from storage are made through the

spring and summer to provide flows diverted at USACE's Daguerre Point Dam at river mile (RM) 11.6 on the Yuba River. Water is released from storage in the fall for diversion at USACE's Daguerre Point Dam for rice stubble decomposition and waterfowl habitat.

New Bullards Bar Reservoir is also the main flood control facility for the Yuba River area. 170,000 ac-ft of storage capacity, or approximately 23-percent of the usable capacity of the reservoir, is reserved from September 15 through March 31 for flood protection purposes.

In addition to providing flood protection, power and downstream water supply, YCWA pumps water directly from the New Bullards Bar Reservoir to supply water to the Cottage Creek Water Treatment Plant for Project recreation uses. Pumping averages approximately 6 ac-ft per year. This relatively small volume of pumping does not affect Project operations.

2.1 Use of YCWA's Water Balance/Operations Model in Exhibit B

YCWA has operated the Project since 1970. However, Project operations have changed through time. Therefore, in some cases historical operations information (e.g., flows, storage and generation) may not provide the best picture of current existing conditions. To better describe existing operations over a range of hydrologic conditions, YCWA developed the Yuba River Development Project Water Balance/Operations Model (Operations Model).¹

Current project operations are simulated using historical inflows to the Project from water year (WY) 1970 through WY 2010 to simulate a 41-year long record of what flows throughout the system would have been if existing infrastructure and regulations had been in place for the full period of record.

A comparison of the results of the Operations Model run and historical operations yields similar, but different results. The difference is primarily due to changes in regulatory conditions and changes in agricultural water supply demand. Because of these factors, direct comparison of No Action Alternative and Historical Operations is not a relevant comparison. These two factors are further discussed below.

2.1.1 Changes in Regulatory Conditions

The existing conditions Operations Model run uses as input existing regulatory conditions for Project operations. These regulatory conditions include YCWA's water rights, the initial FERC license and amendments, the U.S. Army Corps of Engineers (USACE) Flood Control Manual, agreements with Pacific Gas & Electric Company (PG&E), agreements with the California Department of Fish and Wildlife (Cal Fish and Wildlife) and the Lower Yuba River Accord (Yuba Accord).

¹ The Operations Model, including various runs, is provided in Exhibit E, Appendix E6, of YCWA's Application for New License.

While the majority of the regulatory conditions affecting Project operations have not changed throughout the simulated period of record, the Yuba River Accord is a fairly recent change and has a substantial effect on overall Project operations. The Project was operated according to the Yuba Accord requirements in 2006 and 2007, as pilot projects, and the California State Water Resource Control Board (SWRCB) incorporated the Yuba Accord into YCWA's water rights in 2008 (SWRCB 2008). Accordingly, historical Project operations from 2006 through 2010 reflected the Yuba Accord.

Prior to 2006, Project operations included a wide range of regulatory conditions and operational agreements that are no longer relevant for Project operations, including the following:

- Prior to 1986, when infrastructure to deliver surface water to the southern parts of the county was completed, power generation was a major factor in the seasonal operations of New Bullards Bar Dam and Reservoir. Historical New Bullards Bar Reservoir storage during this period was subject to substantial annual variations, since there was not as much need to preserve storage for water supply reliability.
- YCWA conducted single-year water transfers in 1987, 1988, 1989, 1990, 1991, 1992, 1994, 1997, 2001, 2002, 2003, 2004, 2005, 2006 and 2007. These single-year transfers were individually approved by the SWRCB and were each scheduled according to the hydrology of the individual years.
- In 2001, the SWRCB (2003) issued Decision 1644 (revised and re-issued as Revised Decision 1644 in 2003) adding flow requirements on the Yuba River at Marysville and Smartsville to YCWA's water rights.

2.1.2 Water Delivery Demand

YCWA annual surface water irrigation demands have changed substantially since 1970 due to both the addition of lands for surface water irrigation and changes in land use. Additionally, many of the YCWA member units have participated in groundwater substitution transfers, where they elect to pump groundwater for irrigation and allow the surface water they would otherwise have received, to be released for subsequent use by entities outside of the Yuba River watershed. These combinations of factors have precluded the use of historical irrigation records as a representative demand for simulation. Accordingly, YCWA developed a synthetic demand, based on land use and applied water factors, for use in Operations Model.²

3.0 Hydrology

3.1 General

The Project is located in the Yuba River Basin and drains approximately 1,339 square miles (sq mi) (USGS 2004) of the western slope of the Sierra Nevada mountains, including portions of

² A complete description of the agricultural diversion demand timeseries is included in Attachment 2-2A to the *Water Balance/Operations Model*, Technical Memorandum 2-2.

Sierra, Placer, Yuba and Nevada counties. The Yuba River is a tributary of the Feather River, which in turn is a tributary of the Sacramento River. The basin rises from an elevation of about 88 ft to about 8,590 ft. From 1901 through 2005, the annual unimpaired flow at the United States Geological Survey’s (USGS) Smartsville Gage on the Yuba River has ranged from a high of 4,930,000 ac-ft in 1982 to a low of 370,000 ac-ft in 1977, with an average of about 2,370,000 ac-ft per year.³ In general, basin runoff is nearly equally divided between runoff from rainfall during October through March and runoff from snowmelt during April through September.

Upper basins of the Middle Yuba and South Yuba rivers have been extensively developed for hydroelectric power generation and consumptive uses by the Nevada Irrigation District (NID) and PG&E. Total storage capacity of about 307,000 ac-ft on the Middle Yuba and South Yuba rivers and associated diversion facilities enable both NID and PG&E to export approximately 410,000 ac-ft per year from the Yuba River Basin to the Bear River and American River basins. In addition, the South Feather Water and Power Agency exports an average of about 70,000 ac-ft per year from Slate Creek (a tributary to the North Yuba River) to the Feather River Basin. While these upper basins lie outside of the Project study area, their operations can significantly reduce the water supply available to the Project, particularly during dry and critical water years.

3.2 Climate

The Yuba River basin has dry, warm summers with little to no precipitation and cool, wet winters with moderate to heavy precipitation; usually in the form of snow above elevation 5,000 ft. Annual temperatures in the Project Area⁴ range from below zero degrees Fahrenheit (°F) to above 100°F.

Average-annual precipitation data obtained from the California Department of Water Resources (DWR), Division of Flood Management, California Data Exchange Center (CDEC) stations in the Project basin ranges from approximately 20.55 inches near Marysville, California, at elevation 88 ft, to approximately 58.35 inches near Camptonville, California at elevation 2,503 ft. Monthly average precipitation for Camptonville and Marysville stations are provided in Table 3.2-1.

Table 3.2-1. Average-monthly precipitation in the vicinity of the Yuba River Development Project.

Average-Monthly Precipitation (inches)		
Month	City of Camptonville	City of Marysville
January	11.71	4.55
February	9.1	3.42
March	7.86	2.4
April	4.78	1.65

³ The forecasted seasonal unimpaired flow at Smartsville is estimated each year by DWR and reported monthly in Bulletin 120, *Water Conditions in California*. The unimpaired flow at Smartsville controls YCWA contractual delivery obligations to senior water right holders on the Yuba River downstream of Narrows 2 Powerhouse, and is used to calculate the Yuba River Index (YRI), defined in RD-1644, and the North Yuba Index (NYI), defined in the Yuba Accord.

⁴ For the purposes of this document, “Project Area” is defined as the area within the FERC Project Boundary and the land immediately surrounding the FERC Project Boundary (i.e., within about 0.25-mi of the FERC Project Boundary) and includes Project-affected reaches between facilities and downstream to the next major water controlling feature or structure.

Table 3.2-1. (continued)

Month	Average-Monthly Precipitation (inches)	
	City of Camptonville	City of Marysville
May	2.37	0.44
June	0.75	0.24
July	0.13	0.07
August	0.17	0.1
September	0.66	0.31
October	3.58	1.3
November	7.02	2.7
December	10.22	3.37
Yearly	58.35	20.55

3.3 Hydrologic Records

There are 16 active USGS flow and reservoir gaging stations in the Project Area: 1 reservoir (elevation or storage) gaging station; 12 stream flow gaging stations; 3 tunnel and canal gages; and 1 powerhouse flow gaging stations. There are also 4 additional gages within the Project Area that include valuable historical information about the operations of the Project. Table 3.3-1 summarizes physical information such as location, elevation, and period of record for each USGS gage within the Project area. Table 3.3-2 summarizes USGS flow gage data, such as mean annual flows and maximum- and minimum-recorded flows (USGS 1992).

Table 3.3-1. Descriptions of United States Geological Survey stream, canal, tunnel and powerhouse flow and reservoir storage gages in the Yuba River watersheds near the Project for USGS period of record.

USGS Gage No.	Gage Name	Comment	Location	Elevation (ft)	Drainage (sq mi)	Period of Record Start	Period of Record End
RIVER FLOW GAGES							
11408850	M Yuba R Nr Camptonville CA	NA	N/A	N/A	136	8/1/1967	9/30/1989
11408880	Middle Yuba River Below Our House Dam, Near Camptonville, CA	Natural flow of stream affected by Jackson Meadows Reservoir (station 11407800), Milton–Bowman Tunnel (station 11408000), which diverts upstream from station to Bowman Lake (station 11415500), and Lohman Ridge Tunnel (station 11408870), which diverts 300 ft upstream to Oregon Creek and then to New Bullards Bar Reservoir (station 11413515) via Camptonville Tunnel (station 11409350). Other small diversions upstream from station.	On right bank, 300 ft downstream from Our House Dam, and 4.0 mi southeast of Camptonville	1957.51 (NGVD 1929)	145	10/1/1968	Present
11409300	Oregon CA Camptonville CA	N/A	On left bank, 500 ft downstream from Log Cabin Dam, 670 ft upstream from High Point Ravine, and 1.1 mi southwest of Camptonville	2,230 (NGVD 1929)	23	10/1/1967	9/30/2000
11409400	Oregon Creek Below Log Cabin Dam, Near Camptonville, CA	Lohman Ridge Tunnel (station 11408870) diverts water into the basin from the Middle Yuba River. Camptonville Tunnel (station 11409350), maximum capacity, about 1,000 ft ³ /s, 520 ft upstream, diverts water out of the basin to New Bullards Bar Reservoir (station 11413515); diversion began October 1968.	On left bank, 500 ft downstream from Log Cabin Dam, 670 ft upstream from High Point Ravine, and 1.1 mi southwest of Camptonville	1,912.73 (NGVD 1929)	29.1	9/1/1968	Present
11413000	North Yuba River Below Goodyears Bar, CA	Records good. Several small diversions upstream from station for irrigation and mining.	On right bank, 200 ft downstream from St. Catherine Creek, 3.1 mi southwest of Goodyears Bar, and 6.4 mi southwest of Downieville	2,453 (NGVD 1929)	250	10/01/1930	Present
11413300	Slate Creek Below Diversion Dam, Near Strawberry Valley, CA	Slate Creek Tunnel (station 11413250) diverts up to 900 ft ³ /s from Slate Creek Reservoir, capacity, 223 ac-ft, at diversion dam 300 ft upstream, to Sly Creek Reservoir (station 11395400). Diversion began in February 1962.	On right bank, 300 ft downstream from diversion dam, 0.2 mi upstream from Fenev Ravine, and 4.5 mi northeast of town of Strawberry Valley.	3,570 (NGVD 1929)	49.4	10/01/1960	Present

Table 3.3-1. (continued)

USGS Gage No.	Gage Name	Comment	Location	Elevation (ft)	Drainage (sq mi)	Period of Record Start	Period of Record End
RIVER FLOW GAGES (continued)							
11413520	North Yuba River Below New Bullards Bar Dam, Near North San Juan, CA	Flow regulated by New Bullards Bar Reservoir (station 11413515) since 1969. Prior to 1969, flow regulated by Bullards Bar Reservoir (usable capacity, 31,500 ac-ft). New Colgate Powerhouse (station 11413510) diverts at New Bullards Bar Dam 0.2 mi upstream. Records include flow over New Bullards Bar Reservoir spillway.	On right bank, at old Colgate Dam, 0.2 mi downstream from New Bullards Bar Dam, and 2.5 mi northwest of North San Juan.	1,350 (NGVD 1929)	489	8/13/1966	9/30/2004
11417500	South Yuba River At Jones Bar, Near Grass Valley, CA	Flow regulated by Lake Spaulding, Fordyce Lake, and Bowman Lake (stations 11414140, 11414090, and 11415500) and many smaller reservoirs. Diversions into and out of basin for several powerhouses and for irrigation.	On left bank at Jones Bar, 100 ft upstream from Rush Creek, 0.9 mi downstream from bridge on State Highway 49, and 5 mi northwest of Grass Valley.	1,060 (NGVD 1929)	308	10/01/1940	Present
11418000	Yuba River Below Englebright Dam, Near Smartsville, CA	Diversions up to 1,800 ft ³ /s (see stations 11413250, 11414190, and 11414200) out of basin for power and irrigation upstream from station. Flow regulation by Lake Spaulding (station 11414140), Jackson Meadows and New Bullards Bar Reservoirs (stations 11407800 and 11413515), Englebright Reservoir beginning in 1941, capacity 54,339.8 ac-ft (revised), Bowman and Fordyce Lakes (stations 11415500 and 11414090), and many smaller reservoirs.	On right bank, 2,000 ft downstream from Englebright Dam, 0.5 mi upstream from Deer Creek, and 2.3 mi northeast of Smartsville.	278.68 (NGVD 1929)	1,108	10/01/1941	Present
11418500	Deer Creek Near Smartsville, CA	Natural flow of stream is affected by Scotts Flat Reservoir beginning in 1949, usable capacity, 26,300 ac-ft, increased to 49,000 ac-ft in July 1964; Deer Creek Reservoir, capacity 1,400 ac-ft beginning 1949; Lake Wildwood, capacity 3,840 ac-ft beginning in 1970, power developments and diversion for irrigation. At times water from South Yuba River is diverted to Deer Creek and water from Deer Creek is diverted to Bear River.	On left bank, 400 ft upstream from county road bridge, 0.9 mi upstream from mouth, and 2 mi northeast of Smartsville.	630 (NGVD 1929)	84.6	10/01/1935	Present
11421000	Yuba River Near Marysville, CA	Flow regulated by New Bullards Bar Reservoir since January 1969, and several other reservoirs. Many diversions upstream from station for power and for irrigation.	On left bank, 4.2 mi northeast of Marysville, and 5 mi downstream from Dry Creek	-2.95 (NGVD 1929)	1,339	10/01/1943	Present

Table 3.3-1. (continued)

USGS Gage No.	Gage Name	Comment	Location	Elevation (ft)	Drainage (sq mi)	Period of Record Start	Period of Record End
RIVER FLOW GAGES (cont.)							
11413517	North Yuba River Low Flow Release Below New Bullards Bar Dam, CA	No records computed above 10.0 ft ³ /s. Flow regulated by New Bullards Bar Reservoir (station 11413515) since 1969. Prior to 1969, flow regulated by Bullards Bar Reservoir (usable capacity 31,500 ac-ft). New Colgate Powerhouse (station 11413510) diverts at New Bullards Bar Dam 0.2 mi upstream. Water is diverted to Feather River Basin through Slate Creek Tunnel (station 11413250). Camptonville Tunnel (station 11409350) diverts water from Middle Yuba River to New Bullards Bar Reservoir. Prior to October 2004, data published with New Bullards Bar Reservoir spillway as North Yuba River downstream of New Bullards Bar Dam (station 11413520).	On right bank 0.2 mi downstream from dam, and 2.7 mi northwest of North San Juan which is on State Highway 49.	1,350	489	10/01/2004	Present
TUNNEL AND CANAL FLOW GAGES							
11408870	Lohman Ridge Tunnel At Intake, Near Camptonville, CA	Tunnel diverts water from Middle Yuba River to New Bullards Bar Reservoir (station 11413515) for power development.	At tunnel intake at Our House Dam, and 4.0 mi southeast of Camptonville	2,014.77 (NGVD 1929)	N/A	10/01/1988	Present
POWERHOUSE FLOW GAGES							
11409350	Camptonville Tunnel At Intake, Near Camptonville, CA	Water is diverted to Oregon Creek from the Middle Yuba River through Lohman Ridge Tunnel (station 11408870) 1,000 ft upstream. Camptonville Tunnel diverts water from Oregon Creek to New Bullards Bar Reservoir (station 11413515) for power generation	At tunnel intake, at Log Cabin Dam, 1.0 mi southwest of town of Camptonville	1,952.00 (NGVD 1929)	N/A	10/01/1988	Present
11413250	Slate Creek Tunnel Near Strawberry Valley, CA	Tunnel diverts water from Slate Creek to Sly Creek Reservoir (station 11395400) for power development.	On right bank, 30 ft upstream from diversion dam on Slate Creek, 0.3 mi upstream from Fenev Ravine, and 4.5 mi northeast of town of Strawberry Valley.	N/A	N/A	10/01/1962	Present
11417980	Narrows PH No 2 Bl Englebright Dam CA	N/A	N/A	N/A	N/A	10/01/1970	9/30/2011
11417970	Narrows No 1 PH A Englebright Dam CA	N/A	N/A	N/A	N/A	10/01/1974	9/30/2011

Table 3.3-1. (continued)

USGS Gage No.	Gage Name	Comment	Location	Elevation (ft)	Drainage (sq mi)	Period of Record Start	Period of Record End
POWERHOUSE FLOW GAGES (continued)							
11413510	New Colgate Powerplant Near French Corral, CA	Water is diverted from North Yuba River at New Bullards Bar Reservoir (station 11413515). Colgate Powerhouse was rebuilt during the 1970 water year with an increased capacity. Prior to Oct. 31, 1973, Browns Valley Ditch diverted up to 10 ft ³ /s at times from the head of the penstock for use in irrigation.	At powerhouse, on right bank of Yuba River, 0.3 mi upstream from Dobbins Creek, and 2.3 mi northwest of French Corral	N/A	N/A	10/01/1966	Present
RESERVOIR STORAGE GAGES							
11413515	New Bullards Bar Reservoir Near North San Juan, CA	Reservoir is formed by concrete-arch dam with a concrete-sidehill spillway. Spill controlled by three 30-ft by 53-ft radial gates. Storage began in January 1969. Usable capacity, 727,380 ac-ft, between elevations 1,732.0 ft, minimum power pool and 1,956.0 ft, normal gross pool. Dead storage, 234,000 ac-ft. Total capacity at normal gross pool, 961,400 ac-ft, elevation, 1,956.0 ft. Water is released to New Colgate Powerhouse (station 11413510) through a tunnel at the dam. Water is diverted into the reservoir from Middle Yuba River via Lohman Ridge Tunnel to Oregon Creek then via Camptonville Tunnel (stations 11408870 and 11409350). Records, excluding extremes, represent total contents at 2400 hours.	In center of dam on North Yuba River, 2.2 mi upstream from Middle Yuba River, and 2.4 mi northwest of North San Juan	1,965 (NGVD 1929)	489	1/14/1969	Present
11417950	Harry L. Englebright Lake near Smartsville, CA	Reservoir is formed by a concrete arch dam, 1,142 ft long and 260 ft tall, completed in 1941 by the Army Corps of Engineers, water storage began the same year. Gross pool is 70,000 ac-ft, usable storage, 45,000 ac-ft between elevation of spill lip, 527 ft and elevation of intake to Narrows Powerplant No. 1 (station 11417970); 450 ft. Reservoir receives inflow from North, Middle and South Forks of Yuba River which are regulated releases except during spill conditions. Dam has no low-level outlet except water that is released through Narrows Powerplant Nos. 1 and 2 (station 11417980).	In intake tower on right bank of reservoir, 0.9 mi upstream from Deer Creek and 2.7 mi northeast of Smartsville.	527 (NGVD 1929)	1,108	10/01/1973	9/30/2001

N/A = Not Available

Table 3.3-2. Summary of hydrologic data from USGS stream, canal, tunnel and powerhouse flow gages in the Yuba River watersheds near the Project for USGS period of record.

USGS Gage		Mean Annual (cfs)				Mean Monthly (cfs)		Mean Daily (cfs)		Instantaneous (cfs)	
Gage Number	Gage Name	Mean	Median	Highest (year)	Lowest (year)	Highest (month)	Lowest (month)	Highest (date)	Lowest (date)	Highest (date)	Lowest (date)
RIVER FLOW GAGES											
11408850	M Yuba R Nr Camptonville CA	332	186	779 (1982)	37 (1977)	2,038 (Feb)	12 (Aug)	16,800 (17 Feb 1986)	11 (17 Aug 1977)	47,000 (1 Jan 1997)	N/A
11408880	Middle Yuba River Below Our House Dam, Near Camptonville, CA	127	37	521 (1969)	26 (1977)	2,973 (Jan)	7 (Jan)	21,000 (2 Jan 1997)	2 (10 Jan 1982)	27,500 (2 Jan 1997)	N/A
11409300	Oregon C A Camptonville CA	69	20	146 (1982)	5 (1977)	664 (Feb)	1 (Periodic)	3,730 (1 Jan 1997)	0.53 (15 Aug 1997)	5170 (1 Jan 1997)	N/A
11409400	Oregon Creek Below Log Cabin Dam, Near Camptonville, CA	27	11	128 (1969)	4 (1977)	617 (Feb)	1 (Periodic)	5340 (17 Feb 1986)	0.34 (18 Sept 1972)	6400 (17 Feb 1986)	N/A
11413000	North Yuba River Below Goodyears Bar, CA	729	424	1,566 (1982)	141 (1977)	4,526 (Jan)	67 (Aug)	29,600 (2 Jan 1997)	60 (Sep 1977)	45,500 (2 Jan 1997)	N/A
11413300	Slate Creek Below Diversion Dam, Near Strawberry Valley, CA	102	17	352 (1982)	10 (1976)	1,415 (Feb)	4 (Aug)	12,100 (1 Jan 1997)	0.3 (4 Mar 1962)	17,300 (1 Jan 1997)	N/A
11413520	North Yuba River Below New Bullards Bar Dam, Near North San Juan, CA	290	26	1,560 (1967)	5 (1977)	8,990 (Jan)	2 (Periodic)	48,200 (19 Feb 1986)	0.4 (5 Nov 1966)	91,600 (22 Dec 1964)	N/A
11417500	South Yuba River At Jones Bar, Near Grass Valley, CA	431	200	1,135 (1995)	43 (1977)	4,865 (Jan)	1 (Sept)	30,300 (2 Jan 1977)	1 (10 Sept 1944)	53,600 (24 Dec 1964)	N/A
11418000	Yuba River Below Englebright Dam, Near Smartsville, CA	2,449	1,653	5,251 (1982)	414 (1977)	22,351 (Jan)	41 (Nov)	13,4000 (2 Jan 1997)	0 (Periodic)	171,000 (22 Dec 1964)	N/A
11418500	Deer Creek Near Smartsville, CA	122	27	327 (1983)	5 (1977)	1,418 (Jan)	0 (Periodic)	10,200 (17 Feb 1986)	0 (5 Aug 1977)	16,000 (31 Dec 2005)	N/A
11421000	Yuba River Near Marysville, CA	2,419	1,490	5,818 (1982)	229 (1977)	26,180 (Jan)	31 (Jul)	140,000 (2 Jan 1997)	15 (Periodic)	180,000 (24 Dec 1964)	N/A
11413517	North Yuba River Low Flow Release below New Bullards Bar Dam, CA	7	6	7 (Periodic)	6 (Periodic)	6 (Periodic)	8 (Periodic)	10 (17 Mar 2004)	5 (19 Mar 2011)	N/A	N/A
TUNNEL AND CANAL FLOW GAGES											
11408870	Lohman Ridge Tunnel At Intake, Near Camptonville, CA	180	92	377 (2011)	72 (2001)	789 (May)	0 (Periodic)	850 (20 May 2005)	0 (Periodic)	N/A	N/A

Table 3.3-2. (continued)

USGS Gage		Mean Annual (cfs)				Mean Monthly (cfs)		Mean Daily (cfs)		Instantaneous (cfs)	
Gage Number	Gage Name	Mean	Median	Highest (year)	Lowest (year)	Highest (month)	Lowest (month)	Highest (date)	Lowest (date)	Highest (date)	Lowest (date)
TUNNEL AND CANAL FLOW GAGES (continued)											
11409350	Camptonville Tunnel At Intake, Near Camptonville, CA	224	101	448 (2011)	76 (1994)	908 (Apr)	0 (Periodic)	1,090 (25 Mar 1989)	0 (Periodic)	N/A	N/A
11413250	Slate Creek Tunnel Near Strawberry Valley, CA	101	24	209 (1995)	0 (1977)	690 (Apr)	0 (Periodic)	863 (6 Apr 1963)	0 (Periodic)	N/A	N/A
POWERHOUSE FLOW GAGES											
11417980	Narrows Ph No 2 Bl Englebright Dam CA	1,634	1,757	2,855 (1983)	122 (1977)	3,620 (Jan)	0 (Periodic)	4,650 (15 Jan 1978)	0 (Periodic)	N/A	N/A
11417970	Narrows No 1 Ph A Englebright Dam CA	308	272	628 (1982)	38 (1994)	821 (Oct)	0 (Periodic)	916 (25 Oct 1989)	0 (Periodic)	N/A	N/A
11413510	New Colgate Powerplant Near French Corral, CA	1,402	1,410	2,686 (1983)	233 (1969)	3,629 (Jun)	0 (Periodic)	4,200 (2 Jun 1971)	0 (Periodic)	N/A	N/A

N/A = Not Available

3.4 Basin Transfers and Diversions

The Project includes one in-basin transfer and three out-of-basin transfers. An in-basin transfer is a bypass or diversion of water by a man-made conduit from a natural stream segment to another location within the original stream’s water course. An out-of-basin transfer is a bypass or diversion of water by a man-made conduit from a natural stream segment to another location within a different water course. YCWA’s in-basin and out-of-basin transfers are summarized in Table 3.4-1.

Table 3.4-1. In-basin transfers associated with the Project.

Conduit Name	Maximum Flow (cfs)	From	To	Powerhouse Downstream of Diversion
IN-BASIN TRANSFER				
Narrows 2 Tunnel	3,400	Englebright Reservoir	Yuba River	Narrows 2
OUT-OF-BASIN TRANSFERS				
Lohman Ridge Tunnel	860	Middle Yuba River	Oregon Creek	Narrows 2
Camptonville Tunnel	1,100	Oregon Creek	New Bullards Bar Reservoir	New Bullards Bar Minimum Flow
New Colgate Tunnel	3,400	North Yuba River	Yuba River	New Colgate

3.5 Typical Dry, Normal and Wet Years

FERC regulations require that an applicant describe project operation in typical adverse (dry), mean (normal) and high (wet) water years. YCWA has selected the dry, normal and wet water years based on the 90-, 50- and 10-percent exceedance for unimpaired annual runoff in the Yuba River at Smartsville as estimated by the DWR for the period from WY 1970 through WY 2010. DWR’s historical annual unimpaired Water Year Runoff for this location are shown chronologically in Figure 3.5-1 and ranked by water year from driest to wettest in Figure 3.5-2.

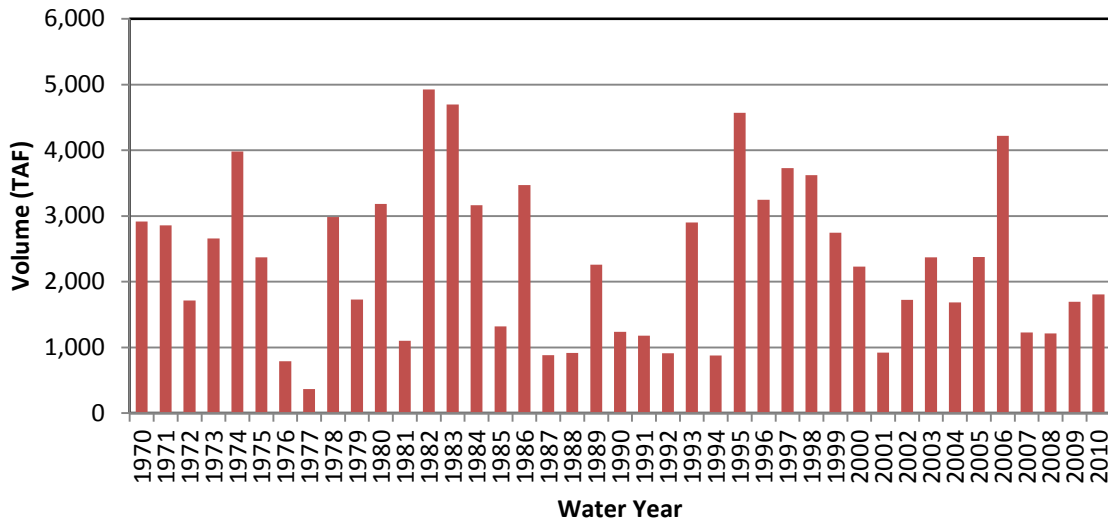


Figure 3.5-1. Yuba River at Smartsville unimpaired runoff from WY 1970 through WY 2010.

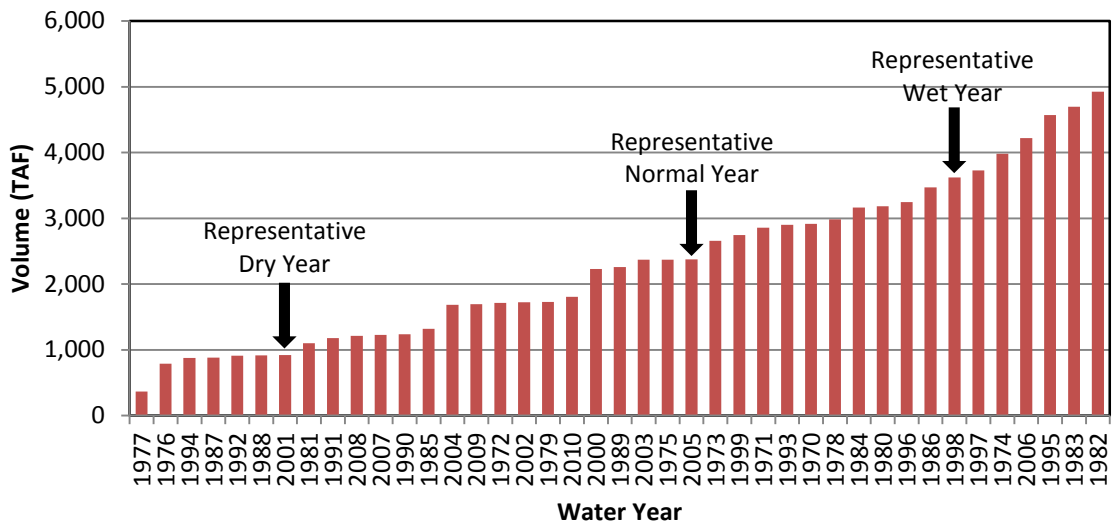


Figure 3.5-2. Yuba River at Smarstville water year unimpaired runoff ranked in order of increasing runoff from 1970 through 2010.

For purposes of this Exhibit B, 2001 is considered the typical dry WY, 2005 is considered the typical normal WY, and 1998 is considered the typical wet WY.

3.6 Relicensing Hydrologic Records

The Project Relicensing Hydrology and Power Generation Data digital versatile disc, included in *Technical Memorandum 2-2, Water Balance/Operations Model, Attachment 2-2F, Hydrology DVD* (YCWA 2013a), contains the Existing Condition hydrological data. Please see Exhibit E, Section 3.3.02 for a summary of regulated hydrologic statistics for the Existing Condition within the Project Vicinity (YCWA 2013b).

4.0 Operations Planning and Forecasting

Project operation can be dramatically different in certain seasons depending on current and forecasted water year conditions. The expected volume and timing of runoff dictates Project operation in late winter and spring. New Bullards Bar Reservoir is operated to capture runoff from snowmelt for recreation, irrigation, domestic water supply and power generation, while meeting applicable minimum flow and other regulatory and contractual operating requirements.

Hydrologic and hydraulic operations planning for the Project is implemented to manage basin runoff throughout the WY for irrigation, municipal water supply, recreation and power generation. The Project utilizes storage capacity within New Bullards Bar Reservoir to store spring runoff that occurs during the snowmelt season. To provide additional perspective regarding the amount of runoff that is available as spring snowmelt, the April-July unimpaired

runoff in the Yuba River is 42.5 percent of the full water-year unimpaired runoff, based on the 50-year average⁵ from WY 1951 through 2000. This stored water is gradually released during summer and fall to augment stream flows, provide hydroelectric generation, and to meet consumptive water demands. New Bullards Bar Reservoir is generally operated in accordance with unofficial target storage curves to achieve reservoir levels and storage capacity that manages the available water effectively.

Operation planning forecasting for the Project is completed by YCWA. Monthly snow surveys in the Project watershed are performed during winter months, and, combined with snow course data from DWR's, provide information to YCWA's hydrologists who use the data to develop runoff forecast models. In addition, YCWA uses larger scale snowmelt runoff forecasts generated by DWR in the form of Bulletin 120 Forecasts. These data are used to determine best operational practices.

YCWA uses monthly precipitation and runoff data to schedule energy needs, flow releases and water demands for the Project as inputs into a forecasting model. Using this forecasting model, YCWA develops a water management plan in order to achieve end-of-month storage targets for New Bullards Bar Reservoir.

Weekly and daily operation of the Project is prioritized for facility and public safety, regulatory compliance, and to balance irrigation and domestic consumptive water demands with power generation. The Project is also operated to comply with YCWA's existing water rights licenses and permits.

4.1 Dry, Normal, and Wet Year Reservoir Operations

While there are hydrological year-type-dependent minimum flows throughout the Project area, Project operations are largely driven in all year-types by minimum flows and agricultural water supply demands on the Yuba River below the Narrows 2 Powerhouse. In all years, New Bullards Bar Reservoir makes releases from storage to supplement flows from the Middle Yuba and South Yuba rivers, Oregon Creek, and other tributaries to Englebright Reservoir to ensure adequate supply is available for release to meet downstream objectives along the Yuba River from either the Narrows 1 or Narrows 2 Powerhouses.

In relatively wet years, releases from New Bullards Bar Reservoir to meet minimum flows and agricultural water supply demands on the Yuba River below the Narrows 2 Powerhouse could result in high New Bullards Bar Reservoir storage; if storage is sufficiently high so that it encroaches into the New Bullards Bar Reservoir flood reservation space, as defined by the USACE (USACE 1972), New Bullards Bar Reservoir would make releases through the New Bullards Bar Reservoir spillway to ensure no water was stored within the flood reservation space. When flood management is not a consideration, either because storage is not encroached in the flood reservation space, or it is outside of period of flood concern (September through April), releases from New Bullards Bar Reservoir during relatively wet periods are made to

⁵ As measured by DWR at the "Yuba River near Smartsville plus Deer Creek" calculation point.

manage storage within the reservoir. While there are not strict rule curves for New Bullards Bar Reservoir storage, YCWA generally operates throughout the summer for a maximum storage of 650,000 ac-ft at the end of September. The 650,000 ac-ft storage target ensures adequate storage for the following year in case of extreme drought yet generally results in manageable releases to provide preferable habitat for anadromous fish throughout the summer in the Yuba River below the Narrows 2 Powerhouse.

In normal years, YCWA operates New Bullards Bar Reservoir very similarly to wet years; inflow to New Bullards Bar is such that, even in normal years, releases are driven by storage management concerns rather than for meeting minimum flows on the Yuba River below the Narrows 2 Powerhouse. Spill avoidance at New Bullards Bar Reservoir is generally is not a concern during normal years, but New Bullards Bar Reservoir releases may take into consideration the possibility of spill at Englebright Dam, and, if New Bullards Bar Reservoir storage allows for it, releases from New Bullards Bar Reservoir through the New Colgate Powerhouse are often reduced in anticipation of a storm event that would cause a brief increase in flow on the Middle Yuba and South Yuba Rivers and potentially create a spill at Englebright Dam. Otherwise, New Bullards Bar Reservoir releases in normal years are determined to manage storage throughout the spring and summer so reservoir storage peaks in the late spring, and then reaches approximately 650,000 ac-ft at the end of September.

In relatively dry years, Project operations are generally to meet minimum flows on the Yuba River below the Narrows 2 Powerhouse and to provide for agricultural water supply for diversions in the vicinity of Daguerre Point Dam. New Bullards Bar Reservoir releases through the New Colgate Powerhouse are determined so that there is sufficient volume within Englebright Reservoir to supplement Middle Yuba and South Yuba River inflow to make the appropriate releases from either the Narrows 1 or Narrows 2 powerhouses. The end-of-September storage target of 650,000 ac-ft rarely affects Project operations in dry years, but, if projected end-of-September New Bullards Bar storage is sufficiently low (below approximately 450,000 ac-ft), reductions in the current year's agricultural water supply could be implemented to ensure adequate storage in New Bullards Bar Reservoir to meet the following year's minimum flows and a portion of the following year's agricultural water supply demand.

Modeled elevation curves and flow duration curves are presented in Section 6.0 as a means to characterize the operation of the Project's reservoirs and powerhouses during typical dry, normal and wet years.

4.2 Operations, Maintenance, Inspection, and Access

Ongoing Project maintenance includes testing gates and valves at the dams and intakes throughout the year, when impact to Project operations can be minimized. All spill gates are operated in the spring and fall, consistent with the Division of Safety of Dams gate operation certificates. FERC requires annual testing of the gates and valve-testing every 5 years, but YCWA also operates gates and valves are operated at least once every 3 years for water rights purposes at each location and YCWA tests their large valves annually. Often, gates and valves are operated more frequently consistent with normal operating procedures.

YCWA typically conducts annual maintenance on the powerhouses during the fall (September through November), when consumptive water and power demand are generally low. Each powerhouse is taken out of service for approximately 1 to 3 weeks on staggered schedule. Maintenance includes inspections of equipment in the powerhouse and switchyard and may include replacing parts and calibrating components. Annual maintenance does not typically require a reservoir drawdown, but downstream Project operations can be affected by certain outages.

The only Project spillway gates are at New Bullards Bar Dam. New Bullards Bar Dam spillway gates are inspected annually to check items including functionality and structural integrity. Functional checks are conducted annually, while inspections take place in the summer, after flood season use, and in the fall prior to flood season use. New Bullards Bar Dam’s spillway can be accessed by various means throughout the year. Walking access from above the New Bullards Bar Dam spillway is accomplished via Marysville Road. Stairways and adits within the dam allow walking access to the north side of the spillway. Access to the surface of the spillway is accomplished through the gate opening once the reservoir elevation has dropped below the spillcrest. Climbing access can also be gained from the bottom of New Bullards Bar Dam.

YCWA obtains access to Project facilities over a number of roads, including those which fall under the jurisdiction of the Forest Service. Licensee and the Forest Service are in consultation regarding maintenance and responsibility for these roads. The Forest Service roads that access various Project features are either included in a Road Maintenance Agreement or under a Special Use Permit.

5.0 Regulatory/Contractual Operating Constraints

5.1 Conditions in Current FERC License

The existing FERC license includes 60 articles. Of these, Licensee considers 19 articles (articles 28, 29, 30, 35, 36, 41, 42, 43, 44, 48, 50, 51, 52, 58, 60, 62, 65, 66, and 67), “expired” or “out of date” because each pertains to a construction activity that has been completed, a filing related to a construction activity that has been completed, or another activity that has been completed. As a result, the existing license contains 41 “active” articles. Of these, Articles 33, 34, 40, and 46 are more germane to Project operations than the other 37 articles. Each of these is provided below as it appears in the existing FERC License.

Article 33. The Licensee shall maintain the following minimum streamflow schedules for maintenance of fish life in the several streams listed:

(a)

(a) Stream	Flow (cfs) ¹	
	April 15 to June 15	June 16 to April 14
Middle Yuba (below Hour House Diversion)	50	30
Oregon Creek (below Log Cabin Diversion)	12	8
North Yuba (below New Colgate Diversion)	5	5

¹ Or natural flow, whichever is less. Maximum 24-hour fluctuations of plus or minus 10 percent are permitted for flows in Middle Yuba below Hour House Diversion and in Oregon Creek below Log Cabin Diversion.

(b)

(b) Stream	Flow (cfs) ¹			Measurement Point
	Jan. 1 to Jun. 30	Jul. 1 to Sept. 30	Oct. 1 to Dec. 31	
Yuba River (below Daguerre Dam)	245	70	400	Over the crest of Daguerre Point Dam and through fishway

¹ Provided that these flows shall be in addition to releases made to satisfy existing downstream water rights.

(c)

Water releases for fish life as specified in paragraphs (a) and (b) of this article shall be subject to the following reduction in any critical dry year, defined as a water year for which the April 1 forecast of the California Department of Water Resources predicts that streamflow in the Yuba River at Smartsville be 50 percent or less of normal:

Yuba River at Smartsville streamflow forecast percent of normal	Reduction in Water Releases for Fish Life, Percent
50	15
45	20
40 or less	30

However, in no event shall releases for fish life below Daguerre Point Dam be reduced to less than 70 cfs. The critical dry year provisions herein shall be effective from the time the aforesaid forecast is available until the April 1 forecast of the following year.

(d)

In addition to maintaining winter minimum water releases for fish life in Yuba River below Daguerre Point Dam, as specified in paragraphs (b) and

(c) of this article, the Licensee shall maintain uniform and continuous releases from Englebright Dam within the limits of the following schedule:

Period	Releases (cfs) ¹	Measurement Point
Oct. 16 to 31	600-1,050	New gaging station to be built downstream from the two Narrows powerhouses.
November	600-700	
December	600-1,400	
Jan. 1 to 15	1,000-1,850	
Jan. 16 to Mar. 31	600	

Provided that:

A. Variations from this schedule are permissible during emergencies, uncontrollable flood flows, and critical dry year curtailments.

B. With the exception of emergencies, releases required by U.S. Army Corps of Engineers flood control criteria, releases required to maintain a flood control buffer or for other flood control purposes, bypasses of uncontrolled flows into Englebright Reservoir, uncontrolled spilling, or uncontrolled flows of tributary streams downstream of Englebright Dam, Licensee shall make reasonable efforts to operate New Bullards Bar Reservoir and Englebright Reservoir to avoid fluctuations in the flow of the lower Yuba River downstream of Englebright Dam, and daily changes in project operations affecting releases or bypasses of flow from Englebright Dam shall be continuously measured at the USGS gage at Smartsville, and shall be made in accordance with the following conditions:

- i. Project releases or bypasses that increase streamflow downstream of Englebright Dam shall not exceed a rate of change of more than 500 cfs per hour.
- ii. Project releases or bypasses that reduce streamflow downstream of Englebright Dam shall be gradual and, over the course of any 24-hour period, shall not be reduced below 70 percent of the prior day's average flow release or bypass flow.
- iii. Once the daily project release or bypass level is achieved, fluctuations in the streamflow level downstream of Englebright Dam due to changes in project operations shall not vary up or down by more than 15 percent of the average daily flow.
- iv. During the period from September 15 to October 31, the licensee shall not reduce the flow downstream of Englebright Dam to less than 55 percent of the maximum five-day average release or bypass level that has occurred during that September 15 to October 31 period or the minimum streamflow requirement that would otherwise apply, whichever is greater.
- v. During the period from November 1 to March 31, the licensee shall not reduce the flow downstream of Englebright Dam to less than the minimum streamflow release or bypass established under (iv) above; or 65 percent of the maximum five-day average flow release or bypass that has occurred during that November 1 to March 31 period; or the minimum streamflow requirement that would otherwise apply, whichever is greater.

Article 34. The Licensee shall maintain a minimum pool in New Bullards Bar Reservoir at Elevation 1,730 ft.

Article 40. Consistent with the primary purpose of the power intakes in the New Bullards Bar Dam, the Licensee shall operate, within limits of the project, the multiple-level power intakes in New Bullards Dam to provide water of suitable quality in the Yuba River downstream from the New Narrows Power Plant for the production of anadromous fish as may be prescribed by the Commission upon the recommendations of the Director of the CDFG and the USFWS.

Article 46. The Licensee shall operate the project reservoirs for flood control in accordance with rules prescribed by the secretary of the Army, such rules to be specified in a formal agreement between the Licensee and the District Engineer, U.S. Army Engineers District, Sacramento, California. Said agreement shall be subject to review from time to time at the request of either party; provided, however, that a different procedure of review may be prescribed by formal agreement.

With regards to Article 46, YCWA operates New Bullards Bar Reservoir from September 16 to May 31 to comply with Part 208 “*Flood Control Regulations, New Bullards Bar Dam and Reservoir, North Yuba River, California,*” pursuant to Section 7 of the Flood Control Act of 1944 (58 Stat. 890). Under the contract between the United States and YCWA that was entered into on May 9, 1966, YCWA agreed to reserve in New Bullards Bar Reservoir 170,000 ac-ft of storage space for flood control in accordance with rules and regulations enumerated in Appendix A of the *Report on Reservoir Regulation for Flood Control* (USACE 1972). The seasonal flood storage space allocation schedule is presented in Table 5.1-1 (specified values are for the end of each month).

Table 5.1-1. New Bullards Bar Reservoir flood storage space allocation in thousands of acre-feet.

	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Storage Allocation	170	170	170	170	170	170	70	0	0	0	0	56

In addition to reservation of flood control space in New Bullards Bar Reservoir, the flood control regulations include rules governing ramping rates as well as target maximum flows in the Yuba River downstream of Englebright Dam and in the Feather River downstream of the confluence with the Yuba River.

YCWA also coordinates operations with PG&E's Narrows 1 Powerhouse downstream of Englebright Dam to use storage in Englebright Reservoir to capture winter storm freshets and reduce storm flows on the Yuba River. This operation is accomplished by evacuating storage space in Englebright Reservoir in anticipation of storm peak flows.

5.2 Measures in Other Licenses, Agreements and Contracts that Affect Operations

In addition to the current FERC license requirements, licenses, agreements and contracts include various streamflow-related requirements, which are summarized below. These licenses, agreements and contracts, and terms and conditions in them, affect Project operations, but are not part of the existing FERC license.

5.2.1 Lower Yuba River Accord (no expiration date in SWRCB Corrected Order Water Right 2008-0014)

In 2005, YCWA and 16 other interested parties signed memoranda of understanding that specify the terms of the Lower Yuba River Accord (Yuba Accord), a comprehensive, consensus-based program to protect and enhance aquatic habitat in the Yuba River downstream of Englebright Dam. Following environmental review, YCWA and parties executed the following four agreements in 2007, which together comprise the Yuba Accord: 1) the Lower Yuba River Fisheries Agreement, which specifies the Yuba Accord's lower Yuba River minimum streamflows and creates a detailed fisheries monitoring and evaluation program; 2) the Water Purchase Agreement, under which CDWR purchases water from YCWA, some of which is provided by the Yuba Accord's minimum streamflows, for CALFED's⁶ Environmental Water Account and State Water Project and Central Valley Project contractors; 3) the Conjunctive Use Agreements with seven of YCWA's member units, which specify the terms of the Yuba Accord's groundwater conjunctive-use program; and 4) amendments to the 1966 Power Purchase Contract between YCWA and PG&E.

The Yuba Accord was developed by a multi-agency resource team, including representatives from NMFS, USFWS, CDFG, and a group of Non-Governmental Organizations (NGOs). Yuba Accord flow schedules 1 and 2 were developed to optimize habitat conditions for anadromous fish during high flow years. Schedule 6 flow schedules were developed to create the best habitat conditions for these fish that are possible during very low flow years, considering available water supplies and competing demands. Flow schedules 3, 4 and 5 then were developed by the resource team by using available water supplies to create habitat conditions during the months

⁶ An interagency committee with management and regulatory responsibility for Bay-Delta Estuary.

when additional flows (over Schedule 6 amounts) will provide the greatest benefits. The Yuba Accord also specifies requirements for “conference years,” which are the very driest years, and are predicted to occur approximately one percent of the time.

YCWA has been operating the Project to implement the Yuba Accord since 2006. The 2006, 2007, and early 2008 operations were under 1-year pilot programs that were approved by the SWRCB through its Orders water right (WR) 2006-0009, WR 2006-0010, WR 2007-0002 and WR 2007-0012-DWR. Since 2008, YCWA has been operating the Project to implement the Yuba Accord according to the authorizations and requirements in SWRCB Corrected Order WR 2008-0014.

The Yuba Accord includes a specific set of flow schedules for the Yuba River. The flow schedule that is in effect at any particular time is determined by the North Yuba Index (NYI), a hydrologic index that was developed as a part of the Yuba Accord. The flow schedules are listed in Table 5.2-1. The NYI is shown in Figure 2.1-6.

Table 5.2-1. Yuba Accord flow schedules.

Schedule	Oct	Oct	Nov	Dec	Jan	Feb	Mar	Apr	Apr	May	May	Jun	Jun	Jul	Aug	Sep	Total Annual Vol. (ac-ft)
	1-15	16-30	1-30	1-31	1-31	1-29	1-31	1-15	16-30	1-15	16-31	1-15	16-30	1-31	1-31	1-30	
MARYSVILLE GAGE (cfs)																	
1	500	500	500	500	500	500	700	1,000	1,000	2,000	2,000	1,500	1,500	700	600	500	574,200
2	500	500	500	500	500	500	700	700	800	1,000	1,000	800	500	500	500	500	429,066
3	500	500	500	500	500	500	500	700	700	900	900	500	500	500	500	500	398,722
4	400	400	500	500	500	500	500	600	900	900	600	400	400	400	400	400	361,944
5	400	400	500	500	500	500	500	500	600	600	400	400	400	400	400	400	334,818
6	350	350	350	350	350	350	350	350	500	500	400	300	150	150	150	350	232,155
SMARTVILLE GAGE (cfs)																	
1	700	700	700	700	700	700	700	700	--	--	--	--	--	--	--	700	--
2	700	700	700	700	700	700	700	700	700	--	--	--	--	--	--	700	--
3	700	700	700	700	700	700	700	700	700	--	--	--	--	--	--	700	--
4	700	700	700	700	700	700	700	700	700	--	--	--	--	--	--	700	--
5	600	600	600	550	550	550	550	550	600	--	--	--	--	--	--	500	--
6	600	600	600	550	550	550	550	550	600	--	--	--	--	--	--	500	--

Notes:

Marysville Gage flows represent average volumes for the specified period. Actual flows may vary from the indicated flows according to established criteria.

Marysville Gage Schedule 6 flows do not include an additional 30,000 ac-ft that SWRCB Corrected Order WR 2008-0014 requires YCWA to make available through groundwater substitution transfers. These additional flows will be allocated during Schedule 6 years.

The water year hydrologic classification for the Yuba River to determine the flow requirements of Yuba County Water Agency’s water right permits shall be based on the North Yuba Index. Determinations of a year’s flow schedule year type shall be made in February, March, April, and May and for any subsequent updates. Table 5.2-2 shows the North Yuba Index schedule year-types.

Table 5.2-2. North Yuba River Index Schedule Year-Types

Flow Schedule Year Type	North Yuba Index Value (thousand ac-ft)
Schedule 1	Greater than or equal to 1,400
Schedule 2	Greater than or equal to 1,040 and less than 1,400
Schedule 3	Greater than or equal to 920, and less than 1,040
Schedule 4	Greater than or equal to 820 and less than 920
Schedule 5	Greater than or equal to 693 and less than 820

Table 5.2-2. (continued)

Flow Schedule Year Type	North Yuba Index Value (thousand ac-ft)
Schedule 6	Greater than or equal to 500 and less than 693
Conference Year	Less than 500

During Conference Years, which are defined as years when the NYI is less than 500,000 ac-ft, and which are expected to occur approximately 1 percent of the time, YCWA is required: 1) to maintain minimum instream flows in the Yuba River at the levels specified in Article 33 of YCWA’s existing FERC license without the reductions authorized by subsections (c) and (d) of that article; 2) to release any supplemental flows recommended by the Lower Yuba Accord River Management Team (RMT) and approved by the SWRCB’s Deputy Director for Water Rights or, if no such recommended flows are effective by April 11 of such a Conference Year, then to release any supplemental flows ordered by the SWRCB, after a hearing under California Code of Regulations, title 23, section 767; and 3) to limit total water supply diversions at Daguerre Point Dam to 250,000 ac-ft.

As stated above, YCWA has operated the Project in compliance with the Yuba Accord since 2006.

5.2.2 YCWA’s Water Rights for Power (No Expiration Date)

YCWA holds pre-1914 appropriative rights dating from 1897 and post-1914 appropriative water rights confirmed by water-right licenses, for the purposes of operating the Project for hydroelectric power generation. Table 5.2-3 lists the post-1914 appropriative water-right licenses held by YCWA for power generation.

Table 5.2-3. Water right licenses held by YCWA for operation of the Project for power generation.

Priority (date)	SWRCB Designation (application)	SWRCB Designation (license)	Source (Waterbody)	Amount & Place of Diversion or Storage (amount & place)		Season (period)		Place of Beneficial Use (powerhouse)
2/11/1921	2197	435	North Yuba River	700 cfs at New Bullards Bar Dam		1/1 - 12/31		New Colgate Powerhouse
				5,000 ac-ft/yr at New Bullards Bar Dam		about 12/15 to about 7/15		
9/7/1922	3026	436	North Yuba River	10,000 ac-ft/yr at New Bullards Bar Dam		about 12/15 to about 7/15		New Colgate Powerhouse
4/30/1926	5004	777	North Yuba River	15,000 ac-ft/yr at New Bullards Bar Dam		about 12/15 to about 7/15		New Colgate Powerhouse
7/30/1927	5631	11565	Middle Yuba River	810 cfs at Our House Dam	490,000 ac-ft/yr storage in New Bullards Bar Res	1/1-12/31 (dir. div.)	10/15 to 6/30 (stor.)	New Colgate Powerhouse and Narrows 2 Powerhouse
			Oregon Creek	240 cfs at Log Cabin Dam		1/1-12/31 (dir. div.)		
			North Yuba River	1,800 cfs at New Bullards Bar Dam		11/1-7/31 (dir. div.)		
			Yuba River	1,800 cfs at USACE’s Englebright Dam		1/1- 12/31		
3/1/1939	9516	3050	North Yuba River	100 cfs at New Bullards Bar Dam		1/1 - 12/31		New Colgate Powerhouse

Table 5.2-3. (continued)

Priority (date)	SWRCB Designation (application)	SWRCB Designation (license)	Source (Waterbody)	Amount & Place of Diversion or Storage (amount & place)		Season (period)	Place of Beneficial Use (powerhouse)
9/12/1941	10282	5544	North Yuba River	5,335 ac-ft/yr at New Bullards Bar Dam		about 10/1 to about 3/1	New Colgate Powerhouse Narrows 2 Powerhouse
2/20/1953	15205	11566	Middle Yuba River	3,200 ac-ft/yr at Log Cabin Dam; storage in New Bullards Bar Res.		5/1- 6/30	New Colgate Powerhouse and Narrows 2 Powerhouse
			North Yuba River	245 cfs and 700 ac-ft/yr at New Bullards Bar Dam		3/15- 6/15 (dir. div.); 5/1- 6/30 (stor.)	
			Yuba River	800 cfs at USACE's Englebright Dam		11/1-7/15	
10/2/1953	15563	11567	Middle Yuba River	30,000 ac-ft/yr at Our House Dam	all storage in New Bullards Bar Res.	10/15 - 6/30	New Colgate Powerhouse and Narrows 2 Powerhouse
			Oregon Creek	1,400 ac-ft/yr at Log Cabin Dam		10/15 - 6/30	
			North Yuba River	146,000 ac-ft/yr at New Bullards Bar Dam		10/15 - 6/30	
			Yuba River	910 cfs at USACE's Englebright Dam		11/1 - 6/30	

YCWA operates the Project consistent with the terms and conditions of the above water rights.

5.2.3 1965 Cal Fish and Game Agreement (has been fully implemented)

On September 2, 1965, YCWA and the California Department of Fish and Game (i.e., now Cal Fish and Wildlife) entered into an agreement regarding the Project. This agreement specifies the Project minimum flow requirements that subsequently were adopted in Article 33 of the FERC license and YCWA's water-right permits. While this agreement does not have a termination date, it was fully implemented when the Commission adopted Article 33 and the SWRCB included the agreement's provisions in YCWA's water-right permits.

5.2.4 Water Supply Deliveries

Within the Project Area, YCWA pumps some water directly from New Bullards Bar Reservoir to supply water to the Cottage Creek Water Treatment Plant for domestic and recreational uses adjacent to the reservoir. The amount of this pumping averages approximately 6 ac-ft per year, which does not affect Project operations. YCWA anticipates that pumping of this small amount of water will continue during the period of the new license.

Downstream of the Project, water is diverted under YCWA's consumptive-use water-right permits to eight water users, which are collectively referred to as the YCWA Member Units. The places of water delivery to YCWA's Member Units are listed in Table 5.2-4.

Table 5.2-4. YCWA’s annual contract amounts and place of delivery.

Member Unit	Base Contract (ac-ft)	Supplemental Contract (ac-ft)	Total Contract (ac-ft)	Member Unit Water Rights (ac-ft)	Total Contract and Water Rights (ac-ft)
BROWNS VALLEY IRRIGATION DISTRICT PUMPLINE DIVERSION FACILITY					
Browns Valley Irrigation District ¹	9,500	--	9,500	24,462 ¹	33,962
SOUTH YUBA CANAL²					
Brophy Water District	43,470	32,177	75,647	--	75,647
South Yuba Water District	25,487	18,843	44,330	--	44,330
Dry Creek Mutual Water Company ²	13,682	3,061	16,743	--	16,743
Wheatland Water District ³	23,092	17,138	40,230	--	40,230
HALLWOOD-CORDUA CANAL⁴					
Cordua Irrigation District	12,000	--	12,000	60,000	72,000
Hallwood Irrigation Company	--	--	--	78,000	78,000
Ramirez Water District	14,790	10,311	25,101	--	25,101
Total	142,021	81,530	223,551	162,462	386,013

- ¹ BVID receives water at the Pumpline Diversion Facility, located 1 mile upstream from USACE’s Daguerre Point Dam.
² BWD, SYWD, DCMWC and WWD receive water from the South Yuba Canal (South Canal), which begins on the south side of the Yuba River slightly upstream of the south abutment of USACE’s Daguerre Point Dam.
³ Includes both Phase 1 and Phase 2 of the Wheatland Project.
⁴ CID, HIC and RWD receive water through the Hallwood-Cordua Canal (North Canal), located on the north abutment of USACE’s Daguerre Point Dam.

BVID, CID, and HIC have their own water rights on the Yuba River. Under settlement contracts with YCWA, CID and HIC receive surface water supplies as part of Project operations. Dry year deficiency criteria in these contracts are different from the deficiency criteria in YCWA’s contracts with other member units. Provisions in YCWA’s water right settlement contracts preclude deficiencies in water right settlement deliveries unless CDWR April forecast of unimpaired runoff as measured at the Smartville gage is less than 40 percent of average. No deficiencies in such deliveries may be imposed on BVID. Contract shortage provisions are presented in Table 5.2-5.

Table 5.2-5. YCWA’s water supply contract shortage provisions.

Category	Unimpaired Runoff Forecast (f) ¹	Percentage of Settlement/ Contract Allocation Available
PRE-1914 RIGHTS SETTLEMENTS		
Base Project Water for Other Member Units	$f > 85\%$	100%
	$50\% < f \leq 85\%$	85%
	$40\% \leq f \leq 50\%$	70%
	$f < 40\%$	50%
Browns Valley Irrigation District	All	100%
Cordua Irrigation District	$f \geq 40\%$	100%
Hallwood Irrigation Company	$f < 40\%$	80%
YCWA SUPPLY CONTRACTS		
Supplemental Water	All forecasts	Determined annually by Licensee in its reasonable discretion considering forecasted runoff and operational conditions.

¹ April 1 CDWR forecast of unimpaired Yuba River runoff near Smartville in percentage of 50-year average.

YCWA’s contract allocations are based on the gross acreage served by each member unit. The maximum “Base Project Water” allocation is computed by multiplying 90 percent of the gross acreage by 2.87 ac-ft per acre. The maximum “Supplemental Water Supply” is computed by

multiplying 90 percent of the gross acreage by 2.13 ac-ft per acre. For member units that have water rights senior to YCWA's, their contract allocations are based on their water right amounts.

In 2009, YCWA started providing water to the WWD under a water service contract. Until then, water users within WWD relied solely on groundwater for irrigation. The Wheatland Project now conveys surface water, diverted by YCWA at Daguerre Point Dam, to WWD through the South Canal system. The Wheatland Project is being constructed in two phases. Phase 1, which was completed in 2009, provides for delivery of surface water to WWD and the immediate irrigation of approximately 7,750 ac of the approximately 9,200 ac that will be served upon the completion of both phases. Under Phase 1, WWD's contract with YCWA provides for a total allocation (base and supplemental) of 23,092 ac-ft per year. When Phase 2 is completed, this contract will allow for a total allocation (base and supplemental) of 40,230 ac-ft per year.

5.2.5 Davis-Grunsky Agreement (Expires December 31, 2014)

On May 10, 1966, YCWA and the State of California entered into an agreement under the Davis-Grunsky Act regarding the Project. Among other provisions, this agreement requires YCWA to operate the Project to maintain the minimum flows specified in Articles 33 and 34 of the FERC license. The agreement was amended on August 14, 1973 and August 14, 2003. The term of the agreement ends on December 31, 2014.

5.3 Other Operating Constraints

Other operating constraints of the Project include water availability, water deliveries, power generation and ramping rates.

5.3.1 Anticipated Water Availability

One of YCWA's major considerations each year is anticipated water availability. YCWA begins estimating water availability each year in January and continually updates the estimate throughout the spring runoff period. When estimating available water supply, YCWA considers current reservoir storage and DWR Bulletin 120 forecasts of unimpaired flow at the Smartsville gage on the Yuba River and the Goodyears Bar gage on the North Yuba River. Estimates of available water supply and other water needs are compared to estimates of required releases, consumptive demands within YCWA, and target levels for fall carryover storage in the New Bullards Bar Reservoir.

5.3.2 YCWA Transfers

Water transfers are an important component of the Project operations. In the 18 years between 1987 and 2004, YCWA transferred water in 12 years, averaging about 120 TAF in each transfer year. Details of individual transfers are presented in Table 5.3-1. Stored water transfers were made by YCWA from storage releases from New Bullards Bar Reservoir. Groundwater substitution transfers were made by YCWA in coordination with its member units.

Typically, individual one-year stored water transfers may occur when the projected end of September storage in New Bullards Bar Reservoir is sufficient for YCWA to reasonably ensure full local water supplies from the Project in the following year. In addition, for cross-Delta water transfers to service areas south of the Delta, the Delta must be in balanced water conditions⁷ and available conveyance capacity must exist at Banks or Jones pumping plants to convey the transfer water to willing buyers. Stored water transfers have typically occurred from July through September. Under the Yuba Accord, transfer releases can occur throughout the year, but through reoperation of the state and federal projects only delivered across the Delta in the summer months.

Table 5.3-1. YCWA historical sales from 1987 to 2010.

Year	Water Year Type Sacramento Valley 40-30-30 Index	Buyer	Stored Water Transfer (ac-ft)	Groundwater Substitution Transfer (ac-ft)
1987	Dry	California Department of Water Resources	83,100	--
1988	Critical	California Department of Water Resources	135,000	--
1989	Dry	California Department of Water Resources	90,000	--
		California Department of Water Resources for California Department of Fish and Game	110,000	--
		City of Napa	7,000	--
		East Bay Municipal Utility District	60,000 ¹	--
1990	Critical	City of Napa	6,700	--
		California Department of Water Resources	109,000	--
		Tudor Mutual Water Company/Feather Water District	2,951	--
1991	Critical	State Water Bank	99,200 ²	84,840
		State Water Bank - California Department of Fish and Game	28,000	--
		City of Napa	7,500	--
1992	Critical	State Water Bank	30,000 ³	--
1994	Critical	California Department of Water Resources	--	26,033
1997	Wet	Bureau of Reclamation for Refuge Water	25,000 ⁴	--
		Sacramento Area Flood Control Agency for American River Fishery	48,857	--
2001	Dry	Environmental Water Account	50,000 ⁵	--
		California Department of Water Resources	52,912	61,140
2002	Dry	Environmental Water Account	79,742	55,248
		California Department of Water Resources	22,050	--
		Contra Costa Water District	5,000	--
2003	Above Normal	Environmental Water Account	65,000 ⁶	--
		Contra Costa Water District	5,000	--
2004	Below Normal	Environmental Water Account	100,000 ⁶	--
		California Department of Water Resources	487	--
2005	Above Normal	Environmental Water Account	6,0866	--
2006	Wet	Environmental Water Account	60,0001	--
2007	Dry	Yuba Accord Water Purchase Participants	65,000 ^{6,7,8}	--
2008	Critical	Yuba Accord Water Purchase Participants	117,212 ⁶	48,875

⁷ Balanced water conditions are periods when it is agreed that releases from upstream reservoirs plus unregulated flows approximately equal the water supply needed to meet Sacramento Valley in-basin uses plus required Delta outflows and exports (Reclamation and DWR 1986).

Table 5.3-1. (continued)

Year	Water Year Type Sacramento Valley 40-30-30 Index	Buyer	Stored Water Transfer (ac-ft)	Groundwater Substitution Transfer (ac-ft)
2009	Dry	Yuba Accord Water Purchase Participants	91,1006 ⁷	--
		DWR Drought Water Bank	--	88,9001 ¹⁰
2010	Below Normal	Yuba Accord Water Purchase Participants	74,179	66,211
Total	1,636,076	431,247		

¹ Sold but not delivered.

² In 1991, BVID transferred an additional 5.5 TAF to the State Water Bank through conservation.

³ In 1992, BVID transferred an additional 5.5 TAF to the State Water Bank through conservation.

⁴ In 1997, the transfer included 5 TAF from BVID.

⁵ In 2001, BVID transferred an additional 4.5 TAF to DWR (stored water transfer) and 3.5 TAF to the Environmental Water Account (EWA) (groundwater substitution pumping).

⁶ In 2002, 2003, 2007, 2008, 2009 and 2010, BVID transferred an additional 3.1 TAF to the Santa Clara Valley Water District through conservation.

⁷ Transfers to the Yuba Accord Water Purchase Participants include 60 TAF of stored water for the EWA.

⁸ The 2007 transfer was under Yuba Accord Pilot Program. It also included 60 TAF of transfer to the EWA purchased in 2006.

⁹ Sacramento Valley Index as defined in SWRCB RD-1641.

¹⁰ In 2009, CID transferred an additional 8,322 ac-ft of groundwater substitution transfer to the DWR Drought Water Bank.

5.3.3 Adherence to 1966 Power Purchase Contract with PG&E

YCWA executed a Power Purchase Contract with PG&E on May 13, 1966. The Power Purchase Contract, which allowed financing the construction of the Yuba Project, specifies conditions of PG&E's power purchase from YCWA and PG&E's rights to require releases of water from New Bullards Bar Reservoir for power production.

Power Purchase Contract Appendix C, Subsection C-2.A.(b), Water for Power and Irrigation, details the monthly storage criteria and monthly power quotas. The maximum end-of-month storage amount (the "Critical Line") is described in paragraph (1):

When it appears that storage by the end of any month will exceed the critical amount for such month listed in Appendix D, project power plants shall be operated, unless otherwise agreed, to reduce the storage on hand by the end of such month to the amount specified in Appendix D but at rates not to exceed the amount required for full capability operation except when greater releases are needed by reason of flood control requirements...

Compliance with this criterion requires releases of up to 3,400 cfs at New Colgate Powerhouse to bring the end-of-month storage at or below the amounts listed in Table 5.3-2, which is the "critical storage at end of month in Yuba's New Bullards Bar Reservoir" of Appendix D, Storage Criteria.

Table 5.3-2. Storage criteria for New Bullards Bar Reservoir under 1966 PG&E Power Purchase Contract.

	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Storage (TAF)	660	645	645	600	600	685	825	930	890	830	755	705

In addition to the storage requirements, a power production quota applies when the operation described above would result in an end-of-month storage at or below the Critical Line. This quota schedule is described in the contract as follows:

When drafts of storage will result in the storage on hand at the end of any month being equal to or less than the critical amount for such month listed in Appendix D, then, unless otherwise requested by Pacific, Yuba shall release during that month only a sufficient amount of water, in accordance with schedules furnished from time to time by Pacific, to generate the following specified amount of energy at the new Colgate Power Plant.

The minimum required power generation criteria are presented in Table 5.3-3.

Table 5.3-3. Minimum required power production under 1966 PG&E Power Purchase Contract.

	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Power (MWh)	39,300	39,500	37,800	81,700	81,700	81,500	81,700	82,000	82,100	37,700	38,200	38,900

Additionally, the contract also provides that the Narrows 2 Powerhouse “... shall be operated in a manner consistent with the foregoing water release requirements.”

PG&E and YCWA entered into an agreement in 2000 that terminated the requirements of monthly minimum required power production, and entered into an agreement in 2008 to facilitate implementation of the Yuba Accord. The 2008 agreement modified the Critical storage and describes a process for making release decisions for end-of-month storage values. All of these agreements, including the 1966 agreement, terminate March 31, 2016.

6.0 Existing Operations

Operation of YCWA’s reservoirs, dams, and powerhouses under YCWA’s No Action Alternative are presented below for the three Project developments: New Colgate, New Bullards Bar Minimum Flow and Narrows 2. The Project does not include USACE’s Englebright Reservoir and Dam and PG&E’s Narrows 1 Powerhouse downstream of Englebright Dam. YCWA coordinates operations of these facilities with USACE and PG&E; therefore, these facilities are also discussed in this section.

6.1 New Colgate Development

The New Colgate Development is located on the main stems of the North Yuba River, Middle Yuba River and Yuba River, and Oregon Creek, a tributary to the Middle Yuba River. The development includes two diversion dams (Our House and Log Cabin), two diversion tunnels (Lohman Ridge and Camptonville), one storage reservoir (New Bullards Bar Reservoir), one power tunnel and penstock (New Colgate), and one powerhouse (New Colgate).

6.1.1 Reservoir Operation

New Colgate development includes two impoundments and one reservoir: Our House Diversion Impoundment on the Middle Yuba River, Log Cabin Diversion Impoundment on Oregon Creek, and New Bullards Bar Reservoir on the North Yuba River.

6.1.1.1 Our House Diversion Impoundment

Our House Diversion Dam Impoundment has an estimated capacity of 280 ac-ft, but YCWA does not store water within the impoundment. YCWA operates it primarily to divert water to New Bullards Bar Reservoir in winter and spring during high flow periods through the Lohman Ridge Diversion Tunnel.

The storage capacity curve showing the usable and gross storage capacities of Our House Diversion Impoundment is provided in Figure 6.1-1. The surface area at the normal maximum water surface elevation of 2,030 ft is 13.8 ac.

Our House Diversion Dam Impoundment is operated as a diversion with no storage in the Operations Model. While the storage is not operated, elevation-storage-area curves are presented in Figure 6.1-2.

The spillway rating curve for Our House Diversion Dam is presented in Figure 6.1-2. The elevation of the spillway crest for the dam is 2,030 ft. Historically, the estimated maximum instantaneous flow below the Diversion Dam was 27,500 cfs, occurring on January 2, 1997.

Drainage area into Our House Diversion Impoundment is about 144.8 sq mi. Inflow is regulated by local accretion and releases from NID's Milton Diversion Dam. Up to 860 cfs is diverted into the Lohman Ridge Diversion Tunnel to Log Cabin Diversion Dam Impoundment. The invert elevation for the Lohman Ridge Diversion Tunnel is at 2,015 ft.

There are no rule curve requirements for Our House Diversion Impoundment. Modeled monthly flow duration curves for the Middle Yuba downstream of Our House Diversion Dam and for the Lohman Ridge Diversion Tunnel are provided in Figures 6.1-3 and 6.1-4. Flow duration curves are based on YCWA's No Action Alternative Model run for WYs 1970 through 2010. Figure 6.1-5 and Figure 6.1-6 show flow duration curves during the representative dry (2001), normal (2005), and wet (1998) water years for the Middle Yuba downstream of Our House Diversion Dam and for the Lohman Ridge Diversion Tunnel.

There are two outlets from the Our House Diversion Dam; a 24-in fish-release outlet with an estimated maximum capacity of 59 cfs when the impoundment water surface elevation is at the Lohman Ridge Diversion Tunnel invert elevation; and a 72-in low-level outlet with an estimated capacity of 463 cfs when the impoundment water surface elevation is at the Lohman Ridge Diversion Tunnel invert elevation. The fish-release outlet is adjusted each day to ensure the required flow is released, but the low-level outlet is rarely used under current operations.

When Our House Diversion Dam is being operated to release inflow to the Our House Diversion Dam impoundment, the fish-release outlet valve is adjusted once per day to maintain the impoundment water surface elevation at a constant level, ensuring outflows are the same as inflows. Allowing the water surface elevation to drop too low would induce additional accumulation of sediment and debris at the dam; maintaining the pool elevation keeps most of the sediment and debris at the upstream end of the impoundment, away from the dam.

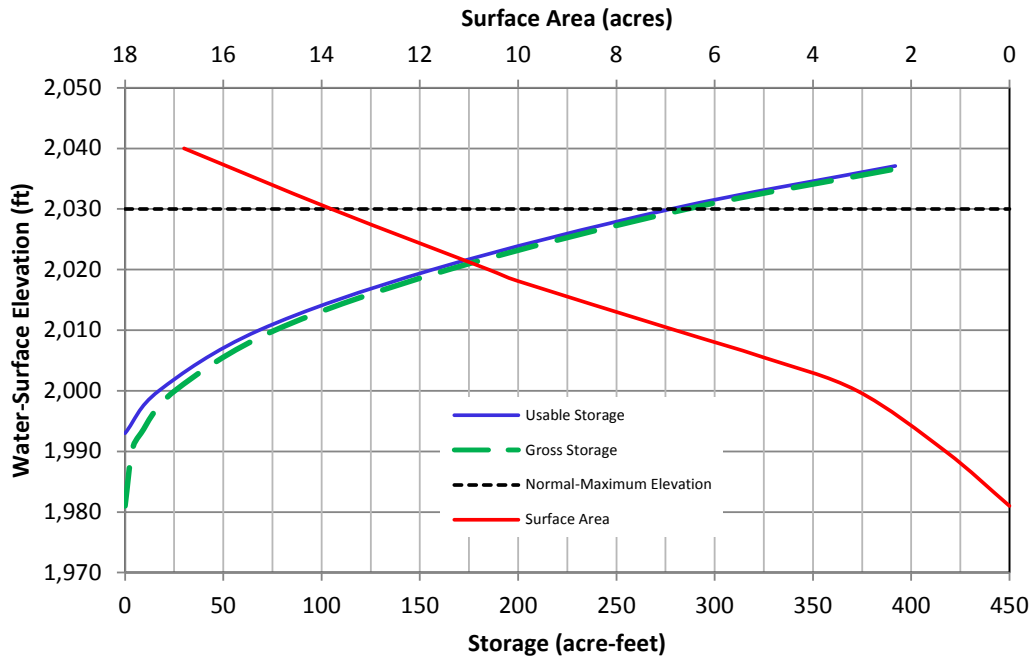


Figure 6.1-1. Our House Diversion Impoundment storage-capacity curve.

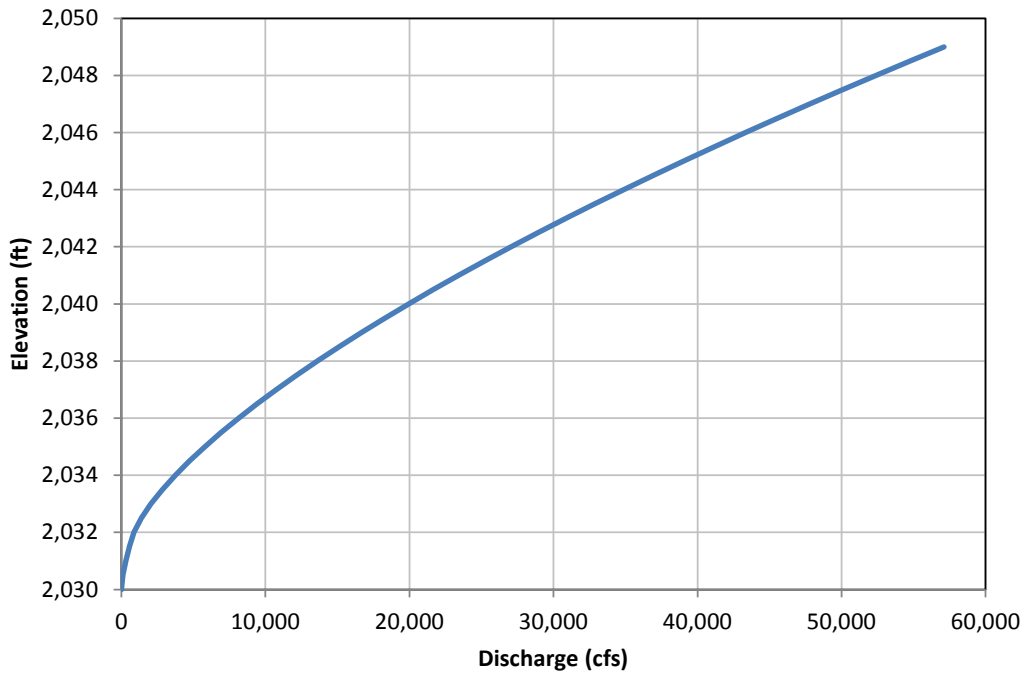


Figure 6.1-2. Our House Diversion Dam spillway rating curve.

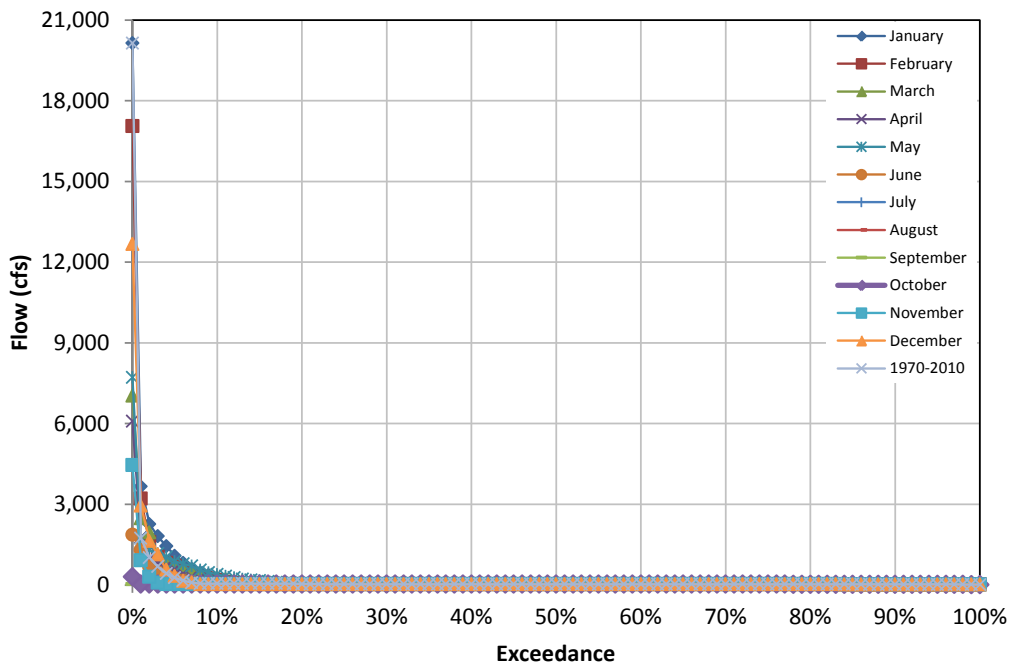


Figure 6.1-3. Modeled monthly flow duration curves for the Middle Yuba River downstream of Our House Diversion Dam for water years 1970 through 2010 under YCWA's No Action Alternative Model run.

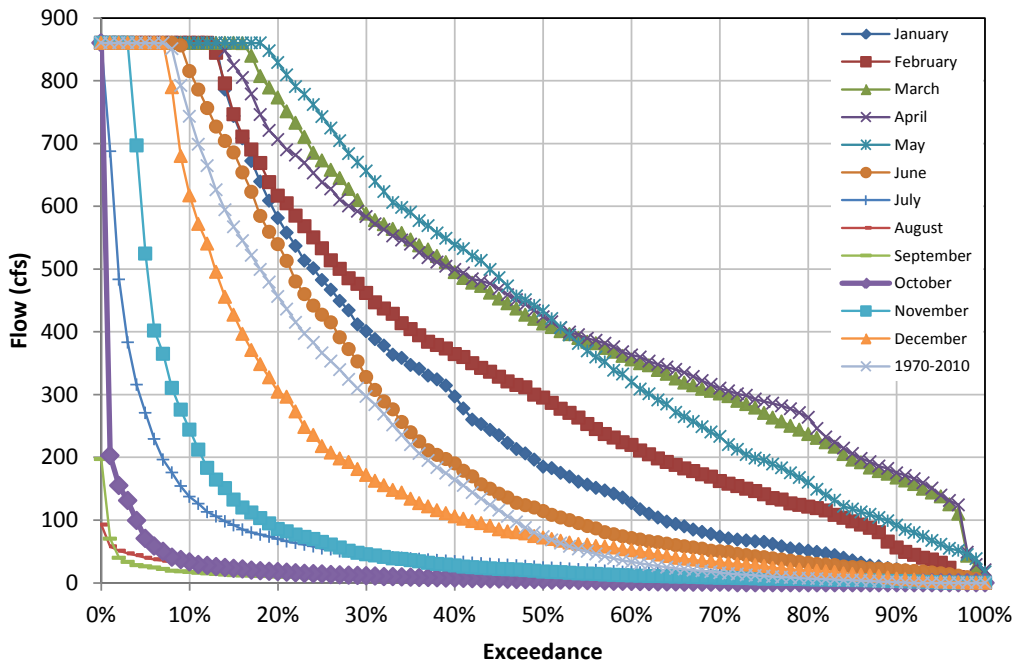


Figure 6.1-4. Modeled monthly flow duration curves for the Lohman Ridge Diversion Tunnel for water years 1970 through 2010 under YCWA's No Action Alternative Model run.

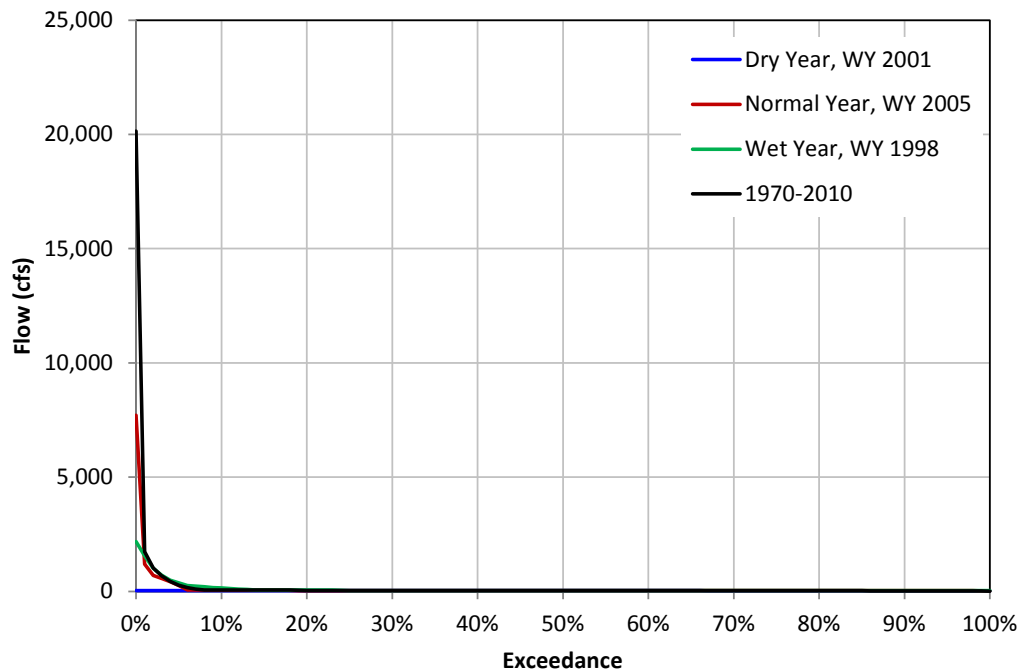


Figure 6.1-5. Modeled flow duration curves for the Middle Yuba River downstream of Our House Diversion Dam for the representative dry (2001), normal (2005) and wet (1998) water years and for the period of record under YCWA's No Action Alternative Model run.

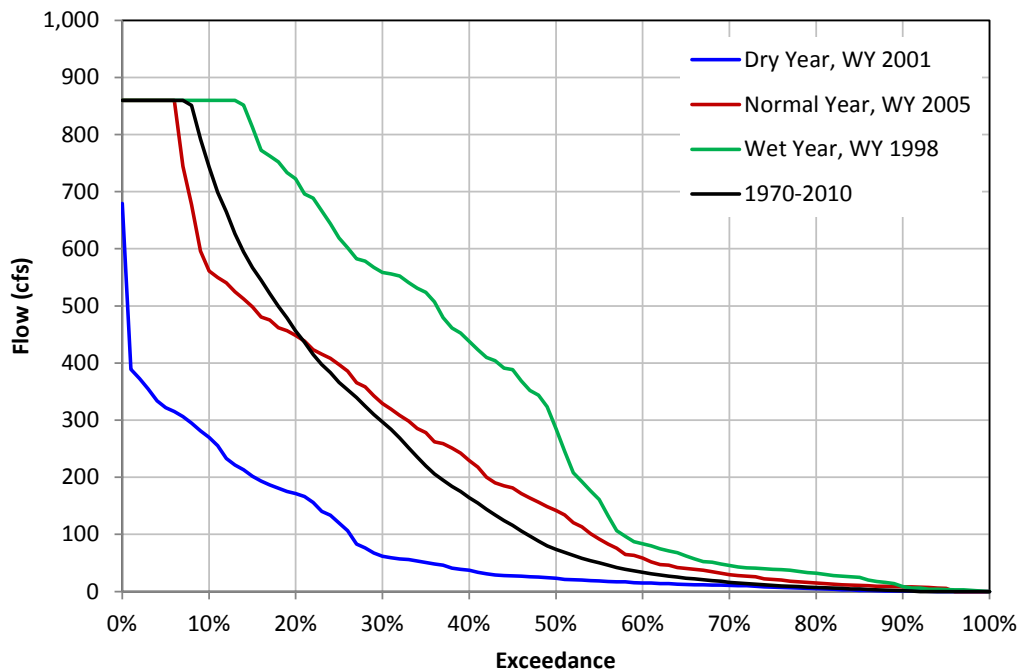


Figure 6.1-6. Modeled flow duration curves for the Lohman Ridge Diversion Tunnel for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.

6.1.1.2 Log Cabin Diversion Impoundment

Log Cabin Diversion Dam Impoundment has an estimated capacity of 90 ac-ft. YCWA operates it primarily to divert water to New Bullards Bar Reservoir in the winter and spring during high flow periods and does not store water within the impoundment. Water from Oregon Creek is diverted to New Bullards Bar Reservoir, along with water from the Middle Yuba River through the Camptonville Diversion Tunnel.

The storage-capacity curve showing the usable and gross storage capacities of Log Cabin Diversion Impoundment is provided in Figure 6.1-7. The surface area at the normal-maximum water-surface elevation of 1,970 ft is 5.4 ac.

Log Cabin Diversion Dam Impoundment is operated as a diversion with no storage in the Operations Model. While the storage is not operated, elevation-storage-area curves are presented in Figure 6.1-7.

A spillway rating curve for Log Cabin Diversion is unavailable; therefore, it is not presented in this document. Inflow above approximately 1,100 cfs (the capacity of the Camptonville Tunnel) is spilled over the dam. Historically, the estimated maximum instantaneous flow below the Diversion Dam was 6,400 cfs, occurring on February 17, 1986.

Drainage area into Log Cabin Diversion Impoundment is about 29.1 sq mi. Inflow is regulated by local accretion and diversions from the Middle Yuba River at Our House Diversion through

the Lohman Ridge Diversion Tunnel. Up to 1,100 cfs is diverted into the Camptonville Diversion Tunnel to New Bullards Bar Reservoir. The invert elevation for the Camptonville Tunnel is 1,952 ft.

There are no rule curve requirements for Log Cabin Diversion Impoundment. Modeled monthly flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam and for the Camptonville Diversion Tunnel are provided in Figures 6.1-8 and 6.1-9. Flow duration curves are based on YCWA’s No Action Alternative Model run for WY 1970 through 2010. Figure 6.1-10 and Figure 6.1-11 show flow duration curves during the representative dry (2001), normal (2005), and wet (1998) water years for Oregon Creek downstream of Log Cabin Diversion Dam and for the Camptonville Diversion Tunnel.

There are two outlets from the Log Cabin Diversion Dam; an 18-in fish-release outlet with an estimated maximum capacity of 18 cfs when the impoundment water surface elevation is at the Camptonville Diversion Tunnel invert elevation; and a 60-in low-level outlet with an estimated capacity of 348 cfs when the impoundment water surface elevation is at the Camptonville Diversion Tunnel invert elevation. The fish-release outlet is adjusted each day to ensure the required flow is released, but the low-level outlet is rarely used under current operations.

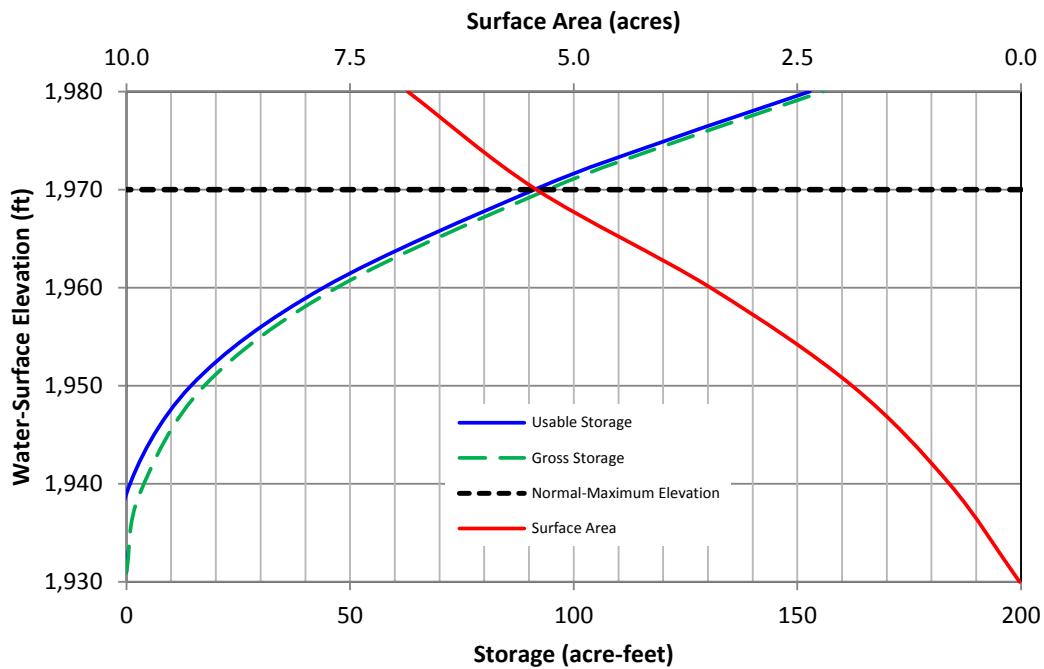


Figure 6.1-7. Log Cabin Diversion Impoundment storage-capacity curve.

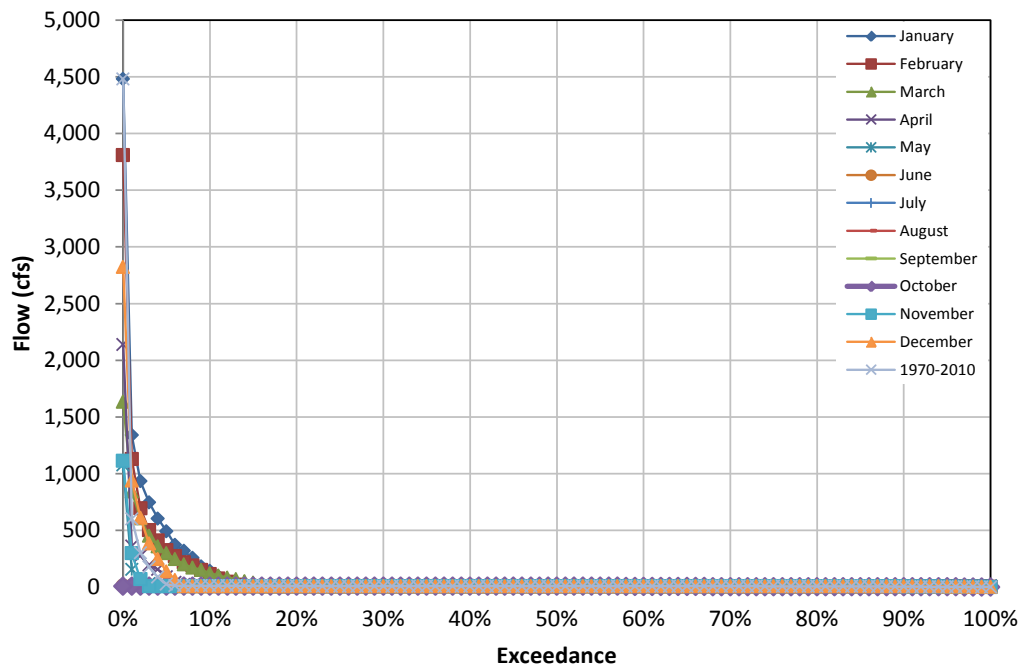


Figure 6.1-8. Modeled monthly flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam for water years 1970 through 2010 under YCWA's No Action Alternative Model run.

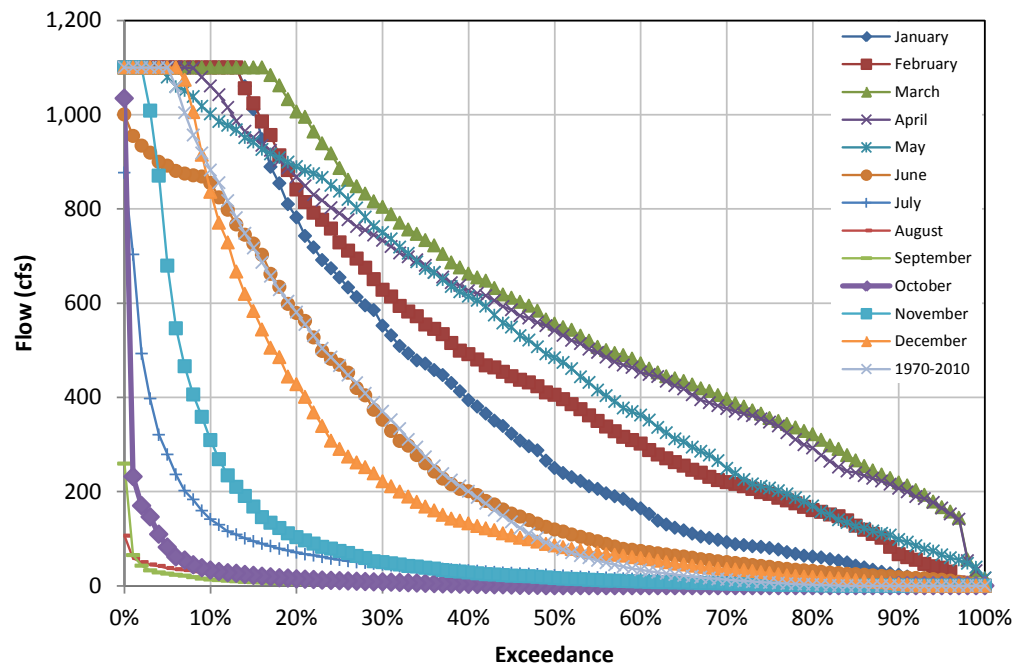


Figure 6.1-9. Modeled monthly flow duration curves for the Camptonville Diversion Tunnel for water years 1970 through 2010 under YCWA's No Action Alternative Model run.

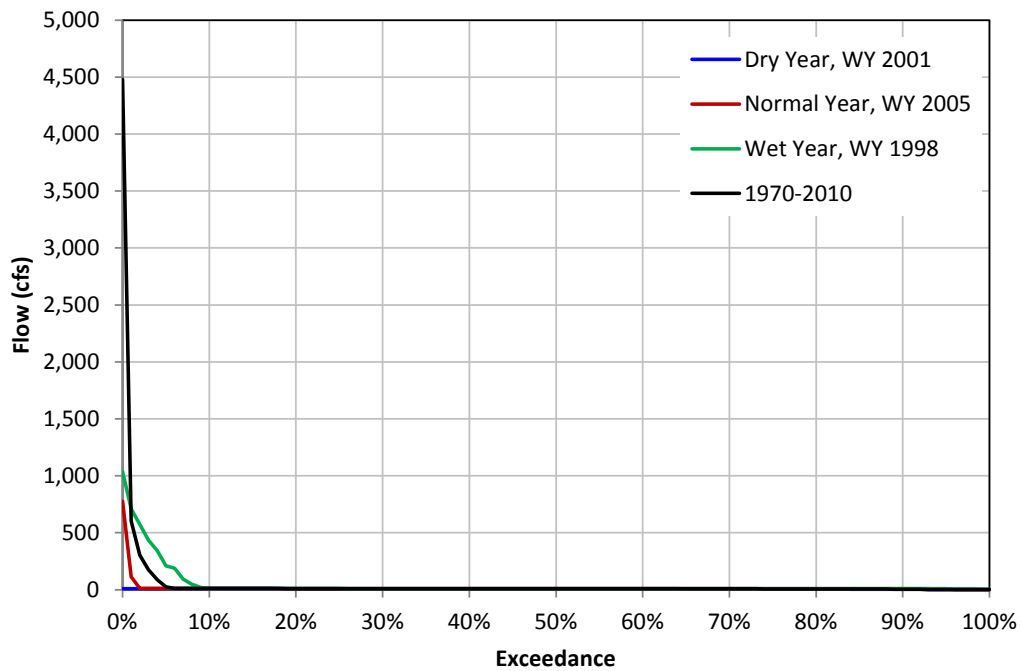


Figure 6.1-10. Modeled flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.

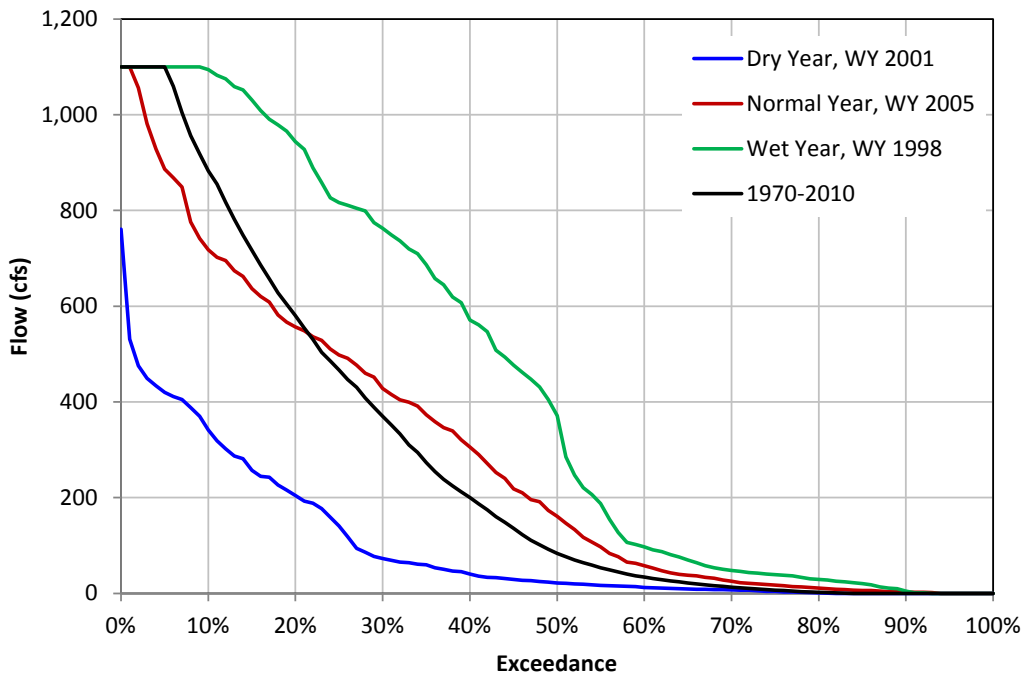


Figure 6.1-11. Modeled flow duration curves for the Camptonville Diversion Tunnel for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.

6.1.1.3 New Bullards Bar Reservoir

New Bullards Bar Reservoir is the principal storage facility for the Project. The reservoir has a gross storage capacity of approximately 966,000 ac-ft with a minimum pool of approximately 230,000 ac-ft (as required by YCWA's FERC license), thus leaving approximately 736,000 of operable capacity. A portion of this operable capacity, 170,000 ac-ft, must be held empty from November 1 through March 31 for flood management; the full pool of the reservoir is available for storage between June 1 and September 15. The required storage volume is linearly interpolated between these two quantities on other dates.

Releases from New Bullards Bar Reservoir are made through the New Colgate Power Tunnel to the New Colgate Powerhouse on the Yuba River; the New Bullards Bar Minimum Flow Powerhouse at the base of the dam; the dam's low-level outlet; or the gated spillway. The New Colgate Power Tunnel is approximately 5.2 mi long and has a maximum flow capacity of 3,400 cfs. The New Bullards Bar Minimum Flow Powerhouse has a maximum flow capacity of 5 cfs. The low-level outlet at the base of New Bullards Bar Dam has a maximum capacity of 1,250 cfs with an invert elevation of 1,395 ft, but it is rarely used. The New Bullards Bar Dam Spillway has a crest elevation of 1,902 ft and a maximum capacity of 124,000 cfs at full pool. Minimum flow on the North Yuba River below New Bullards Bar Dam are met through a combination of releases from the New Bullards Bar Minimum Flow Powerhouse and seepage from the New Bullards Bar Dam. Any additional non-spill releases are made through the New Colgate Powerhouse. The spillway is only used during flood management operations.

Figure 6.1-12 shows modeled average-daily storage in New Bullards Bar Reservoir, as well as the maximum-daily storage minimum-daily storage for the period of record and various percent exceedance levels of daily storage.

New Bullards Bar Reservoir's normal-maximum and normal-minimum operating elevations are 1,956 ft and 1,730 ft, respectively. The reservoir's gross storage of 966,400 ac-ft is the volume of water between the gross pool elevation of 1,956 ft, and the bottom of the reservoir, approximately equal to 1,360 ft. The reservoir's usable storage is 966,103 ac-ft based on the volume of water between normal-maximum pool elevation and the intake elevation at the low-level outlet (1,395 ft).

The storage-capacity curve showing the usable and gross storage capacities of New Bullards Bar Reservoir is provided in Figure 6.1-13. The surface area at the maximum water-surface elevation of 1,956 ft is 4,790 ac.

Modeled daily average water-surface elevations for New Bullards Bar Reservoir for each water year are graphically presented in Figure 6.1-14. As indicated on the figure, the reservoir storage and elevation can fluctuate significantly from year to year; although, the median and mean curves represent general reservoir operation.

Operation of New Bullards Bar Reservoir in terms of storage for the representative dry (2001), normal (2005) and wet (1998) water years is shown in Figure 6.1-15. The range of reservoir

elevations in the representative dry (2001), normal (2005), and wet (1998) water years and annual elevation fluctuation in New Bullards Bar Reservoir are summarized in Table 6.1-1.

Table 6.1-1. Modeled minimum and maximum elevations in New Bullards Bar Reservoir in the representative dry (2001), normal (2005) and wet (1998) water years under YCWA’s No Action Alternative Model run.

Water Year	Minimum Daily Elevation (feet)	Average Daily Elevation (feet)	Maximum Daily Elevation (feet)	Annual Elevation Fluctuation (feet)
2001 (Dry Year)	1,844	1,870	1,905	60
2005 (Normal Year)	1,860	1,898	1,956	96
1998 (Wet Year)	1,840	1,901	1,956	116

The target rule curve for New Bullards Bar Reservoir, shown as a green line in Figure 6.1-15, depicts the physical and regulatory limitations of the reservoir operation.

The spillway rating curve for New Bullards Bar Reservoir Dam is presented in Figure 6.1-16. The elevation of the spillway crest for the dam is 1,902 ft.

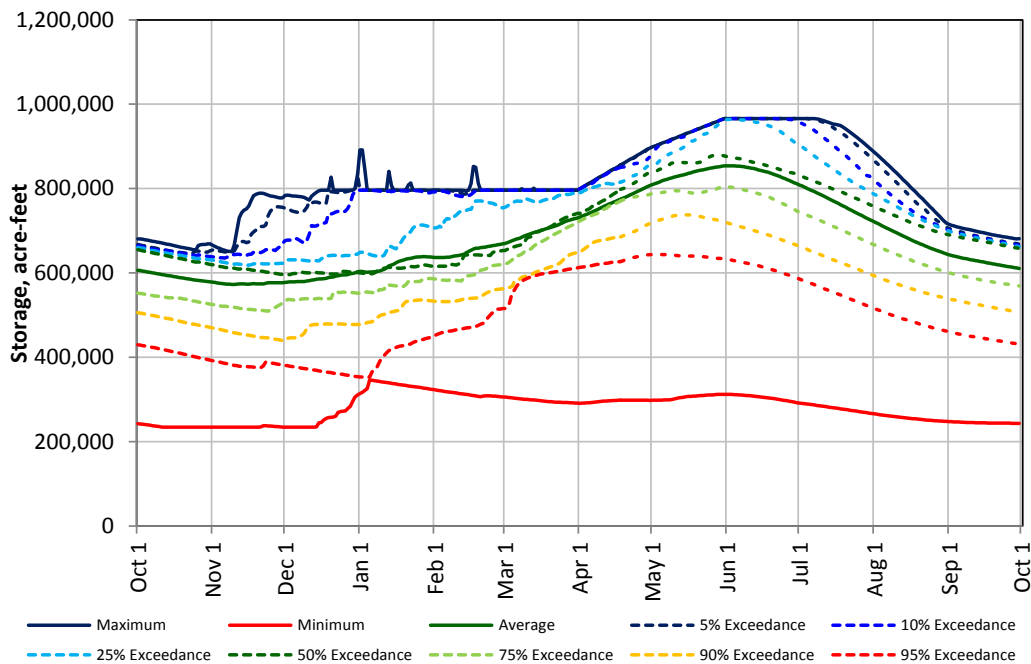


Figure 6.1-12. Modeled average-daily storage in New Bullards Bar Reservoir for various percent exceedances for the simulated period of water years 1970 through 2010 under YCWA’s No Action Alternative Model run.

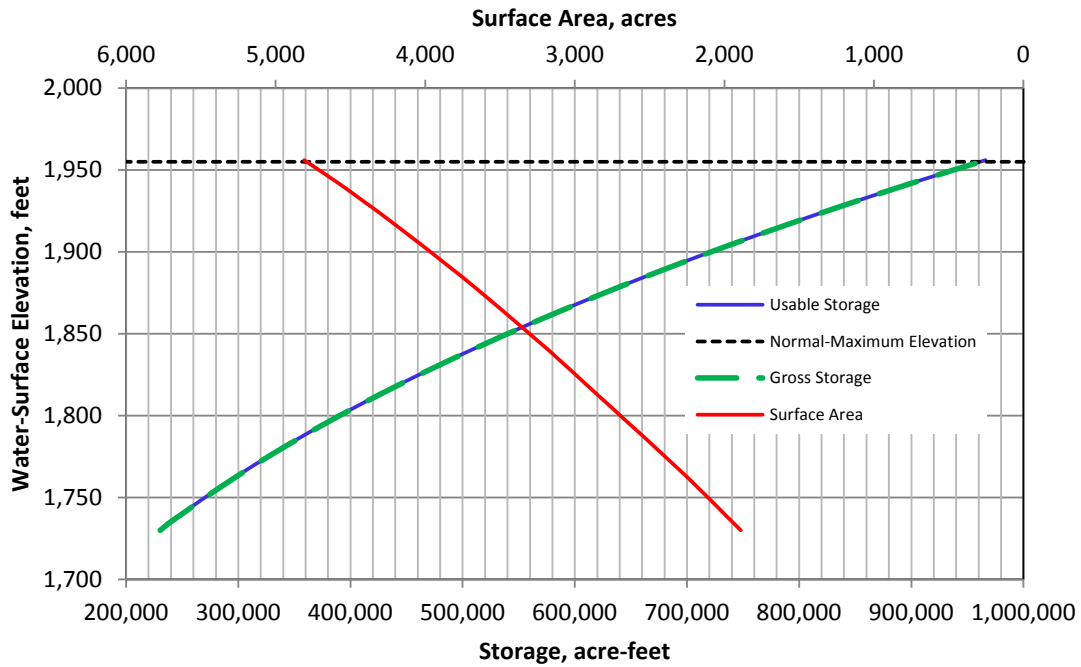


Figure 6.1-13. New Bullards Bar Reservoir storage-capacity curve.

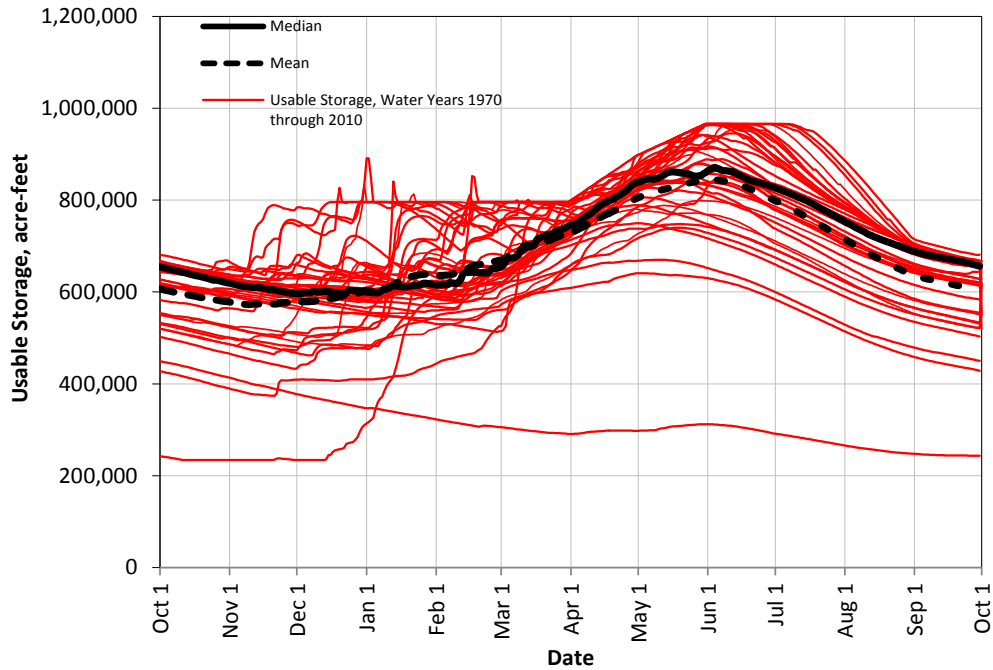


Figure 6.1-14. Modeled New Bullards Bar Reservoir median and mean storage for water years 1970 through 2010 under YCWA's No Action Alternative Model run.

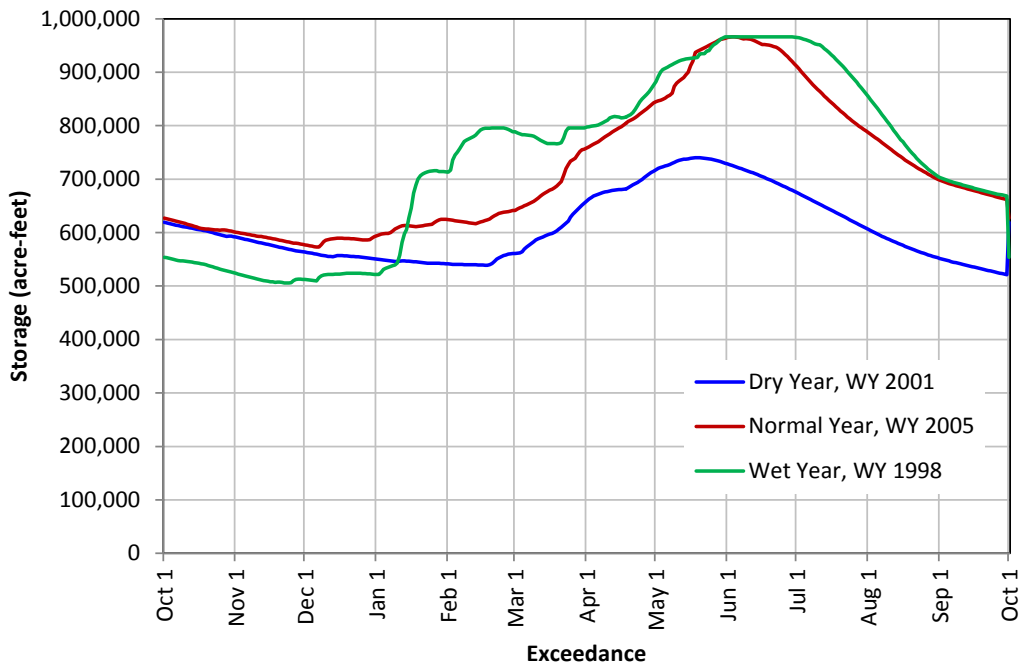


Figure 6.1-15. Modeled New Bullards Bar Reservoir storage for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s No Action Alternative Model run.

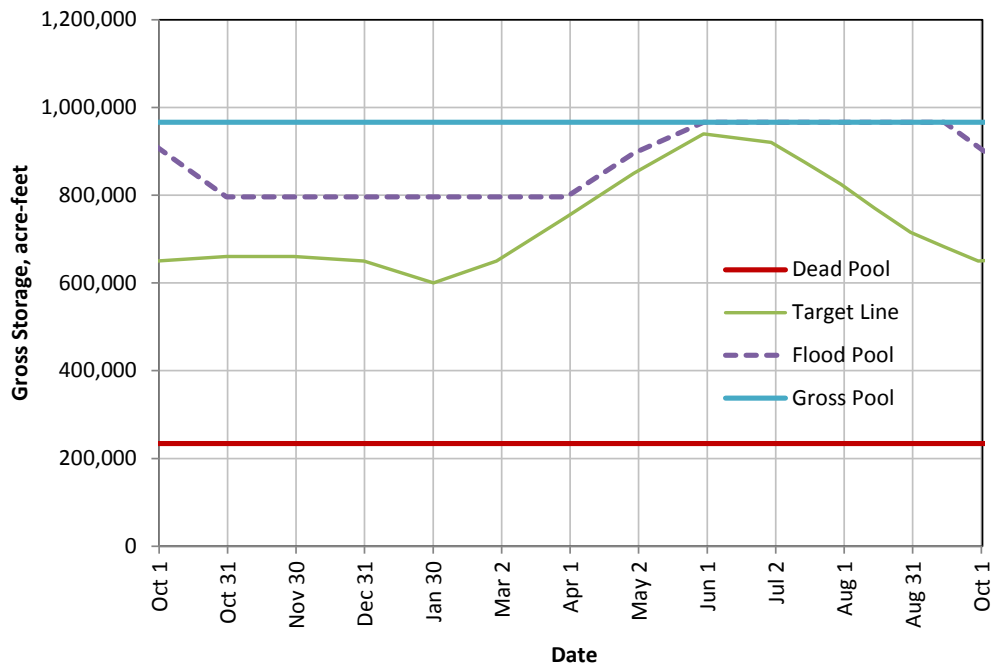


Figure 6.1-16. New Bullards Bar Reservoir rule curve.

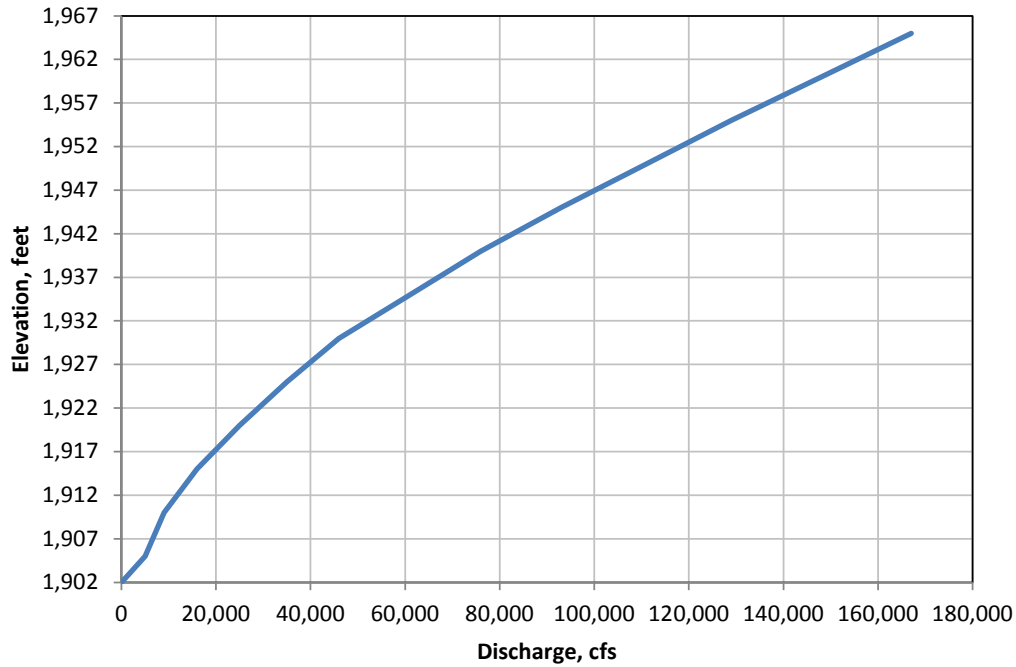


Figure 6.1-17. New Bullard Bar Dam spillway rating curve.

6.1.2 Plant Operations – New Colgate Powerhouse

New Colgate Powerhouse is a highly versatile facility, and is used for a combination of peaking, ancillary services and some base generation. Depending upon energy demand, the New Colgate Powerhouse generation can be fluctuated from a minimum of 1 MW with only one unit operating to its nameplate capacity of 315 MW with both units operating in less than 10 minutes, assuming both units are ramped up at the same time. This ability to rapidly fluctuate generation, together with substantial storage available in New Bullards Bar Reservoir makes New Colgate Powerhouse important and unique to the Northern California grid. The average annual flow through the New Colgate Powerhouse based on YCWA’s No Action Alternative Model run for WY 1970 through 2010 was 1,074,003 ac-ft. With a theoretical powerhouse capacity of almost 3 million MWh per year (MWh/yr) if the powerhouse always could be operated at full capacity, New Colgate Powerhouse has a plant factor of 45-percent. This is comparable to the national average hydropower plant factor of 43-percent.

For most of the year, New Colgate Powerhouse is operated as a peaking facility, or to provide ancillary services such as spinning reserves or regulation. Under peaking operations, releases through the powerhouse are concentrated to hours of the day when power is most valuable or when power is needed most (e.g. weekdays, mid-morning through early evening in northern California, largely corresponding to warmer times of the day and/or peak workday hours). Under ancillary services operations, the generating station may be ramped upwards or downwards quickly, to respond to power system load changes on a near-real-time basis. Under ancillary services operations, generating station output and flows may vary substantially minute-to-minute. The New Colgate Powerhouse also often operates under a combined peaking/ancillary service protocol, with one unit operating in peaking mode and the other unit

responding to ancillary service requirements. During some of the late 1990s and early 2000s, New Colgate Powerhouse operations were focused on weekday peak generation. Most recently power generation has shifted to a schedule driven by a balance of peak period generation and providing ancillary services to the region. However, under high flow conditions some or all of the available capacity is used for base load.

6.1.2.1 Powerhouse Minimum, Maximum and Mean Flows

Minimum-, maximum- and mean-daily average flows based on YCWA's No Action Alternative Model run for WY 1970 through 2010, are 2.2 cfs, 1,483 cfs and 3,430 cfs, respectively. When flows on the Yuba River above the New Colgate Powerhouse exceed approximately 20,000 cfs, the New Colgate Powerhouse tailrace elevations begin to impede operations of the two New Colgate Units, and releases through the New Colgate Powerhouse are shut off until flows recede to the point the pelton wheels are not affected by the tail race elevation.

6.1.2.2 Powerhouse Hydraulic Capacity

New Colgate Powerhouse contains two Voith Siemens Pelton-type turbines with a nameplate capacity of 315 MW under a design head at the plant of 1,306 ft (there is approximately 80 ft of hydraulic head loss in the penstock at peak flow) and a rated flow of 3,430 cfs.

6.1.2.3 Powerhouse Flow Duration Curves

Annual and monthly flow duration curves for releases from New Colgate Powerhouse, based on YCWA's No Action Alternative Model run for WY 1970 through 2010, are provided in Figure 6.1-18.

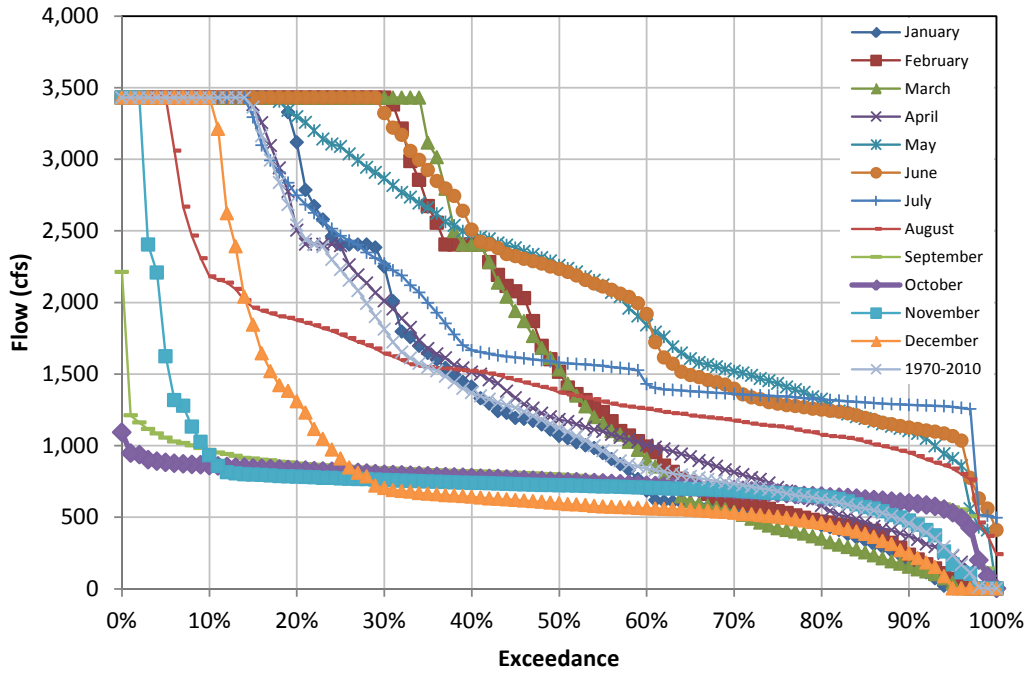


Figure 6.1-18. Modeled monthly flow duration curves for New Colgate Powerhouse for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.

6.1.2.4 Powerhouse Capability Versus Head

Powerhouse capability versus head is shown in Figure 6.1-19. Minimum- and maximum-operating heads for New Colgate Powerhouse are 1,165 ft (corresponding to a reservoir surface elevation of 1,730 ft and 230,000 ac-ft of storage) and 1,390 ft (corresponding to a reservoir surface elevation of 1,955 ft and 966,400 ac-ft of storage), respectively.

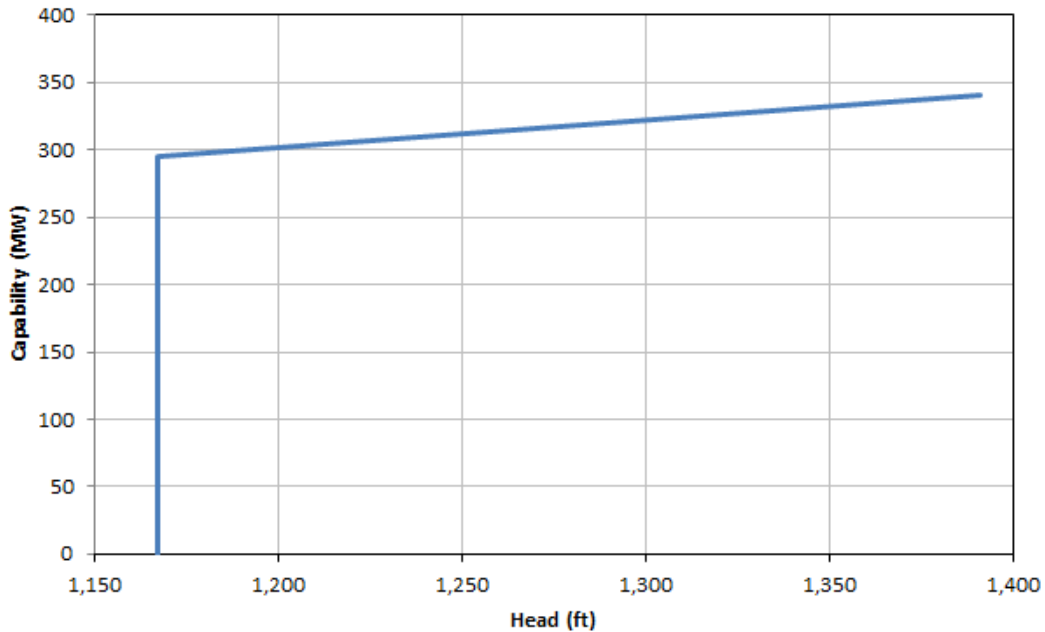


Figure 6.1-19. New Colgate Powerhouse capability curve.

6.1.2.5 Tailwater Rating Curve

New Colgate Powerhouse is a Pelton turbine, and is not dependent on tailwater elevation. The turbine elevation for New Colgate Powerhouse is 565 ft.

6.1.2.6 Load Curves

Because New Colgate Powerhouse is used for ancillary services, there is no diurnal or weekly load curve.

6.1.2.7 Average Annual Energy Production

New Colgate Powerhouse would have generated an average of 1,243,398 MWh/yr from 1970 to 2010 under YCWA’s No Action Alternative Model run. The average annual plant factor for the powerhouse for this time period is 0.45 based on the annual generation divided by the plant nameplate generating capability (315 MW) times the number of hours per year. Annual gross generation and plant factors for the powerhouse are provided in Table 6.1-2.

Table 6.1-2. Modeled generation and plant factors for New Colgate Powerhouse under YCWA’s No Action Alternative Model run.

Water Year	Annual Generation (MWh)	Annual Generation, (aMW)	Plant Capability (MW)	Plant Factor
1970	1,380,658	158	315	0.50
1971	1,664,326	190	315	0.60
1972	1,175,754	134	315	0.43
1973	1,526,757	174	315	0.55
1974	2,187,500	250	315	0.79

Table 6.1-2. (continued)

Water Year	Annual Generation (MWh)	Annual Generation, (aMW)	Plant Capability (MW)	Plant Factor
1975	1,448,480	165	315	0.52
1976	697,788	80	315	0.25
1977	353,218	40	315	0.13
1978	1,396,529	159	315	0.51
1979	1,072,471	122	315	0.39
1980	1,706,641	195	315	0.62
1981	782,964	89	315	0.28
1982	2,183,740	249	315	0.79
1983	2,253,690	257	315	0.82
1984	1,764,280	201	315	0.64
1985	844,617	96	315	0.31
1986	1,382,335	158	315	0.50
1987	631,443	72	315	0.23
1988	564,100	64	315	0.20
1989	1,076,482	123	315	0.39
1990	684,543	78	315	0.25
1991	682,600	78	315	0.25
1992	676,509	77	315	0.25
1993	1,544,432	176	315	0.56
1994	638,508	73	315	0.23
1995	1,935,319	221	315	0.70
1996	1,801,677	206	315	0.65
1997	1,494,948	171	315	0.54
1998	1,859,265	212	315	0.67
1999	1,680,664	192	315	0.61
2000	1,375,233	157	315	0.50
2001	596,252	68	315	0.22
2002	803,227	92	315	0.29
2003	1,391,734	159	315	0.50
2004	1,001,392	114	315	0.36
2005	1,281,369	146	315	0.46
2006	1,978,099	226	315	0.72
2007	846,785	97	315	0.31
2008	574,432	66	315	0.21
2009	928,533	106	315	0.34
2010	1,110,004	127	315	0.40
Total	50,979,300	--	--	--
Minimum	353,218	40	--	0.13
Average	1,243,398	142	--	0.45
Median	1,281,369	146	--	0.46
Maximum	2,253,690	257	--	0.82

Key: aMW = annual megawatt

6.1.2.8 New Colgate Powerhouse Dependable Capacity

The dependable capacity of a generating facility is defined as “*the generating capacity that the plant can deliver under the most adverse water supply conditions to meet the needs of an electric power system with a given maximum demand.*” (Elliott et al. 1997). One of the critical parameters for defining dependable capacity is the period over which the capacity must be provided. Traditionally, a year or season from time of maximum storage to minimum storage is used for the time period over which capacity is calculated. For a peaking plant, such as the New

Colgate Powerhouse, the dependable capacity critical period is less precisely defined and is specific to the plant demand and constraints.

For the purposes of determining dependable capacity of the Project's powerhouses, a different methodology is used for each powerhouse. As pointed out above, New Colgate Powerhouse is a peaking powerhouse. For the New Colgate Powerhouse, available water supply and flow are not limiting factors for determining dependable capacity; New Bullards Bar Reservoir storage has never been drawn down to a volume where water supply limited generation. Instead, generating capacity at the New Colgate Powerhouse is limited by available head; as a peaking plant, the full flow capacity of 3,430 cfs is available at any time. The dependable capacity for the New Colgate Powerhouse is determined by the generation capacity at New Bullards Bar Reservoir's minimum storage. Under the No Action Alternative, the minimum New Bullards Bar Reservoir storage of 188,997 ac-ft occurred on December 13, 1977. Based on this minimum storage and the full flow capacity through the New Colgate Powerhouse, the dependable capacity of the New Colgate Powerhouse under the No Action Alternative is 231,497 kW.

6.2 New Bullards Bar Minimum Flow Development

New Bullards Bar Minimum Flow Development is located on the North Yuba River and includes one powerhouse (New Bullards Bar Minimum Flow). New Bullards Bar Minimum Flow Powerhouse is immediately downstream of New Bullards Bar Dam (part of the New Colgate Development). The powerhouse penstock is a 70-ft long, 12-in diameter, steel penstock with a maximum capacity of 5 cfs. The powerhouse includes a single Pelton type turbine with a nameplate capacity of 150 kW of flow at 5 cfs.

6.2.1 Reservoir Operations

There are no reservoir operations associated with the New Bullards Bar Minimum Flow Development. Releases are made from the bottom of New Bullards Dam, part of the New Colgate Development, and are made irrespective of storage.

6.2.2 Plant Operations – New Bullards Bar Minimum Flow Powerhouse

New Bullards Bar Minimum Flow Powerhouse is operated as a “base load” facility, where flows are set at a constant rate to supplement seepage from New Bullards Bar Dam to provide the required flow downstream of New Bullards Bar Dam.

6.2.2.1 Powerhouse Minimum, Maximum and Mean Flows

Minimum-, maximum- and mean-daily average flows based on YCWA's No Action Alternative Model run for WY 1970 through 2010, are 1.6 cfs, 3.3 cfs and 4.4 cfs, respectively.

6.2.2.2 Powerhouse Hydraulic Capacity

New Bullards Bar Minimum Flow Powerhouse consists of a single Pelton type turbine with a nameplate capacity of 150 kW under a design head of 560 ft and a rated flow of 5 cfs.

6.2.2.3 Powerhouse Flow Duration Curves

Annual and monthly flow duration curves for releases from New Bullards Bar Minimum Flow Powerhouse, based on YCWA’s No Action Alternative Model run for WY 1970 through 2010, is provided in Figure 6.2-1.

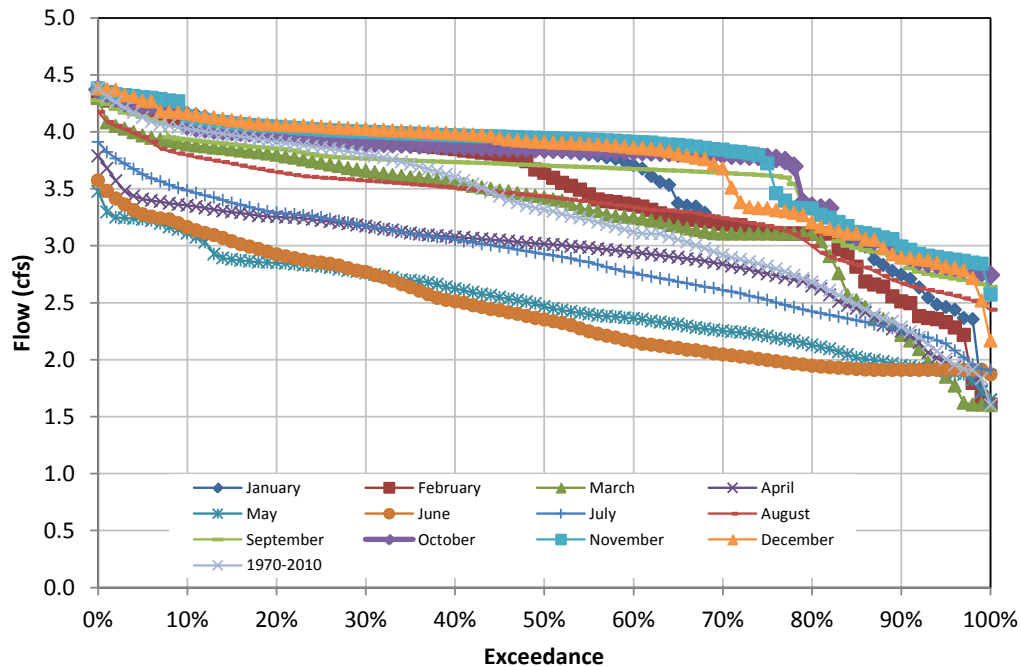


Figure 6.2-1. Modeled monthly flow duration curves for New Bullards Bar Minimum Flow Powerhouse for water years 1970 through 2010 under YCWA’s No Action Alternative Model run.

6.2.2.4 Powerhouse Capability Versus Head

Powerhouse capability versus head is shown in Figure 6.2-2. Minimum- and maximum-operating heads for New Colgate Powerhouse are 344 ft and 560 ft, respectively.

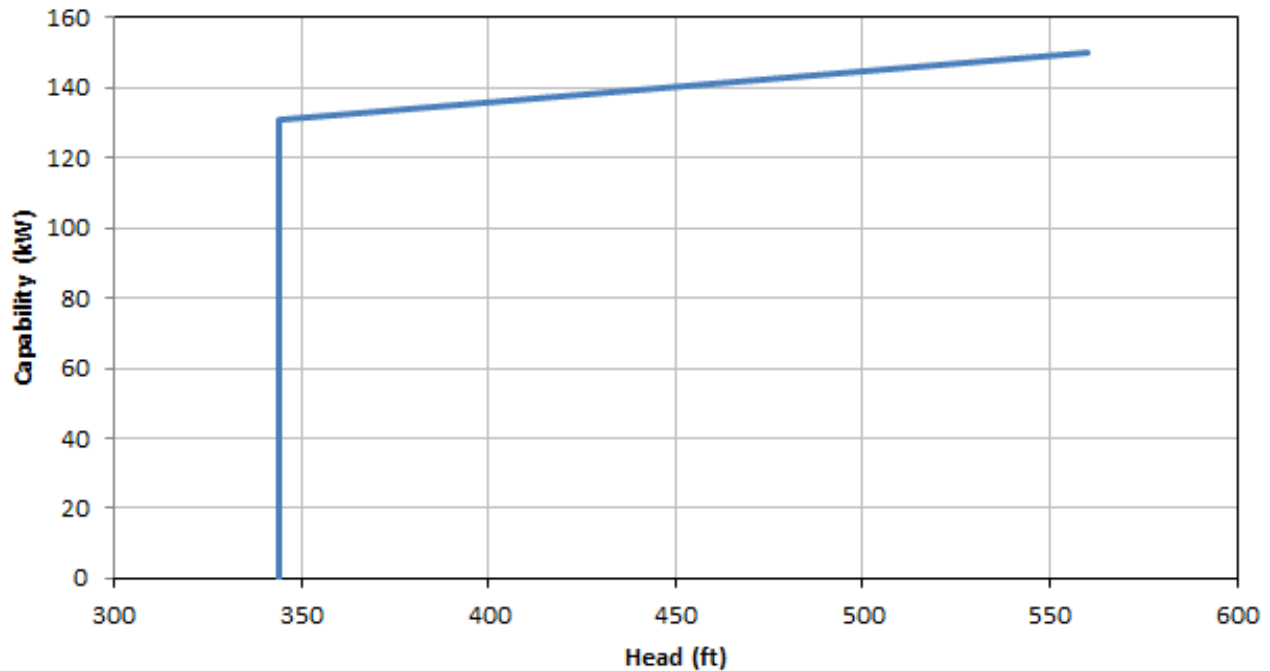


Figure 6.2-2. New Bullards Bar minimum flow powerhouse capability curve.

6.2.2.5 Tailwater Rating Curve

New Bullards Bar Minimum Flow Powerhouse is a Pelton turbine and is not dependent on tailwater elevation. The turbine centerline elevation for New Bullards Bar Minimum Flow Powerhouse is 1,320 ft.

6.2.2.6 Load Curves

Because New Bullards Bar Minimum Flow Powerhouse is a base-loaded plant without peaking capability, there is no diurnal or weekly load curve. There is no appreciable station service power usage.

6.2.2.7 Average Annual Energy Production

New Bullards Bar Minimum Flow Powerhouse generated an average of 952 MWh/yr from 1970 to 2010 under YCWA’s No Action Alternative Model run. The average annual plant factor for the powerhouse for this time period is 72-percent based on the annual generation divided by the plant generating capability (150 kW) times the number of hours per year. Annual gross generation and plant factors for the powerhouse are provided in Table 6.2-1.

Table 6.2-1. Modeled generation and plant factors for New Bullards Bar Minimum Flow Powerhouse under YCWA’s No Action Alternative Model run.

Water Year	Annual Generation (MWh)	Annual Generation (akW)	Plant Capability (kW)	Plant Factor
1970	1,068	122	150	0.81
1971	992	113	150	0.75
1972	1,058	121	150	0.80

Table 6.2-1. (continued)

Water Year	Annual Generation (MWh)	Annual Generation (akW)	Plant Capability (kW)	Plant Factor
1973	1,014	116	150	0.77
1974	949	108	150	0.72
1975	994	113	150	0.76
1976	912	104	150	0.69
1977	714	81	150	0.54
1978	783	89	150	0.60
1979	1,022	117	150	0.78
1980	991	113	150	0.75
1981	960	110	150	0.73
1982	839	96	150	0.64
1983	944	108	150	0.72
1984	1,005	115	150	0.76
1985	1,060	121	150	0.81
1986	1,030	118	150	0.78
1987	889	101	150	0.68
1988	728	83	150	0.55
1989	853	97	150	0.65
1990	1,055	120	150	0.80
1991	941	107	150	0.72
1992	770	88	150	0.59
1993	794	91	150	0.60
1994	880	100	150	0.67
1995	740	84	150	0.56
1996	986	113	150	0.75
1997	1,036	118	150	0.79
1998	964	110	150	0.73
1999	998	114	150	0.76
2000	1,041	119	150	0.79
2001	897	102	150	0.68
2002	847	97	150	0.64
2003	1,007	115	150	0.77
2004	1,059	121	150	0.81
2005	1,007	115	150	0.77
2006	960	109	150	0.73
2007	1,087	124	150	0.83
2008	1,095	125	150	0.83
2009	1,037	118	150	0.79
2010	1,009	115	150	0.77
Total	39,017	--	--	--
Minimum	714	81	--	0.54
Average	952	108.6	--	0.72
Median	991	113.1	--	0.75
Maximum	1,095	125.0	--	0.83

Key: akW = annual kilowatt

6.2.2.8 Minimum Flow Powerhouse Dependable Capacity

Dependable capacity at the Minimum Flow Powerhouse at the base of New Bullards Bar Dam is flow limited. The Minimum Flow Powerhouse is operated to meet a minimum required flow on the North Yuba River downstream of New Bullards Bar Dam. Rather than operating at a constant rate according to the required flow, the Minimum Flow Powerhouse is operated to

supplement seepage from New Bullards Bar Dam. The dependable capacity for the Minimum Flow Powerhouse is determined by evaluating the period with the lowest release through the minimum flow powerhouse, corresponding to the period with the greatest seepage and lowest reservoir water-surface elevation. On March 10, 1995, there was a mean-daily release of 1.6 cfs through the minimum flow powerhouse and a reservoir storage of 796,980 ac-ft. This combination of circumstances defines the period used to determine the Minimum Flow Powerhouse's dependable capacity of 57 kW.

6.3 Narrows 2 Development

The Narrows 2 Development is located on the main stem of the Yuba River. The development includes one power tunnel and penstock (Narrows 2) and one powerhouse (Narrows 2). The Narrows 2 powerhouse is an indoor facility located at the base of the USACE's Englebright Dam.

6.3.1 Reservoir Operations

There are no Project reservoirs associated with the Narrows 2 Development.

6.3.2 Plant Operations – Narrows 2 Powerhouse

Narrows 2 Powerhouse is operated as a base loaded facility, with stable flows, as required by the Yuba Accord flow schedules seasonal irrigation demands and license terms for flow ramping and flow fluctuation.

6.3.2.1 Powerhouse Minimum, Maximum, and Mean Flows

Minimum-, maximum and mean-daily average flows based on YCWA's No Action Alternative Model run for WY 1970 through 2010, are 0.0 cfs, 1,318 cfs and 3,400 cfs, respectively.

6.3.2.2 Powerhouse Hydraulic Capacity

Narrows 2 Powerhouse Penstock is a 20-ft diameter, concrete lined tunnel in the upper 349-ft section, and is a 14-ft diameter, steel lined tunnel in the lower 368-ft section. The penstock has a maximum capacity of 3,400 cfs. Narrows 2 flow bypass is a valve and penstock branch off of the main Narrows 2 penstock that was added to the Project in 2008 to provide the capability to bypass flows of up to 3,000 cfs around the Narrows 2 Powerhouse during times of full powerhouse shutdowns. Narrows 2 Powerhouse consists of a vertical axis Francis turbine with a nameplate capacity of 46.7 MW at a head of 236 ft and flow of 3,400 cfs.

6.3.2.3 Powerhouse Flow Duration Curves

Annual and monthly flow duration curves for releases from Narrows 2 Powerhouse, based on YCWA's No Action Alternative Model run for WY 1970 through 2010, is provided in Figure 6.3-1. Annual and monthly flow duration curves for releases from Narrows 2 Bypass, based on

YCWA's No Action Alternative Model run for WY 1970 through 2010, is provided in Figure 6.3-2.

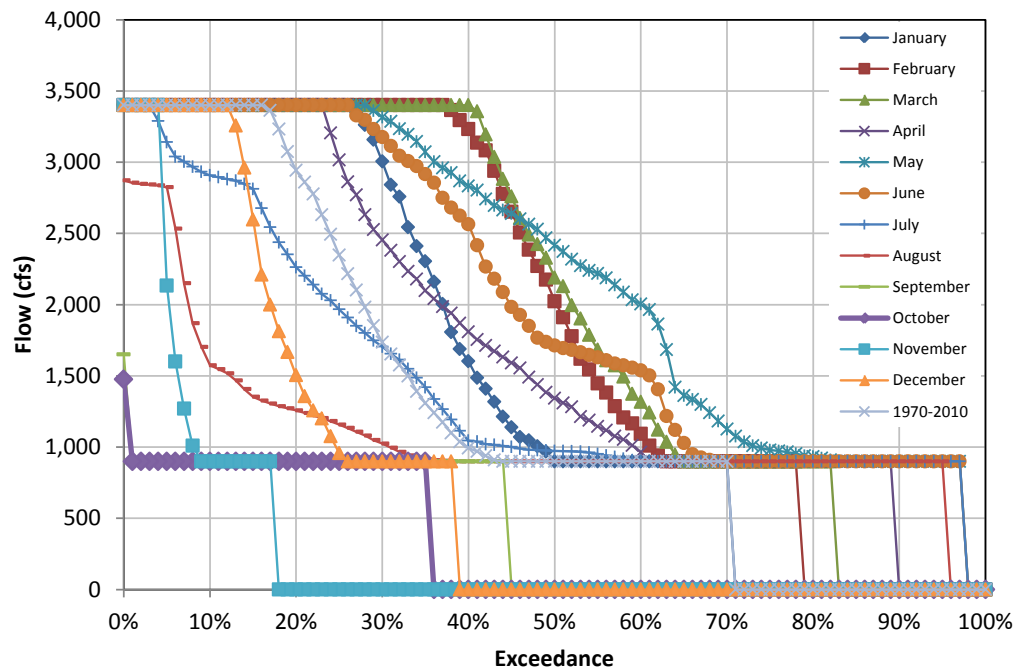


Figure 6.3-1. Modeled monthly flow duration curves for Narrows 2 Powerhouse for water years 1970 through 2010 under YCWA's No Action Alternative Model run.

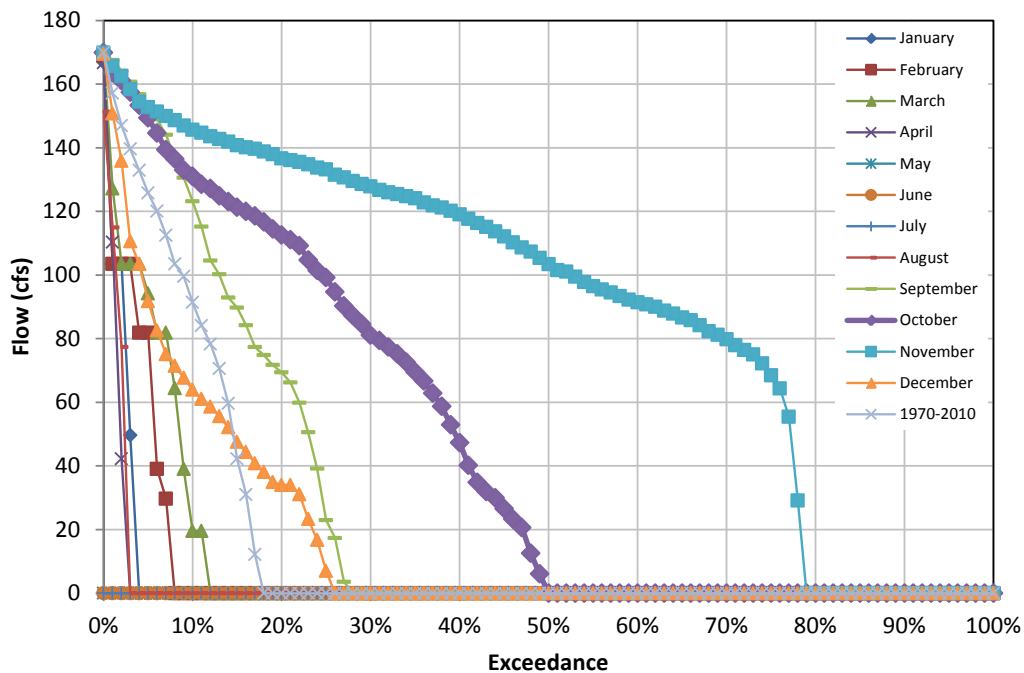


Figure 6.3-2. Modeled monthly flow duration curves for Narrows 2 Bypass for water years 1970 through 2010 under YCWA's No Action Alternative Model run.

6.3.2.4 Powerhouse Capability Versus Head

Powerhouse capability versus head is shown in Figure 6.3-3. Minimum- and maximum-operating heads for Narrows 2 Powerhouse are 183 ft and 236 ft, respectively.

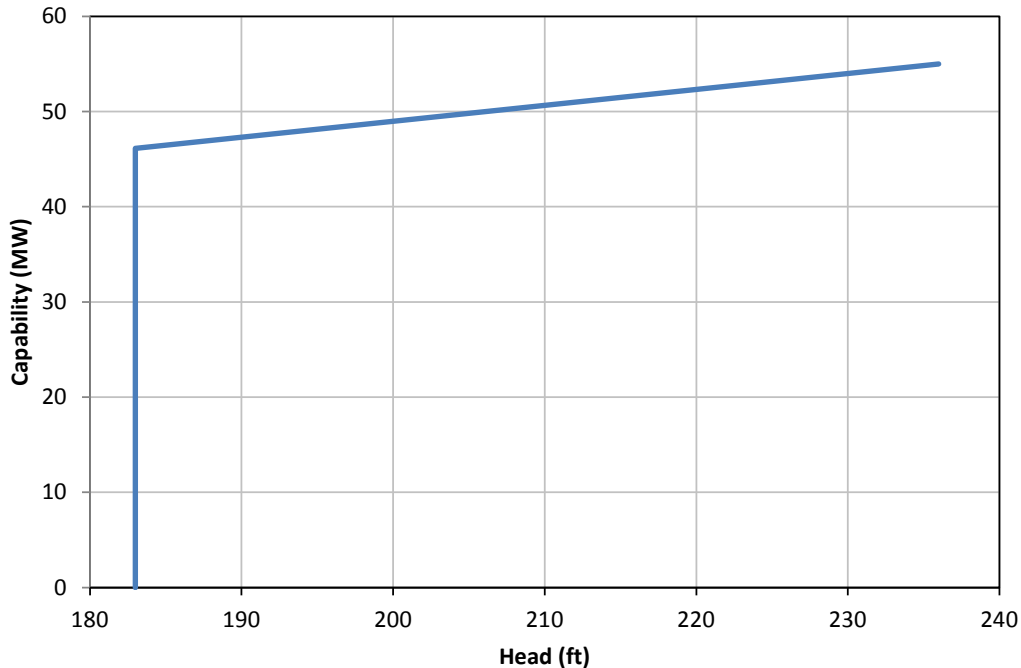


Figure 6.3-3. Narrows 2 Powerhouse capability curve.

6.3.2.5 Tailwater Rating Curve

The normal tailwater elevation for Narrows 2 Powerhouse is 287 ft. Tailwater elevation is a function of the combined release from Narrows 1 and Narrows 2 Powerhouses, and Englebright Reservoir spill. As such, a tailwater rating curve does not exist.

6.3.2.6 Load Curves

Because Narrows 2 Powerhouse is a base-loaded plant without peaking capability, there is no diurnal or weekly load curve.

6.3.2.7 Average Annual Energy Production

Narrows 2 Powerhouse generated an average of 172,902 MWh/yr from 1970 to 2010 under YCWA's No Action Alternative Model run. The average annual plant factor for the powerhouse for this time period is 0.42 based on the annual generation divided by the plant generating capability (46.7 MW) times the number of hours per year. Annual gross generation and plant factors for the powerhouse are provided in Table 6.3-1.

Table 6.3-1. Generation and plant factors for Narrows 2 Powerhouse under YCWA’s No Action Alternative Model run.

Water Year	Annual Generation (MWh)	Annual Generation (aMW)	Plant Capability (MW)	Plant Factor
1970	188,930	21.6	46.7	0.46
1971	276,389	31.5	46.7	0.68
1972	156,945	17.9	46.7	0.38
1973	219,664	25.1	46.7	0.54
1974	346,394	39.5	46.7	0.85
1975	234,278	26.7	46.7	0.57
1976	66,130	7.5	46.7	0.16
1977	0	0.0	46.7	0.00
1978	237,522	27.1	46.7	0.58
1979	146,007	16.7	46.7	0.36
1980	258,067	29.4	46.7	0.63
1981	75,639	8.6	46.7	0.18
1982	340,318	38.8	46.7	0.83
1983	361,768	41.3	46.7	0.88
1984	267,327	30.5	46.7	0.65
1985	99,969	11.4	46.7	0.24
1986	199,859	22.8	46.7	0.49
1987	47,444	5.4	46.7	0.12
1988	40,484	4.6	46.7	0.10
1989	148,198	16.9	46.7	0.36
1990	68,151	7.8	46.7	0.17
1991	58,787	6.7	46.7	0.14
1992	59,714	6.8	46.7	0.15
1993	251,644	28.7	46.7	0.61
1994	50,400	5.7	46.7	0.12
1995	306,584	35.0	46.7	0.75
1996	263,055	30.0	46.7	0.64
1997	220,631	25.2	46.7	0.54
1998	294,501	33.6	46.7	0.72
1999	250,829	28.6	46.7	0.61
2000	186,224	21.2	46.7	0.45
2001	43,307	4.9	46.7	0.11
2002	94,146	10.7	46.7	0.23
2003	210,913	24.1	46.7	0.52
2004	121,971	13.9	46.7	0.30
2005	190,007	21.7	46.7	0.46
2006	295,749	33.7	46.7	0.72
2007	87,410	10.0	46.7	0.21
2008	50,432	5.8	46.7	0.12
2009	113,762	13.0	46.7	0.28
2010	159,441	18.2	46.7	0.39
Total	7,088,988	--	--	--
Minimum	0	0.0	--	0.00
Average	172,902	19.7	--	0.42
Median	186,224	21.2	--	0.45
Maximum	361,768	41.3	--	0.88

Key: aMW = annual megawatt

6.3.2.8 Narrows 2 Powerhouse Dependable Capacity

The Narrows 2 Powerhouse dependable capacity is flow limited. Historically, there were no releases through the Narrows 2 Powerhouse for most of 1977; all releases from Englebright Reservoir were made through PG&E's Narrows 1 Powerhouse during that time. Accordingly, the lack of releases through the Narrows 2 Powerhouse defines the critical streamflow for determining the dependable capacity for the powerhouse. The dependable capacity for the Narrows 2 Powerhouse under the No Action Alternative is 0 kW.

7.0 YCWA's Proposed Project Operations by Development

Operation of YCWA's reservoirs, dams, and powerhouses under YCWA's Proposed Project Alternative are presented below for the three Project developments: New Colgate, New Bullards Bar Minimum Flow and Narrows 2.

The YCWA has simulated operations of the Proposed Project Alternative using the same modeling tools used for the No Action Alternative. Accordingly, many of the facility features are identical to those described in Section 6. Differences in operations from the No Action Alternative are described here, as are the model output resulting from simulated operations according to the Proposed Project Alternative.

7.1 Proposed Project Conditions Affecting Project Operations

YCWA's proposed Project includes several conditions directly affecting Project operations. Other proposed Conditions may affect Project operations, but operations for the proposed Conditions are the same under the No Action Alternative. Proposed Conditions affecting operations differently than under the No Action Alternative are described below.

7.1.1 New Water Year Types for Conditions Pertaining to New Bullards Bar Dam, Our House Diversion Dam, and Log Cabin Diversion Dam

Proposed Condition WR2 includes the definition of a new hydrologic index, the "Smartsville Hydrological Index," and associated water year types that are used to determine minimum required flows on the North Yuba River downstream of New Bullards Bar Dam, the Middle Yuba River downstream of Our House Diversion Dam, and on Oregon Creek downstream of Log Cabin Dam. These hydrologic year types are defined by published forecasts of annual unimpaired Yuba River flow near Smartsville and computed unimpaired flows for previous months. DWR publishes forecasts of annual volumes of unimpaired Yuba River flow near Smartsville in its Bulletin 120, Water Conditions in California, every year in early February, March, April, and May. At the end of the water year, YCWA will use the actual annual volume of unimpaired Yuba River flow near Smartsville for the previous year to determine the water year type used until the next forecast is released. Table 7.1-1 shows the Smartsville Hydrological Index thresholds and associated water year types.

Table 7.1-1. Smartsville hydrological index Water Year types and associated thresholds

Water Year Type	DWR Forecast of Total Unimpaired Runoff in the Yuba River at Smartsville in Thousand Acre-Feet or DWR Full Natural Flow Near Smartsville for the water year in Thousand Acre-Feet ¹
Wet	Greater than 3,240
Above Normal	2,191 to 3,240
Below Normal	1,461 to 2,190
Dry	901 to 1,460
Critically Dry	616 to 900
Extreme Critically Dry ²	Equal to or Less than 615

¹ DWR rounds the Bulletin 120 forecast to the nearest 1,000 acre-feet. The Full Natural Flow is provided to the nearest acre-foot, and YCWA will round DWR's Full Natural Flow to the nearest 1,000 acre-feet.

² A Critically Dry Water Year that follows an Extreme Critically Dry Water Year or a Critically Dry Water Year shall be considered an Extreme Critically Dry Water Year.

7.1.2 Minimum Flows in the Middle Yuba River Downstream of Our House Diversion Dam

Under the Proposed Project proposed Condition AR1, there would be new flow requirements for the Middle Yuba River downstream of Our House Diversion Dam. The required flow will be determined based on the applicable Smartsville Hydrological Index water-year type. Table 7.1-2 shows the proposed monthly required flows for the Middle Yuba River downstream of Our House Diversion Dam by water year type, as included in proposed Condition AR1.

Table 7.1-2. Proposed Project flow requirements for the Middle Yuba River downstream of Our House Diversion Dam by Smartsville hydrological index Water Year type.

Month	Wet Water Year (cfs)	Above Normal Water Year (cfs)	Below Normal Water Year(cfs)	Dry Water Year (cfs)	Critically Dry Water Year (cfs)	Extreme Critically Dry Water Year (cfs)
October 1 - 30	57*	57*	57*	49*	35*	21*
November 1-30	57*	57*	57*	49*	35*	21*
December 1 - 31	57*	57*	57*	49*	35*	21*
January 1 - 31	57*	57*	57*	49*	35*	21*
February 1- 29	57*	57*	57*	49*	35*	21*
March 1 - 31	80*	66*	57*	49*	35*	21*
April 1 - 30	80*	66*	57*	49*	35*	21*
May 1- 31	80*	66*	57*	49*	35*	21*
June 1 - 30	80*	66*	57*	49*	35*	21*
July 1 - 31	80*	66*	57*	49*	35*	21*
August 1 - 31	80*	66*	57*	49*	35*	21*
September 1- 30	80*	66*	57*	49*	35*	21*

* Or natural inflow if natural inflow is less.

7.1.3 Minimum flows in Oregon Creek Flow Downstream of the Log Cabin Diversion Dam

Under the proposed Project, there would be new flow requirements for Oregon Creek downstream of Log Cabin Diversion Dam under proposed Condition AR1. The required flow will be determined based on the applicable Smartsville Hydrological Index water year type. Table 7.1-3 shows the monthly required flows for Oregon Creek downstream of Log Cabin Diversion Dam by water year type, as included in proposed Condition AR1.

Table 7.1-3. Proposed Project flow requirements for Oregon Creek downstream of Log Cabin Diversion Dam by Smartsville Hydrological Index Water Year Type.

Month	Wet Water Year (cfs)	Above Normal Water Year (cfs)	Below Normal Water Year (cfs)	Dry Water Year (cfs)	Critically Dry Water Year (cfs)	Extreme Critically Dry Water Year (cfs)
October 1 - 30	8*	8*	8*	6*	6*	6*
November 1-30	8*	8*	8*	6*	6*	6*
December 1 - 31	8*	8*	8*	6*	6*	6*
January 1 - 31	8*	8*	8*	6*	6*	6*
February 1- 29	8*	8*	8*	6*	6*	6*
March 1 - 31	13*	10*	8*	6*	6*	6*
April 1 - 30	31*	26*	21*	18*	12*	6*
May 1- 31	31*	26*	21*	18*	12*	6*
June 1 - 30	31*	26*	21*	18*	12*	6*
July 1 - 31	13*	10*	8*	6*	6*	6*
August 1 - 31	13*	10*	8*	6*	6*	6*
September 1- 30	13*	10*	8*	6*	6*	6*

* Or natural inflow if natural inflow is less.

7.1.4 Minimum Flows in the North Yuba River Flow Downstream of New Bullards Bar Dam

Under the Proposed Project, proposed Condition AR1 includes new flow requirements for the North Yuba River downstream of New Bullards Bar Dam. The required flow will be determined based on the applicable Smartsville Hydrological Index water year type. Table 7.1-4 shows the monthly required flows for the North Yuba River downstream of New Bullards Bar Dam by water year type, as included in Condition AR1.

Table 7.1-4. Proposed Project Flow Requirements for the North Yuba River below New Bullards Bar Dam by Smartsville Hydrological Index Water Year-Type.

Month	Wet Water Year (cfs)	Above Normal Water Year(cfs)	Below Normal Water Year(cfs)	Dry Water Year(cfs)	Critically Dry Water Year(cfs)	Extreme Critically Dry Water Year(cfs)
October 1 - 30	13	13	13	13	7	5
November 1-30	13	13	13	13	7	5
December 1 - 31	13	13	13	13	7	5
January 1 - 31	13	13	13	13	7	5
February 1- 29	13	13	13	13	7	5
March 1 - 31	11	12	13	13	7	5
April 1 - 30	5	5	5	5	5	5
May 1- 31	5	5	5	5	5	5
June 1 - 30	5	5	5	5	5	5
July 1 - 31	11	12	13	13	7	5
August 1 - 31	11	12	13	13	7	5
September 1- 30	11	12	13	13	7	5

7.1.5 Control Project Spills at Our House Diversion Dam

The proposed Project includes a condition controlling the rate of spill cessation for flows over Our House Diversion Dam. This condition, AR2, indicates the spill cessation measure will affect flows over Our House Diversion Dam of 600 cfs or less between May 1 and July 15.

Under these conditions, the Our House Diversion Dam low-level outlet will be used to regulate Middle Yuba River flows downstream from Our House Diversion. The low-level outlet valve would be used to reduce flows by a maximum of 100 cfs or the natural recession rate every two days. Under this condition, Operators would open the low-level valve the first time Our House Dam spills after May 1 to an opening that resulted in the elimination of spill. Operators would continue their existing practice of checking the dam each day, and if they observed spill over the top of Our House Diversion Dam, they would open the valve so the spill stopped. If, after two days at the same setting, the impoundment water-surface elevation dropped, operators would close the valve to a setting that either stopped the impoundment water-surface elevation from dropping, or so the flow downstream of the dam was reduced from the previous day’s flow by 100 cfs, whichever came first. At no point would the fish-flow outlet be closed during spill cessation operations.

7.1.6 Minimum Flows on the Yuba River below the Narrows 2 Powerhouse and Narrows 2 Full Bypass

Under YCWA’s proposed Condition AR3, Maintain Streamflows Downstream of Narrows 2 Powerhouse and Narrows 2 Full Bypass, the required conference year flows for the Yuba River near Smartsville and near Marysville are different from under the No Action Alternative. Table 7.1-5 shows the new conference year flows for the Yuba River near Smartsville and Marysville.

Table 7.1-5. Proposed Project flow requirements for the Yuba River downstream of Narrows 2 Powerhouse and Narrows 2 full flow bypass by North Yuba Index Flow Schedule.

Month	Schedule 1	Schedule 2	Schedule 3	Schedule 4	Schedule 5	Schedule 6	Conference Year
YUBA RIVER - BELOW NARROWS 2 POWERHOUSE/NARROWS 2 FULL BYPASS (Compliance Point: USGS Streamflow Gage 11418000)							
October 1 – 15	700	700	700	700	600	600	500
October 16 - 30	700	700	700	700	600	600	550
November 1 - 30	700	700	700	700	600	600	550
December 1 - 31	700	700	700	700	550	550	550
January 1- 15	700	700	700	700	550	550	550
January 16 – 31	700	700	700	700	550	550	550
February 1 - 29	700	700	700	700	550	550	550
March 1- 31	700	700	700	700	550	550	550
April 1 – 15	700	700	700	700	600	600	500
April 16 – 30	--	--	--	--	--	--	--
May 1 – 15	--	--	--	--	--	--	--
May 16 – 31	--	--	--	--	--	--	--
June 1 - 15	--	--	--	--	--	--	--
June 16 – 30	--	--	--	--	--	--	--
July 1 – 31	--	--	--	--	--	--	--
August 1 – 31	--	--	--	--	--	--	--
September 1 – 30	700	700	700	700	500	500	500
YUBA RIVER - BELOW NARROWS 2 POWERHOUSE/NARROWS 2 FULL BYPASS (Compliance Point: USGS Streamflow Gage 11421000)							
October 1 - 15	500	500	500	400	400	350	350
October 16 - 30	500	500	500	400	400	350	350

Table 7.1-5. (continued)

Month	Schedule 1	Schedule 2	Schedule 3	Schedule 4	Schedule 5	Schedule 6	Conference Year
YUBA RIVER - BELOW NARROWS 2 POWERHOUSE/NARROWS 2 FULL BYPASS (Compliance Point: USGS Streamflow Gage 11421000) (continued)							
November 1 - 30	500	500	500	500	500	350	350
December 1 - 31	500	500	500	500	500	350	350
January 1 - 15	500	500	500	500	500	350	350
January 16 - 31	500	500	500	500	500	350	350
February 1 - 29	500	500	500	500	500	350	350
March 1 - 31	700	700	500	500	500	350	350
April 1 - 15	1,000	700	700	600	500	350	300
April 16 - 30	1,000	800	700	900	600	500	245
May 1 - 15	2,000	1,000	900	900	600	500	245
May 16 - 31	2,000	1,000	900	600	400	400	245
June 1 - 15	1,500	800	500	400	400	300	245
June 16 - 30	1,500	500	500	400	400	150	245
July 1 - 31	700	500	500	400	400	150	150
August 1 - 31	600	500	500	400	400	150	150
September 1 - 30	500	500	500	400	400	350	150

7.1.7 Control Project Spills at New Bullards Bar Dam

Under YCWA’s proposed Condition AR4, Control Project Spills at New Bullards Bar Dam, YCWA would implement a spill cessation operation, where spills of 2,000 cfs or less from New Bullards Bar Dam from May 1 through July 13 would be reduced at a rate of 250 cfs per day until spill had ceased

7.2 New Colgate Development

The Proposed Project includes new flow requirements at two locations within the New Colgate Development: downstream of Our House Diversion Dam; and downstream of Log Cabin Diversion Dam. The Proposed Project also includes spill cessation measures at New Bullards Bar Dam, and Our House Diversion Dam. Lastly, the Proposed Project includes the construction of several flood management-related structures at New Bullards Bar Dam and the New Colgate Powerhouse.

7.2.1 Middle Yuba River Below the Our House Diversion Dam

The current fish-flow release valve at Our House Diversion Dam has an estimated capacity of 59 cfs when the Our House Diversion Dam impoundment water-surface elevation is at the invert of the Lohman Ridge Tunnel, so an enlargement of the valve’s capacity would be needed to release the flows in the Proposed Project. Otherwise, operations for required flows would continue similarly to the No Action Alternative.

Increased minimum flows downstream of Our House Diversion Dam will result in less water diverted to Oregon Creek through the Lohman Ridge Tunnel. As a result, less Middle Yuba River water will be available to supplement minimum instream flow requirements in Oregon

Creek downstream of Log Cabin Dam. Also, less water will be available to divert to New Bullards Bar Reservoir through the Camptonville Tunnel. Operation of the Lohman Ridge Tunnel intake would continue similarly to the No Action Alternative.

Modeled monthly flow duration curves for the Middle Yuba downstream of Our House Diversion Dam and for the Lohman Ridge Diversion Tunnel are provided in Figures 7.2-1 and 7.2-2. Flow duration curves are based on YCWA’s Proposed Project Alternative Model run for WY 1970 through 2010. Figure 7.2-3 and Figure 7.2-4 show flow duration curves during the representative dry (2001), normal (2005), and wet (1998) water years for the Middle Yuba downstream of Our House Diversion Dam and for the Lohman Ridge Diversion Tunnel.

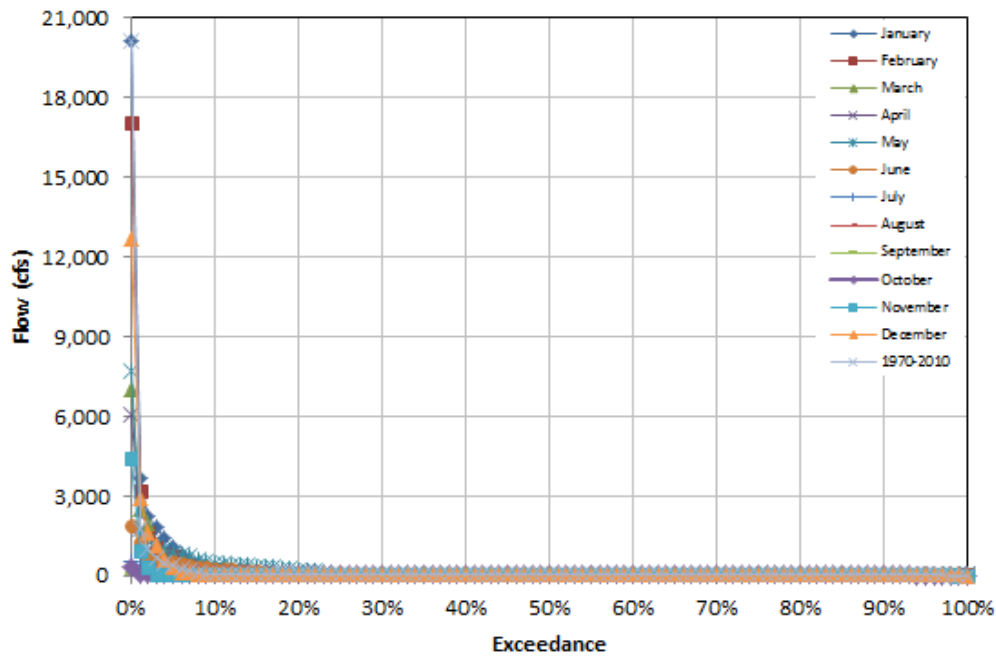


Figure 7.2-1. Modeled monthly flow duration curves for the Middle Yuba River downstream of Our House Diversion Dam for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.

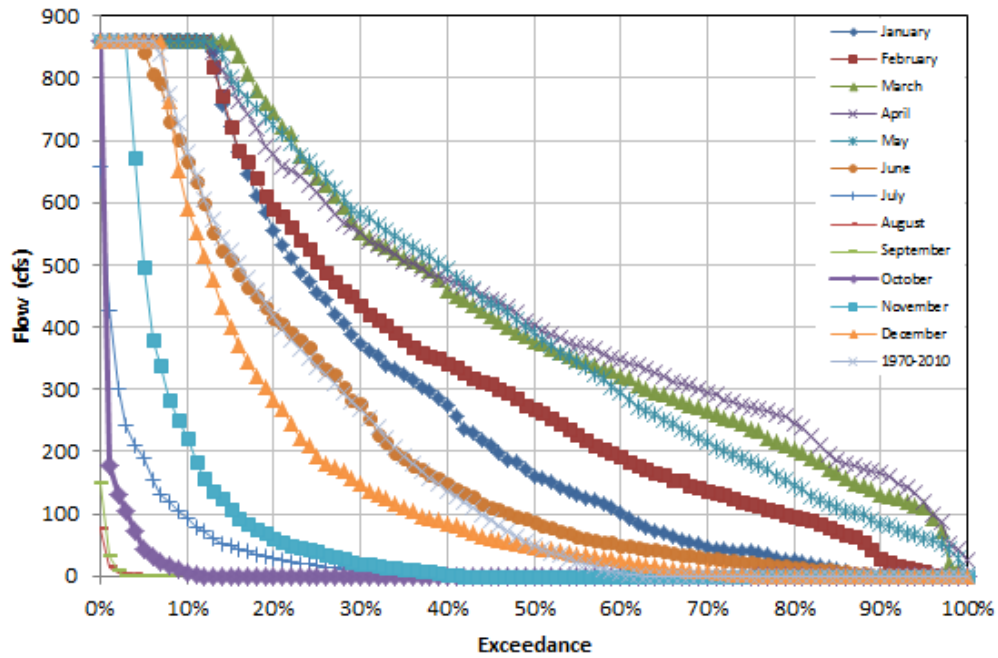


Figure 7.2-2. Modeled monthly flow duration curves for the Lohman Ridge Diversion Tunnel for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.

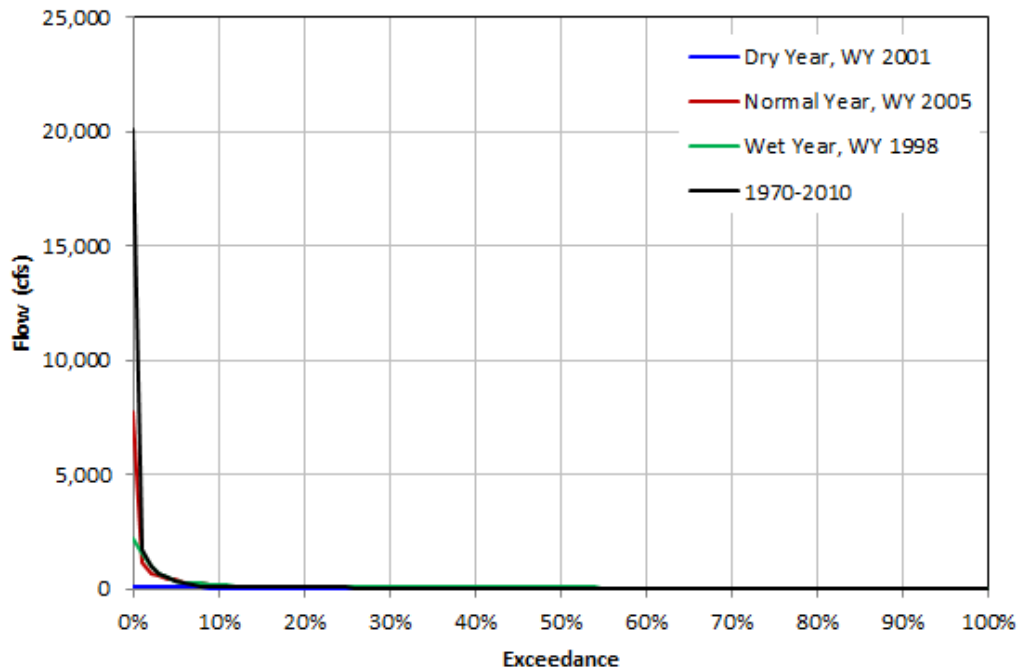


Figure 7.2-3. Modeled flow duration curves for the Middle Yuba River downstream of Our House Diversion Dam for the representative dry (2001), normal (2005) and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative Model run.

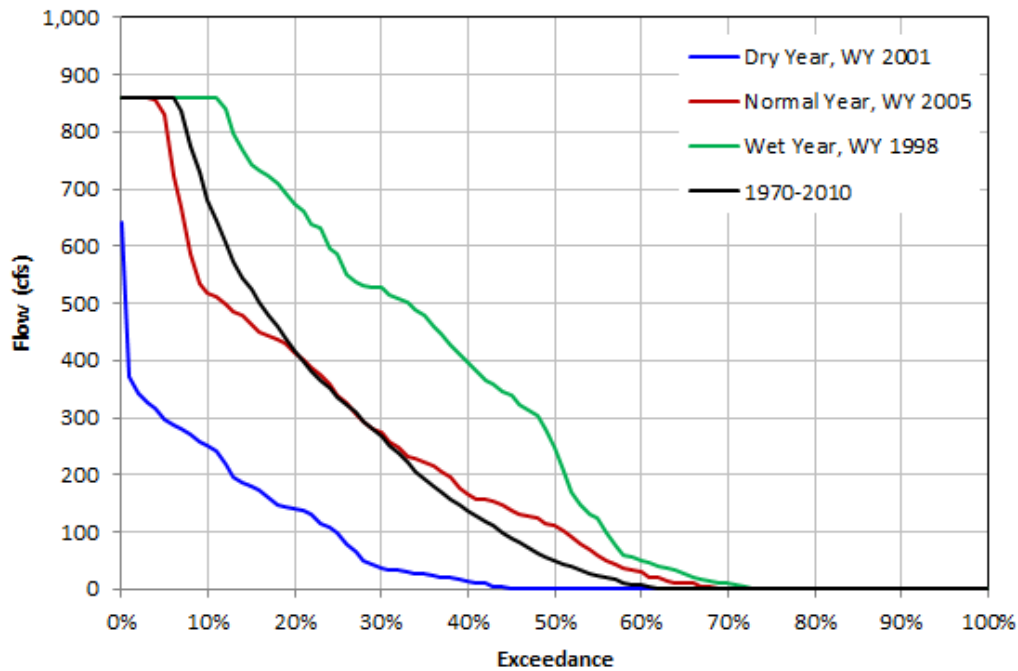


Figure 7.2-4. Modeled flow duration curves for the Lohman Ridge Diversion Tunnel for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative Model run.

7.2.2 Oregon Creek downstream of Log Cabin Dam

The current fish-flow release valve at the Log Cabin Diversion Dam has an estimated capacity of 18 cfs when the Log Cabin Diversion Dam impoundment water-surface elevation is at the invert of the Camptonville Tunnel, so an enlargement of the valve’s capacity would be needed to release flows under the proposed Project. Otherwise, operations for required flows would continue similarly to the No Action Alternative.

Increased minimum flows downstream of Log Cabin Diversion Dam will result in less water diverted to New Bullards Bar Reservoir through the Camptonville Tunnel. Operation of the Camptonville Tunnel intake would continue similarly to the No Action Alternative.

Modeled monthly flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam and for the Camptonville Diversion Tunnel are provided in Figures 7.2-5 and 7.2-6. Flow duration curves are based on YCWA’s Proposed Project Alternative Model run for WY 1970 through 2010. Figure 7.2-7 and Figure 7.2-8 show flow duration curves during the representative dry (2001), normal (2005), and wet (1998) water years for Oregon Creek downstream of Log Cabin Diversion Dam and for the Camptonville Diversion Tunnel.

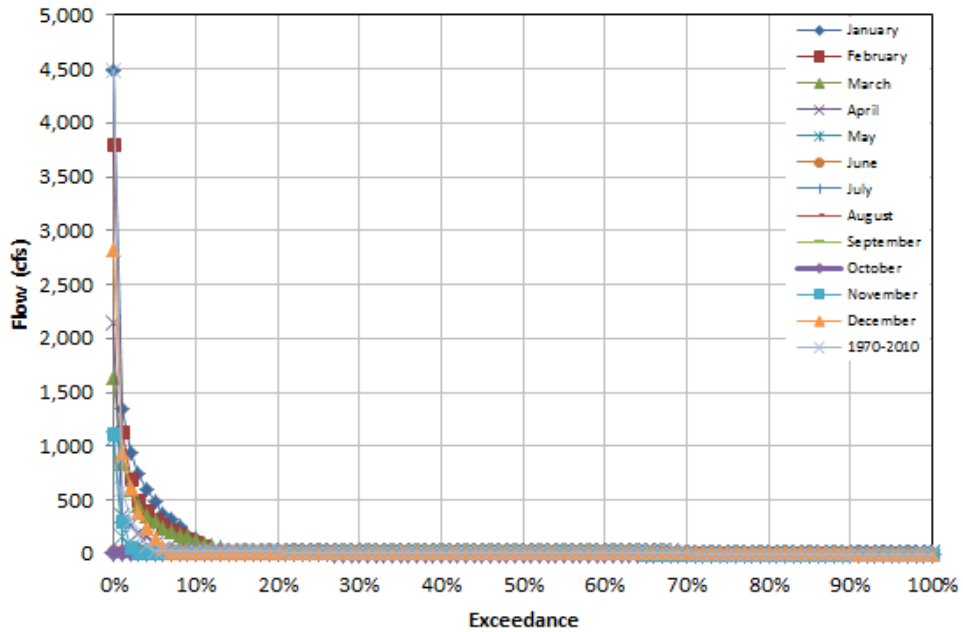


Figure 7.2-5. Modeled monthly flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam for water years 1970 through 2010 under YCWA's Proposed Project Alternative Model run.

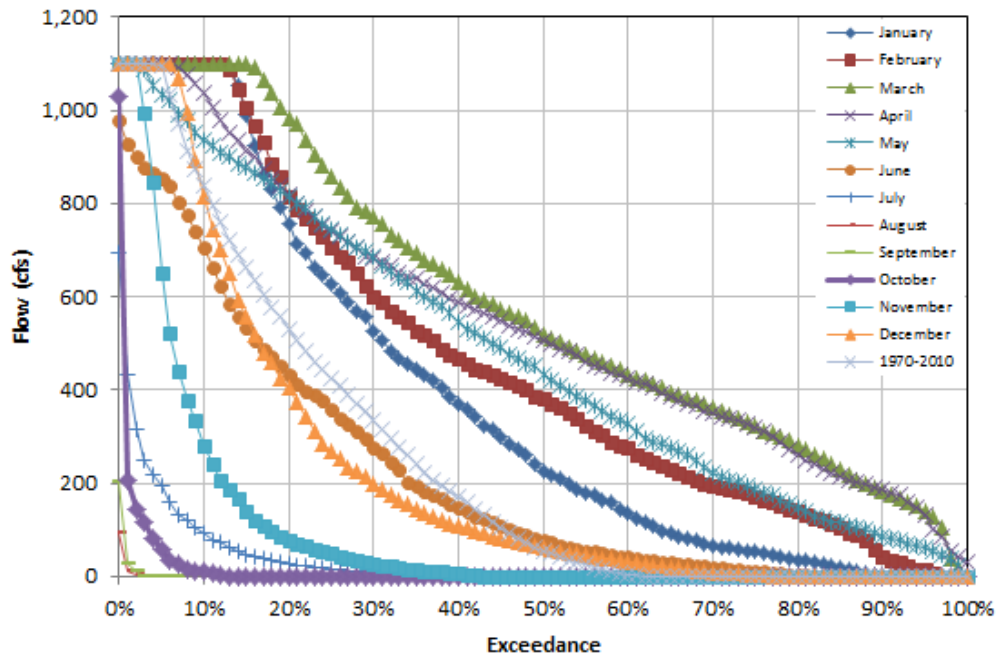


Figure 7.2-6. Modeled monthly flow duration curves for the Camptonville Diversion Tunnel for water years 1970 through 2010 under YCWA's Proposed Project Alternative Model run.

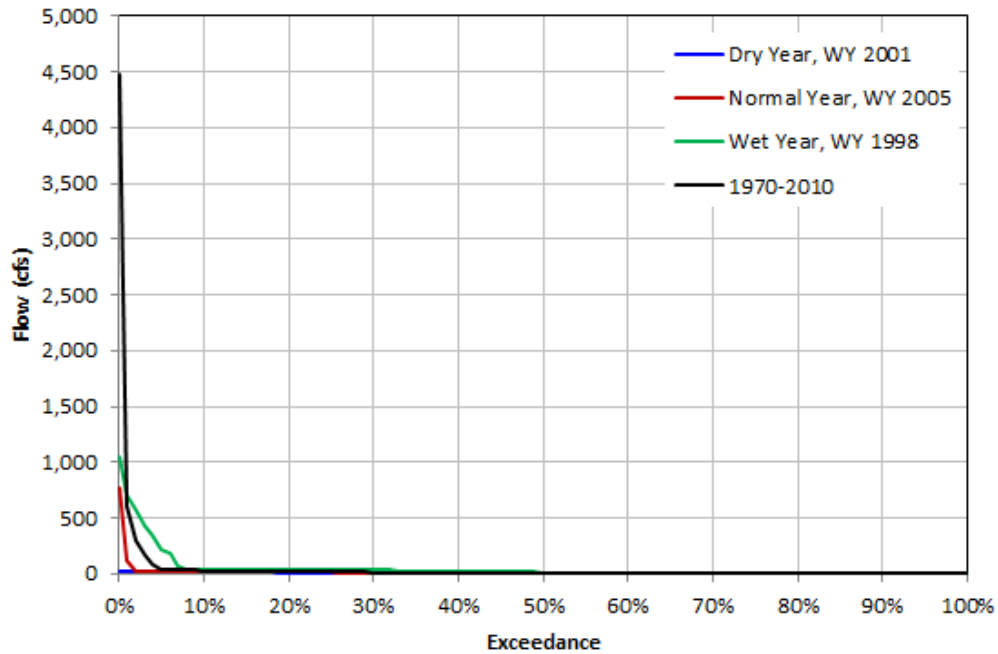


Figure 7.2-7. Modeled flow duration curves for Oregon Creek downstream of Log Cabin Diversion Dam for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative Model run.

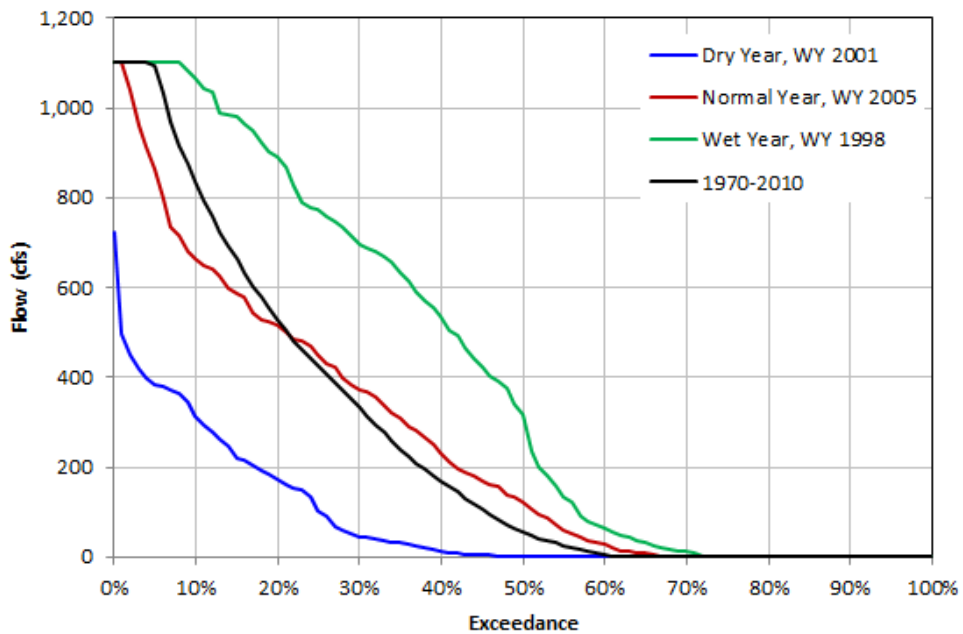


Figure 7.2-8. Modeled flow duration curves for the Camptonville Diversion Tunnel for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative model run

7.2.3 New Bullards Bar Reservoir

The only flow-related conditions in YCWA's Proposed Project Alternative directly focused on New Bullards Bar Reservoir operations is AR4, Control Project Spills at New Bullards Bar Reservoir, but as the primary facility in the Project, an operational change on any other Project facility would have an affect of some sort on New Bullards Bar Reservoir operations. Increasing minimum instream flows on the Middle Yuba River and Oregon Creek downstream of Our House Diversion Dam and Log Cabin Diversion Dam, respectively, could both reduce inflows to New Bullards Bar Dam through the Camptonville Tunnel, and result in reduced releases to the New Colgate Powerhouse. Similarly, the change to the minimum instream flows on the North Yuba River downstream of New Bullards Bar Dam, would similarly result in decreased releases to the New Colgate Powerhouse. Flows on the Yuba River downstream of Englebright Dam under the Proposed Project would not change in most years; since New Bullards Bar Reservoir releases are generally driven by flows on the Yuba River downstream of Englebright Dam, there would not be much change in New Bullards Bar Reservoir storage under the proposed Project. Decreases in inflow due to changes in minimum instream flows on the Middle Yuba River and Oregon Creek, and increased releases to the North Yuba River would be generally offset by equivalently decreased releases from New Bullards Bar Dam through the New Colgate Powerhouse.

The addition of the new flood management-related facilities in the Proposed Project Alternative, the tailwater depression system (TDS) and the New Bullards Bar Dam Flood-Control Outlet, would have an effect on New Bullards Bar Reservoir operations. The TDS at the New Colgate Powerhouse would increase New Bullards Bar Reservoir release capacity during flood events by allowing the New Colgate Powerhouse to continue to operate during high flow events through the injection of compressed air into the New Colgate Powerhouse tailrace when the stage of the Yuba River would otherwise prevent generation. A corresponding benefit would be that the TDS would also allow for an increase in generation from the New Colgate Powerhouse at times when generation would otherwise have been precluded. Modeling for the Proposed Project indicates the TDS would operate in 12 out of 41 years.

The proposed Flood-Control Outlet would allow for releases from New Bullard Bar Dam's when the water-surface elevation is below the existing New Bullards Bar Dam spillway in anticipation of large storm events, and would increase New Bullards Bar Dam's exiting release capacity during high flow events. While the Flood-Control Outlet is included in the simulation of the Proposed Project Alternative in the Operations Model, only its increased release capacity during spill events is included in the Proposed Project simulation. Anticipatory releases through the Flood-Control Outlet or flood management-related releases when storage is below the USACE flood reservation space are not included in modeling of the Proposed Project Alternative; those operations would be determined based on a number of real-time factors including upstream snow-pack and forecasted storm intensity that are not included in the Operations Model. Modeling of the Proposed Project Alternative to augment the existing New Bullards Bar Dam spillway capacity indicates the Flood-Control Outlet could be used each time New Bullards Bar Reservoir spill operations are needed, but the existing capacity is adequate for all low-to-medium intensity storm events so the release from the dam can be made through either outlet. The modeling results show that the Flood-Control Outlet additional release capacity and release

capacity at a lower water-surface elevation would only be needed during very large storm events, or in roughly 8 out of 41 years. Any pre-emptive releases associated with the Forecasted Coordinated Operations program would likely be made using the Flood Control Outlet in even fewer occurrences than the 8 in 41 years.

Figure 7.2-9 shows modeled average-daily storage in New Bullards Bar Reservoir, as well as the maximum-daily storage minimum-daily storage for the period of record and various percent exceedance levels of daily storage.

Modeled daily average water-surface elevations for New Bullards Bar Reservoir for each water year are graphically presented in Figure 7.2-10. As indicated on the figure, the reservoir storage and elevation can fluctuate significantly from year to year; although, the median and mean curves represent general reservoir operation.

Operation of New Bullards Bar Reservoir in terms of storage for the representative dry (2001), normal (2005) and wet (1998) water years is shown in Figure 7.2-11. The range of reservoir elevations in the representative dry (2001), normal (2005), and wet (1998) water years and annual elevation fluctuation in New Bullards Bar Reservoir are summarized in Table 7.2-1.

Table 7.2-1. Modeled minimum and maximum elevations in New Bullards Bar Reservoir in the representative dry (2001), normal (2005) and wet (1998) water years under YCWA’s Proposed Project Alternative model run.

Water Year	Minimum Daily Elevation (feet)	Average Daily Elevation (feet)	Maximum Daily Elevation (feet)	Annual Elevation Fluctuation (feet)
2001 (Dry Year)	1,843	1,869	1,904	61
2005 (Normal Year)	1,860	1,898	1,955	96
1998 (Wet Year)	1,839	1,901	1,956	117

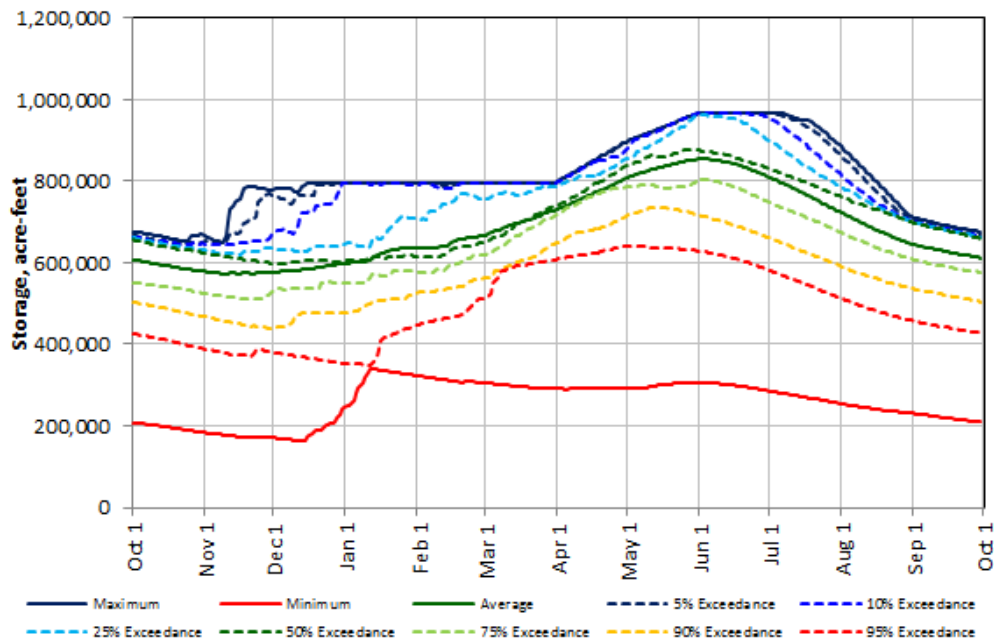


Figure 7.2-9. Modeled average-daily storage in New Bullards Bar Reservoir for various percent exceedances for the simulated period of water years 1970 through 2010 under YCWA’s Proposed Project Alternative model run.

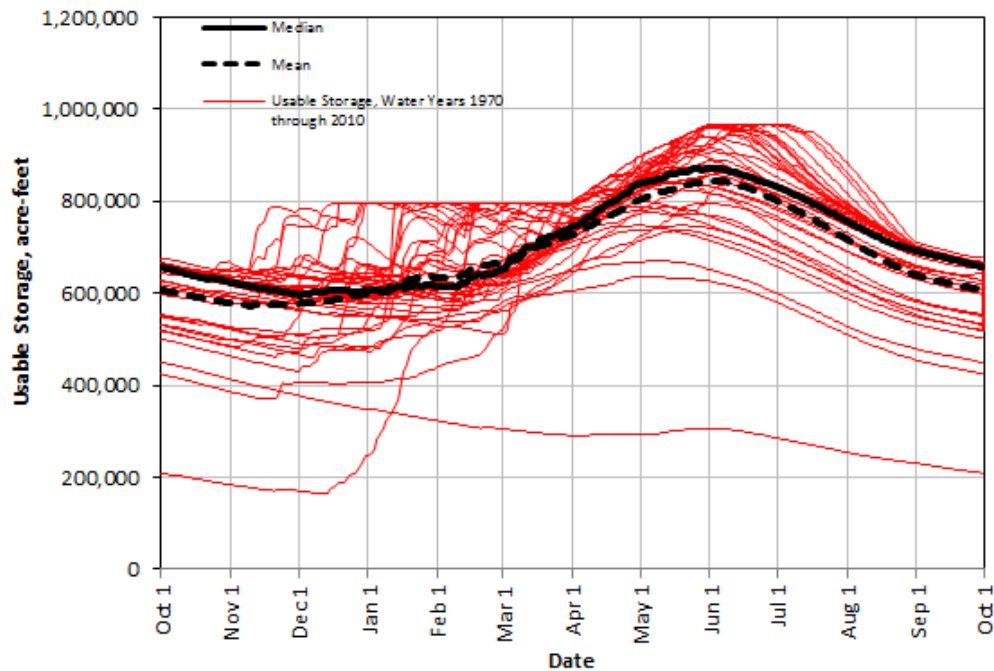


Figure 7.2-10. Modeled New Bullards Bar Reservoir median and mean storage for water years 1970 through 2010 under YCWA’s Proposed Project Alternative model run.

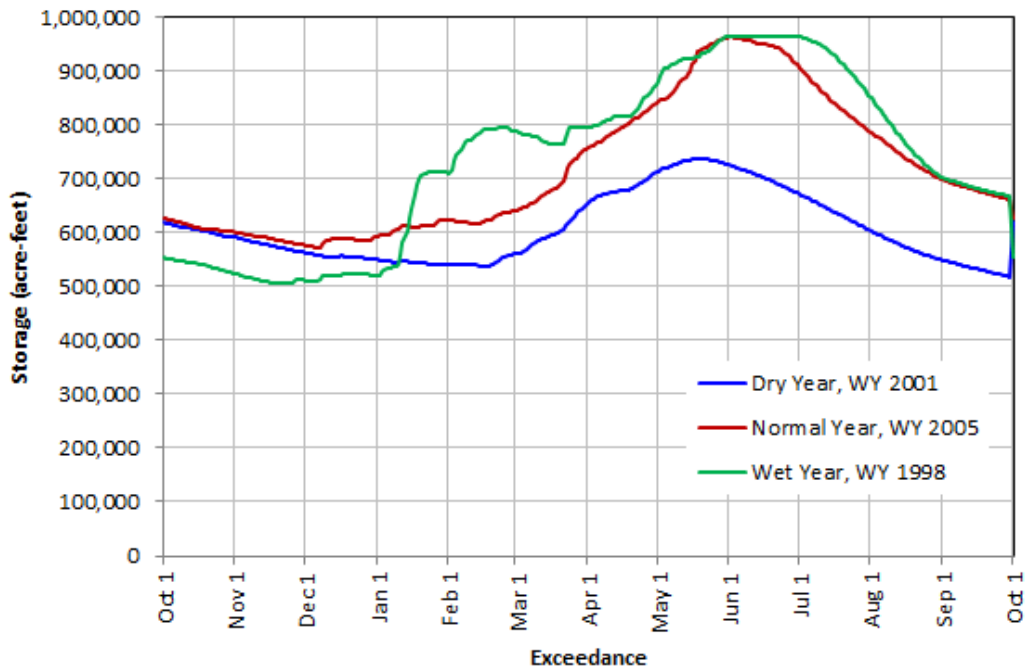


Figure 7.2-11. Modeled New Bullards Bar Reservoir storage for the representative dry (2001), normal (2005), and wet (1998) water years and for the period of record under YCWA’s Proposed Project Alternative model run.

7.2.4 Plant Operations – New Colgate Powerhouse

As described above, the Proposed Project Alternative includes several conditions and measures that will generally reduce flows through the New Colgate Powerhouse, and one proposed feature that will allow for increased generation under certain conditions.

The average annual flow through the New Colgate Powerhouse based on YCWA’s Proposed Project Alternative Model run for WY 1970 through 2010 was 1,051,780 ac-ft. With a theoretical powerhouse capacity of almost 3 million MWh per year (MWh/yr) if the powerhouse always could be operated at full capacity, New Colgate Powerhouse has a plant factor of 44-percent. This is comparable to the national average hydropower plant factor of 43-percent.

7.2.4.1 Powerhouse Minimum, Maximum and Mean Flows

Minimum-, maximum- and mean-daily average flows based on YCWA’s Proposed Project Alternative Model run for WY 1970 through 2010, are 0 cfs, 1,452 cfs and 3,430 cfs, respectively.

7.2.4.2 Powerhouse Flow Duration Curves

Annual and monthly flow duration curves for releases from New Colgate Powerhouse, based on YCWA’s Proposed Project Alternative Model run for WY 1970 through 2010, are provided in Figure 7.2-12.

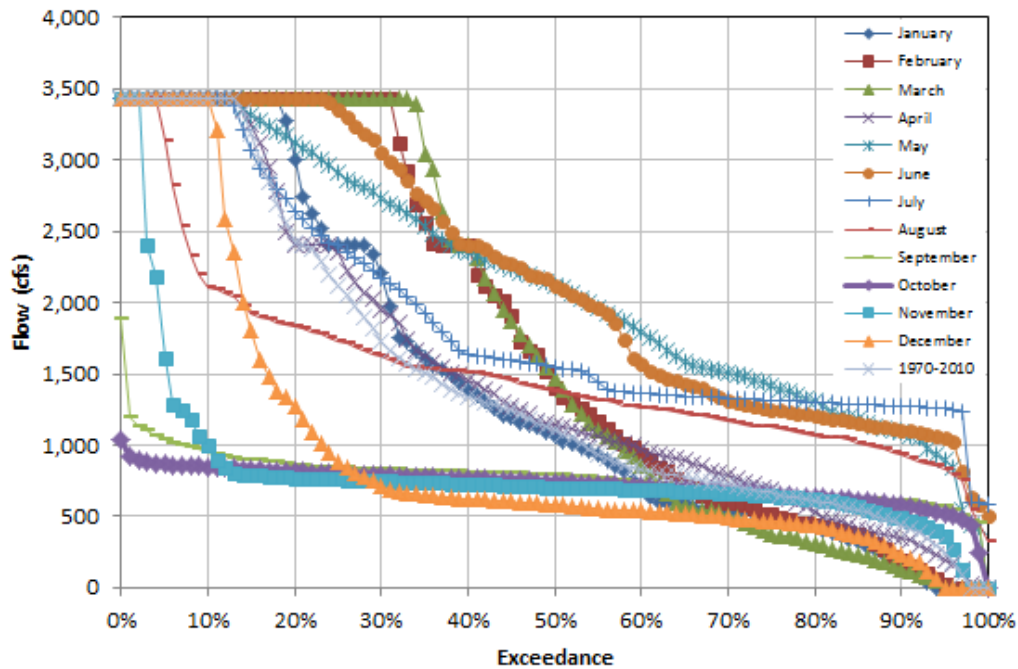


Figure 7.2-12. Modeled monthly flow duration curves for New Colgate Powerhouse for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.

7.2.4.3 Average Annual Energy Production

New Colgate Powerhouse would have generated an average of 1,218,484 MWh/yr from 1970 to 2010 under YCWA’s Proposed Project Alternative Model run. The average annual plant factor for the powerhouse for this time period is 0.44 based on the annual generation divided by the plant nameplate generating capability (315 MW) times the number of hours per year. Annual gross generation and plant factors for the powerhouse are provided in Table 7.2-2.

Table 7.2-2. Modeled generation and plant factors for New Colgate Powerhouse under the Proposed Project Alternative model run.

Water Year	Annual Generation (MWh)	Annual Generation, (aMW)	Plant Capability (MW)	Plant Factor
1970	1,357,797	155	315	0.49
1971	1,633,176	186	315	0.59
1972	1,105,988	126	315	0.40
1973	1,553,382	177	315	0.56
1974	2,166,669	247	315	0.78
1975	1,410,061	161	315	0.51
1976	677,361	77	315	0.25
1977	381,200	43	315	0.14
1978	1,335,349	152	315	0.48
1979	1,050,810	120	315	0.38
1980	1,666,658	190	315	0.60
1981	746,039	85	315	0.27
1982	2,150,674	245	315	0.78
1983	2,233,011	255	315	0.81
1984	1,734,034	198	315	0.63
1985	822,204	94	315	0.30

Table 7.2-2. (continued)

Water Year	Annual Generation (MWh)	Annual Generation, (aMW)	Plant Capability (MW)	Plant Factor
1986	1,359,390	155	315	0.49
1987	616,550	70	315	0.22
1988	549,127	63	315	0.20
1989	1,003,282	114	315	0.36
1990	720,348	82	315	0.26
1991	663,191	76	315	0.24
1992	655,687	75	315	0.24
1993	1,515,916	173	315	0.55
1994	621,341	71	315	0.23
1995	1,898,557	217	315	0.69
1996	1,762,384	201	315	0.64
1997	1,469,590	168	315	0.53
1998	1,834,926	209	315	0.66
1999	1,650,591	188	315	0.60
2000	1,349,762	154	315	0.49
2001	576,072	66	315	0.21
2002	777,260	89	315	0.28
2003	1,370,662	156	315	0.50
2004	979,805	112	315	0.35
2005	1,241,133	142	315	0.45
2006	1,955,240	223	315	0.71
2007	825,637	94	315	0.30
2008	561,659	64	315	0.20
2009	889,115	101	315	0.32
2010	1,086,210	124	315	0.39
Total	49,957,851	--	--	--
Minimum	381,200	43	--	0.14
Average	1,218,484	139	--	0.44
Median	1,241,133	142	--	0.45
Maximum	2,233,011	255	--	0.81

Key: aWM = annual megawatt

7.2.4.4 New Colgate Powerhouse Dependable Capacity

Under the Proposed Project Alternative, the minimum New Bullards Bar Reservoir storage of 163,216 ac-ft occurred on December 13, 1977. Based on this minimum storage and the full flow capacity through the New Colgate Powerhouse, the dependable capacity of the New Colgate Powerhouse under the Proposed Project Alternative is 224,329 kW.

7.3 New Bullards Bar Minimum Flow Development

The Minimum Flow Powerhouse has an estimated capacity of 5 cfs, so any additional required releases to meet the required flows would be made from either the New Bullards Bar Dam low-level outlet, or a new release valve would have to be added. Otherwise, operations for required flows would continue similarly to the No Action Alternative.

7.3.1 Powerhouse Minimum, Maximum and Mean Flows

Minimum-, maximum- and mean-daily average flows based on YCWA’s Proposed Project Alternative Model run for WY 1970 through 2010, are 1.9 cfs, 4.5 cfs and 5.0 cfs, respectively.

7.3.2 Powerhouse Flow Duration Curves

Annual and monthly flow duration curves for releases from New Bullards Bar Minimum Flow Powerhouse, based on YCWA’s Proposed Project Alternative Model run for WY 1970 through 2010, is provided in Figure 7.3-1.

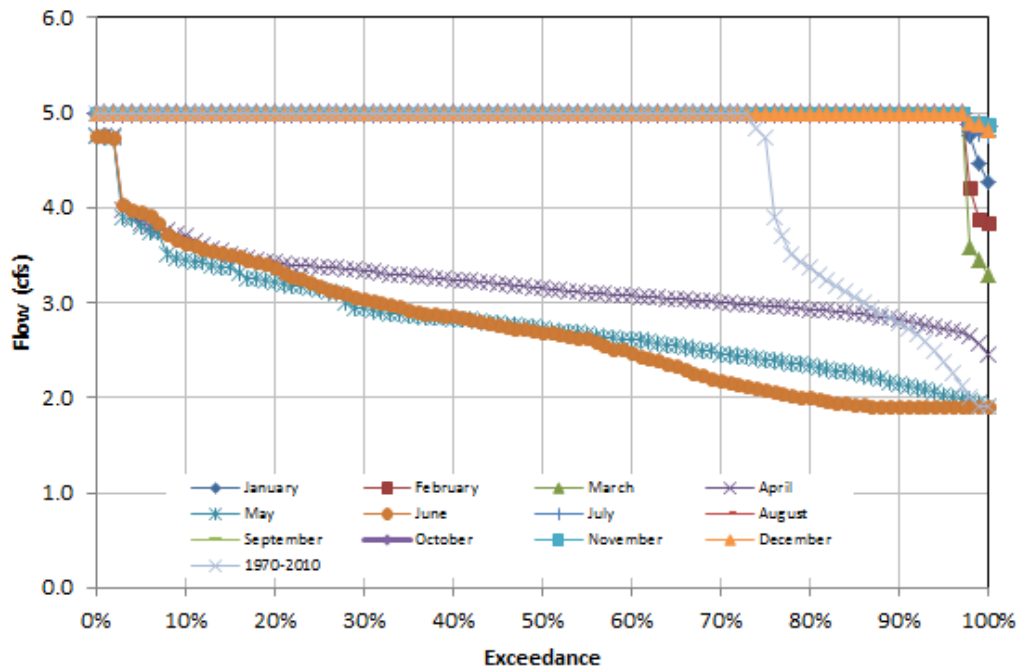


Figure 7.3-1. Modeled monthly flow duration curves for New Bullards Bar Minimum Flow Powerhouse for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.

7.3.3 Average Annual Energy Production

New Bullards Bar Minimum Flow Powerhouse generated an average of 1,298 MWh/yr from 1970 to 2010 under YCWA’s Proposed Project Alternative Model run. The average annual plant factor for the powerhouse for this time period is 99-percent based on the annual generation divided by the plant generating capability (150 kW) times the number of hours per year. Annual gross generation and plant factors for the powerhouse are provided in Table 7.3-1.

Table 7.3-1. Modeled generation and plant factors for New Bullards Bar Minimum Flow Powerhouse under YCWA’s Proposed Project Alternative Model run.

Water Year	Annual Generation (MWh)	Annual Generation (akW)	Plant Capability (kW)	Plant Factor
1970	1,319	150	150	1.00
1971	1,286	147	150	0.98
1972	1,326	151	150	1.01
e1973	1,327	151	150	1.01
1974	1,333	152	150	1.01
1975	1,292	147	150	0.98
1976	1,320	151	150	1.00
1977	1,083	124	150	0.82
1978	1,079	123	150	0.82
1979	1,301	148	150	0.99
1980	1,337	153	150	1.02
1981	1,313	150	150	1.00
1982	1,320	151	150	1.00
1983	1,322	151	150	1.01
1984	1,353	154	150	1.03
1985	1,319	151	150	1.00
1986	1,321	151	150	1.00
1987	1,309	149	150	1.00
1988	1,269	145	150	0.96
1989	1,232	141	150	0.94
1990	1,331	152	150	1.01
1991	1,307	149	150	0.99
1992	1,315	150	150	1.00
1993	1,262	144	150	0.96
1994	1,321	151	150	1.00
1995	1,283	146	150	0.98
1996	1,314	150	150	1.00
1997	1,341	153	150	1.02
1998	1,286	147	150	0.98
1999	1,327	151	150	1.01
2000	1,322	151	150	1.01
2001	1,301	148	150	0.99
2002	1,289	147	150	0.98
2003	1,302	149	150	0.99
2004	1,326	151	150	1.01
2005	1,289	147	150	0.98
2006	1,317	150	150	1.00
2007	1,322	151	150	1.01
2008	1,294	148	150	0.98
2009	1,298	148	150	0.99
2010	1,298	148	150	0.99
Total	53,204	--	--	--
Minimum	1,079	123	--	0.82
Average	1,298	148.0	--	0.99
Median	1,314	149.9	--	1.00
Maximum	1,353	154.3	--	1.03

Key: akW = annual kilowatt

7.3.4 Minimum Flow Powerhouse Dependable Capacity

Dependable capacity at the Minimum Flow Powerhouse at the base of New Bullards Bar Dam is flow limited. The Minimum Flow Powerhouse is operated to meet a minimum required flow on the North Yuba River downstream of New Bullards Bar Dam. Rather than operating at a constant rate according to the required flow, the Minimum Flow Powerhouse is operated to supplement seepage from New Bullards Bar Dam. The dependable capacity for the Minimum Flow Powerhouse is determined by evaluating the period with the lowest release through the minimum flow powerhouse, corresponding to the period with the greatest seepage and lowest reservoir water-surface elevation. On June 26, 1971, there was a mean-daily release of 1.9 cfs through the minimum flow powerhouse and a reservoir storage of 966,000 ac-ft. This combination of circumstances defines the period used to determine the Minimum Flow Powerhouse's dependable capacity of 72 kW under the Proposed Project Alternative.

7.4 Narrows 2 Development

The Narrows 2 Development is minimally affected by changes in Project operations upstream from Englebright Reservoir. The only change from the No Action Alternative to the Proposed Project for operations of the Narrows 2 Development is Condition AR3, Maintain Streamflows Downstream of Narrows 2 Powerhouse and Narrows 2 Full Bypass.

7.4.1 Powerhouse Minimum, Maximum, and Mean Flows

Minimum-, maximum and mean-daily average flows based on YCWA's No Action Alternative Model run for WY 1970 through 2010, are 0.0 cfs, 1,318 cfs and 3,400 cfs, respectively.

7.4.2 Powerhouse Flow Duration Curves

Annual and monthly flow duration curves for releases from Narrows 2 Powerhouse, based on YCWA's Proposed Project Alternative Model run for WY 1970 through 2010, is provided in Figure 7.4-1. Annual and monthly flow duration curves for releases from Narrows 2 Bypass, based on YCWA's Proposed Project Alternative Model run for WY 1970 through 2010, is provided in Figure 7.4-2.

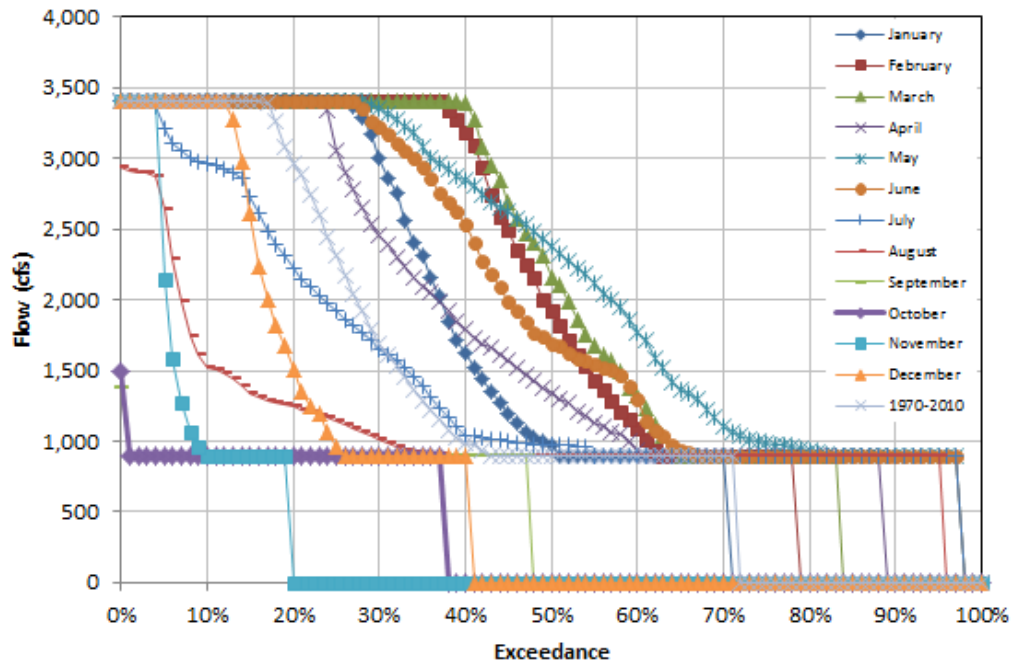


Figure 7.4-1. Modeled monthly flow duration curves for Narrows 2 Powerhouse for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.

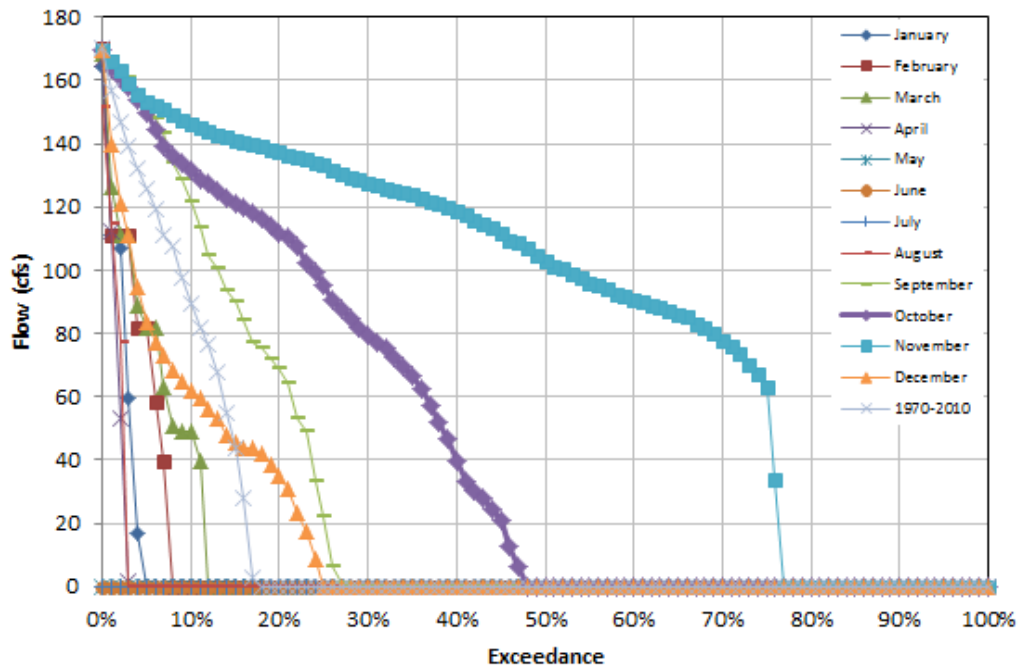


Figure 7.4-2. Modeled monthly flow duration curves for Narrows 2 Bypass for water years 1970 through 2010 under YCWA’s Proposed Project Alternative Model run.

7.4.3 Average Annual Energy Production

Narrows 2 Powerhouse generated an average of 172,253MWh/yr from 1970 to 2010 under YCWA’s Proposed Project Alternative Model run. The average annual plant factor for the powerhouse for this time period is 0.42 based on the annual generation divided by the plant generating capability (46.7 MW) times the number of hours per year. Annual gross generation and plant factors for the powerhouse are provided in Table 7.4-1.

Table 7.4-1. Generation and plant factors for Narrows 2 Powerhouse under YCWA’s Proposed Project Alternative Model run.

Water Year	Annual Generation (MWh)	Annual Generation (aMW)	Plant Capability (MW)	Plant Factor
1970	188,729	21.5	46.7	0.46
1971	275,219	31.4	46.7	0.67
1972	147,982	16.9	46.7	0.36
1973	233,949	26.7	46.7	0.57
1974	344,911	39.3	46.7	0.84
1975	232,179	26.5	46.7	0.57
1976	65,872	7.5	46.7	0.16
1977	0	0.0	46.7	0.00
1978	226,797	25.9	46.7	0.55
1979	145,958	16.7	46.7	0.36
1980	249,299	28.4	46.7	0.61
1981	74,814	8.5	46.7	0.18
1982	338,123	38.6	46.7	0.83
1983	360,053	41.1	46.7	0.88
1984	266,425	30.4	46.7	0.65
1985	98,804	11.3	46.7	0.24
1986	199,809	22.8	46.7	0.49
1987	47,457	5.4	46.7	0.12
1988	41,314	4.7	46.7	0.10
1989	141,957	16.2	46.7	0.35
1990	79,451	9.1	46.7	0.19
1991	58,377	6.7	46.7	0.14
1992	59,701	6.8	46.7	0.15
1993	253,949	29.0	46.7	0.62
1994	50,946	5.8	46.7	0.12
1995	303,157	34.6	46.7	0.74
1996	261,751	29.9	46.7	0.64
1997	220,441	25.1	46.7	0.54
1998	294,119	33.6	46.7	0.72
1999	250,271	28.6	46.7	0.61
2000	185,918	21.2	46.7	0.45
2001	43,327	4.9	46.7	0.11
2002	93,678	10.7	46.7	0.23
2003	210,649	24.0	46.7	0.51
2004	121,696	13.9	46.7	0.30
2005	189,457	21.6	46.7	0.46
2006	295,039	33.7	46.7	0.72
2007	87,534	10.0	46.7	0.21
2008	50,750	5.8	46.7	0.12
2009	112,972	12.9	46.7	0.28
2010	159,531	18.2	46.7	0.39
Total	7,062,362	--	--	--
Minimum	0	0	--	0.00

Table 7.4-1. (continued)

Water Year	Annual Generation (MWh)	Annual Generation (aMW)	Plant Capability (MW)	Plant Factor
Average	172,253	19.7	--	0.42
Median	185,918	21.2	--	0.45
Maximum	360,053	41.1	--	0.88

Key: aMW = annual megawatt

7.4.4 Narrows 2 Powerhouse Dependable Capacity

The Narrows 2 Powerhouse dependable capacity is flow limited. Historically, there were no releases through the Narrows 2 Powerhouse for most of 1977; all releases from Englebright Reservoir were made through PG&E's Narrows 1 Powerhouse during that time. Accordingly, the lack of releases through the Narrows 2 Powerhouse defines the critical streamflow for determining the dependable capacity for the powerhouse. The dependable capacity for the Narrows 2 Powerhouse under the Proposed Project Alternative is 0 kW.

8.0 Literature Cited

State Water Resources Control Board (SWRCB). 2003. Revised Water Right Decision 1644 In the Matter of: Fishery Resources and Water Right Issues of the Lower Yuba River. July 16 2003.

_____. 2008. Order WR 2008-0014. Order Approving Petition for Modification and Petition for Long-Term Transfer of Water. March 2008.

United States Army Corps of Engineers (USACE). 1972. New Bullards Bar Reservoir Regulation for Flood Control. June 1972.

United States Bureau of Reclamation and Department of Water Resources (DWR). 1986. Agreement Between the United States of America and the State of California for Coordinated Operation of the Central Valley Project and the State Water Project. 1986

United States Federal Power Commission (FPC). 1963. Order Issuing License and Accepting Surrender of License. May 1963.

_____. 1966. P-2246 35 FPC Order Amending License (Major). FPC, Washington DC. May 6, 1966.

United States Geological Survey (USGS). 1992. USGS Office of Surface Water Technical Memorandum No. 93.07, December 4, 1992.

_____. 2004. Water-Data Report CA-04-4. Water Resources Data California Water Year 2004 Volume 4 Northern Central Valley Basins and the Great Basin from Honey Lake Basin to Oregon State Line, 2004.

Yuba County Water Agency (YCWA). 2000. Yuba River Basin Model: Operations and Simulation Procedures. January 2000.

_____. 2007. Draft Environmental Impact Report/ Environmental Impact Statement for the Proposed Lower Yuba River Accord. June 2007.

_____. 2013a. Technical Memorandum 2-2, Water Balance/Operations Model. Prepared by HDR for the Relicensing of the Yuba River Development Project (FERC Project No. 2246).

_____. 2013b. Section 3.3.2. Water Resources. Prepared by HDR for the Relicensing of the Yuba River Development Project (FERC Project No. 2246).

Yuba County Water Agency and Pacific Gas and Electric Company. 1966. Power Purchase Contract. May 1966.